

Cardiff[®]
Air Conditioning

1. Product Lineup

T1 application

| Nominal ton | Model | Function | Air Outlet | Power Supply |
|-------------|-------------|-----------|-----------------|------------------|
| 6.2 | CMR4-072HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |
| 7.5 | CMR4-075HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |
| 8.5 | CMR4-085HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |
| 10 | CMR4-100HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |
| 12.5 | CMR4-125HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |
| 15 | CMR4-150HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |
| 17.5 | CMR4-175HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |
| 20 | CMR4-200HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |
| 25 | CMR4-250HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |
| 30 | CMR4-300HWT | Heat pump | Side air supply | 380~415V-3N-50Hz |

Note: Please refer to specification tables for accurate cooling or heating capacity with Kw or Btu/h unit.

2. External Appearance



6.2&7.5Ton



8.5&10Ton



12.5&15Ton



17.5&20Ton



25&30Ton

4. Features

4.1 High reliability and high efficiency

Outstanding reliability

- ◆ Midea rooftop package units shall be factory assembled, internally wired, fully charged refrigerant and 100% run tested to check cooling and heating operation, fan and blower rotation, and control sequence before leaving the factory. Wiring internal to the unit shall be colored and numbered for simplified identification. The unit is provided with an integral weather resistant control panel.
- ◆ Multiple self-protecting functions guarantee the safety of unit and running perfectly: high-pressure protection, low-pressure protection, over-heat protection, over-current protection and so on.

Reliable components

- ◆ Famous brand compressor, high IP class motor, reliable pressure switch.



Excellent efficiency

- ◆ High efficiency scroll compressor;
- ◆ Enlarge the air inlet area space contribute a high efficiency.


Durable construction

- ◆ Pre-painted exterior cabinet panels pass 1000-hour Salt Spray Test for durability.
- ◆ Weather-resistant construction with capped seams and sloped top panels.
- ◆ G90 galvanized heavy gauge plate conforming to ASTM-A-653, Zinc content of galvanized plate is 275 g/m².



New fan duct design

- ◆ Optimized fan vane shape reduces pressure loss and improves heat exchange efficiency.

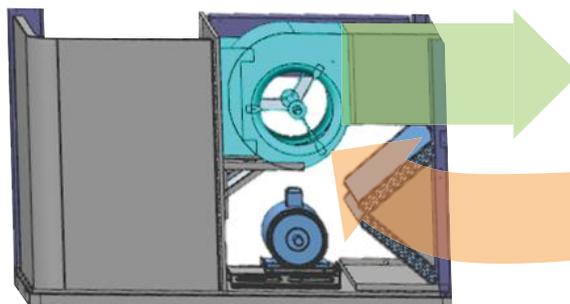


Adjustable Pulley

- ◆ Through changing the working pitch diameter of the pulley mounted on driver shaft, in turn the revolutions per minute of the driven shaft will increase or decrease to change air volume.



Well compressor control

- ◆ Compressor start-stop is controlled directly by the main control board. To prevent compressor start and stop frequently, when the unit first / re-power, the compressor will delay three minutes to start, when the indoor temperature is below the set temperature or mode conversion or system protection, the compressor will start after seven minutes delay.
- ◆ It has two-stage control for the system which has two compressors. The system will shut off one compressor in condition of part load.

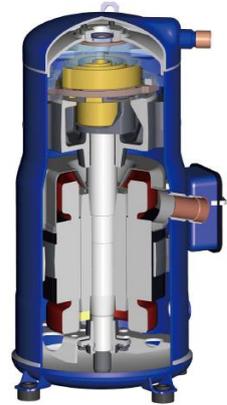



Compressor cycle duty operation

- ◆ When the set temperature and ambient temperature meet one compressor to start, for the first time to open compressor A, compressor B start next time, this extends the compressor's life span effectively.

4.2 Easy installation and service

Design flexibility, easy to install

- ◆ New structure design, compact design, smaller body size, reduce transfer cost.;
- ◆ Rooftop or ground is selectable to install.
- ◆ Anywhere removable as requirement without fixed.

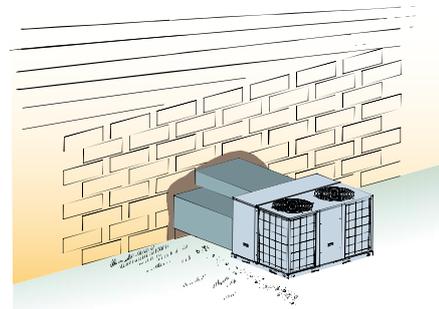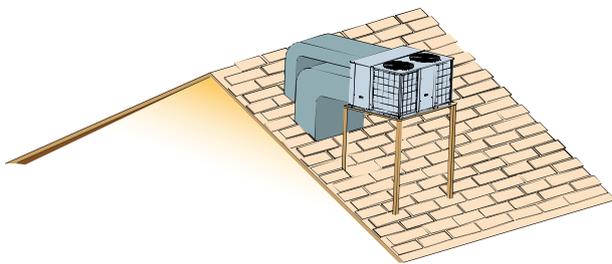

Easy drainage

- ◆ External drainage port reserved, quickly and accurately connect the rubber drainage pipe.




External pressure gauge ports

- ◆ The unit provide external pressure gauge ports, for convenient and fast checking without remove the panel.



✚ Easy access doors

- ◆ Installer no need to enter inside of the door, only out-of-doors.
- ◆ Provide easy access to system components for maintenance and service.
- ◆ Removable access doors on the filter, fan motor, and control box sections.

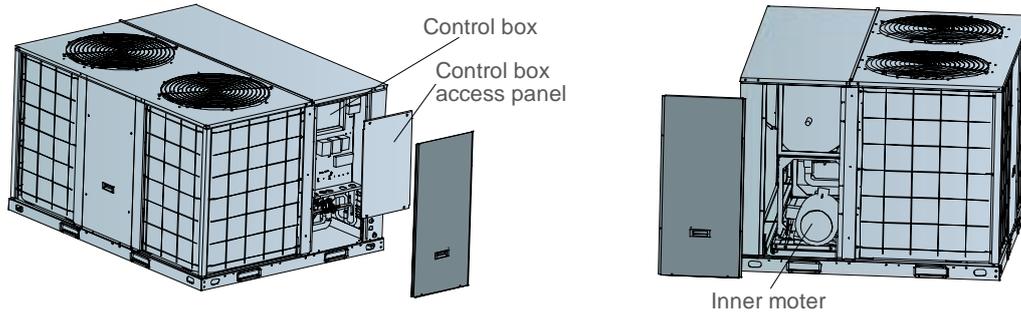


✚ Low voltage connections

- ◆ All ports of low voltage wires are integrated in the PCB board,so it is easy and safe for the installer to wire.



✚ System self-diagnostic

- ◆ The system self-diagnostic function, press the “check” button, the LED displays the normal checking code. When the unit is in running with abnormal operation, the LED will display the error code.



4.3 Standard features/options/accessories

| Description | Standard features | Options (factory installed) | Accessories (field installed) |
|---|-------------------|--------------------------------|----------------------------------|
| Horizontal discharge | ◆ | | |
| Compressor crankcase heaters | ◆ | | |
| Evaporator fan-belt driven | ◆ | | |
| Evaporator fan motor-ODP type(TEFC type optional) | ◆ | | |
| Condenser fan-direct drive, propeller type(Except 5ton) | ◆ | | |
| Condenser fan-direct drive, axial type(Only 5ton) | ◆ | | |
| Condenser fan motor-totally enclosed air-over type | ◆ | | |
| Filter, Nylon | | ◆ | |
| Filter, aluminum(Thickness 25mm) | | ◆ | |
| Compressor overload protection | ◆ | | |
| Low &high pressure switch | ◆ | | |
| Cooling & heating thermostat | ◆ | | |
| Condenser fan guard | ◆ | | |
| Condenser coil guard | ◆ | | |
| Wired controller KJR-12B | ◆ | | |
| Wired controller KJR-23B | | | ◆ |
| Wired controller KJR-25B | | | ◆ |
| Drainage pipe | | | ◆ |
| Drainage outlet | | | ◆ |
| Snap ring | | | ◆ |

T1 application

| Nominal ton | | (Ton) | 6.2 | 7.5 | 8.5 | 10 |
|------------------------|------------------------|---------|-------------------|-------------------|-------------------|-------------------|
| Model | | | CMR4-072HWT | CMR4-075HWT | CMR4-085HWT | CMR4-100HWT |
| Power Supply | | V,Ph,Hz | 380~415V,3Ph,50Hz | 380~415V,3Ph,50Hz | 380~415V,3Ph,50Hz | 380~415V,3Ph,50Hz |
| Cooling | Cooling Capacity | Btu/h | 75000 | 89000 | 103000 | 120000 |
| | | kW | 22.0 | 26.0 | 30.0 | 35.0 |
| | Power Input | kW | 6.6 | 7.9 | 9.3 | 10.7 |
| Heating | Heating Capacity | Btu/h | 89000 | 103000 | 120000 | 137000 |
| | | kW | 26 | 30 | 35 | 40 |
| | Power Input | kW | 7.5 | 8.9 | 10.6 | 11.9 |
| Max. input consumption | | kW | 8.6 | 12.0 | 13.6 | 15.0 |
| Max. current | | A | 18.3 | 24.8 | 26.5 | 28.8 |
| Performance | Indoor fan air flow | CFM | 2800 | 2830 | 3500 | 4100 |
| | ESP | Pa | 80 | 80 | 80 | 90 |
| | EER | Btu/h/W | 11.4 | 11.3 | 11.1 | 11.2 |
| | COP | Btu/h/W | 11.8 | 11.6 | 11.3 | 11.5 |
| Indoor Coil | Number of rows | | 4 | 3 | 4 | 4 |
| | Fin spacing | mm | 1.3 | 1.3 | 1.5 | 1.5 |
| | | FPI | 19 | 19 | 17 | 17 |
| | Tube diameter | mm | 7 | 7 | 7 | 7 |
| | | inch | 9/32 | 9/32 | 9/32 | 9/32 |
| Indoor fan | Type | | FC Centrifugal | FC Centrifugal | FC Centrifugal | FC Centrifugal |
| | Quantity | | 1 | 1 | 1 | 1 |
| | Drive type | | Direct | Direct | Belt | Belt |
| | Motors quantity | | 1 | 1 | 1 | 1 |
| | Motor model | | YDK750-4E | YDK750-4E | YE2-90L-4-1.5KW | YE2-90L-4-1.5KW |
| Compressor | Type | | Scroll | Scroll | Scroll | Scroll |
| | Quantity | | 1 | 1 | 2 | 2 |
| | Model | | ZP72KCE-TFD-522 | H CJ106T4LC6 | E604DH-59D2Gx2 | E654DH-65D2Gx2 |
| | Brand | | Copeland | Danfoss | Hitachi | Hitachi |
| | Capacity | Btu/h | 58345 | 89053 | 52784x2 | 58345x2 |
| | Refrigerant oil charge | ml | 1656 | 2400 | 1300x2 | 1300x2 |
| Outdoor Coil | Number of rows | | 2.5 | 3 | 2.5 | 2.5 |
| | Fin spacing | mm | 1.5 | 1.5 | 1.5 | 1.5 |
| | | FPI | 17 | 17 | 17 | 17 |
| | Tube diameter | mm | 7 | 7 | 7 | 7 |
| | | inch | 9/32 | 9/32 | 9/32 | 9/32 |
| Outdoor Fan | Type | | Propeller | Propeller | Propeller | Propeller |
| | Quantity | | 1 | 1 | 1 | 1 |
| | Drive type | | Direct | Direct | Direct | Direct |
| | Motors quantity | | 1 | 1 | 1 | 1 |
| | Motor model | | YDK450-6C | YDK580-6C | YDK580-6C | YS1100-6P |
| Refrigerant | Type | | R410A | R410A | R410A | R410A |
| | Refrigerant volume | kg | 5 | 4.8 | 2.5+2.5 | 2.6+2.6 |
| | Refrigerant Control | | Piston | Piston | Piston | Piston |
| Net Weight | | kg | 229 | 244 | 340 | 343 |
| Gross Weight | | kg | 234 | 249 | 350 | 354 |
| Net Dimension | WxHxD | mm | 1475x840x1130 | 1475x840x1130 | 1483x1138x1231 | 1483x1138x1231 |
| Packing | WxHxD | mm | 1497x867x1152 | 1497x867x1152 | 1492x1248x1146 | 1492x1248x1146 |
| Shipping | Qty/Per 20'/40'/40'HQ | | 12/24/48 | 12/24/48 | 8/16/32 | 8/16/32 |

Note:

The data are based on the following conditions:

Cooling : Indoor Temperature 26.7°C(80°F) DB / 19.4°C(67°F) WB; - Outdoor Temperature 35°C(95°F) DB.

Heating and Power input: Indoor Temperature 20°C(68°F) DB/15°C(59°F) WB; - Outdoor Temperature 7°C(44.6°F) DB/6°C(42.8°F) DB

| Nominal ton | | (Ton) | 12.5 | 15 | 17.5 |
|------------------------|------------------------|---------|--------------------------------------|--------------------------------------|--------------------|
| Model | | | CMR4-125HWT | CMR4-150HWT | CMR4-175HWT |
| Power Supply | | V,Ph,Hz | 380~415V,3Ph,50Hz | 380~415V,3Ph,50Hz | 380~415V,3Ph,50Hz |
| Cooling | Cooling Capacity | Btu/h | 150000 | 180000 | 208000 |
| | | kW | 43.0 | 53.0 | 61.0 |
| | Power Input | kW | 13.3 | 16.7 | 19.1 |
| Heating | Heating Capacity | Btu/h | 154000 | 191000 | 218000 |
| | | kW | 45 | 56 | 64 |
| | Power Input | kW | 13.2 | 17.2 | 19.5 |
| Max. input consumption | | kW | 19.7 | 25.0 | 27.0 |
| Max. current | | A | 38.2 | 46.1 | 55.4 |
| Performance | Indoor fan air flow | CFM | 5500 | 7000 | 7600 |
| | ESP | Pa | 110 | 110 | 110 |
| | EER | Btu/h/W | 11.3 | 10.8 | 10.9 |
| | COP | Btu/h/W | 11.7 | 11.1 | 11.2 |
| Indoor Coil | Number of rows | | 4 | 4 | 3 |
| | Fin spacing | mm | 1.3 | 1.3 | 1.3 |
| | | FPI | 19 | 19 | 20 |
| | Tube diameter | mm | 7 | 7 | 7 |
| inch | | 9/32 | 9/32 | 9/32 | |
| Indoor fan | Type | | FC Centrifugal | FC Centrifugal | FC Centrifugal |
| | Quantity | | 1 | 1 | 1 |
| | Drive type | | Belt | Belt | Belt |
| | Motors quantity | | 1 | 1 | 1 |
| | Motor model | | YE2-100L2-4-3KW | YE2-112M-4-4KW | YE2-112M-4-4KW |
| Compressor | Type | | Scroll | Scroll | Scroll |
| | Quantity | | 2 | 2 | 2 |
| | Model | | ZP61KCE-TFD-522+ ZP122KCE-TFD-522 | ZP61KCE-TFD-522+ ZP144KCE-TFD-522 | ZP122KCE-TFD-522x2 |
| | Brand | | Copeland | Copeland | Copeland |
| | Capacity | Btu/h | 49986+102018 | 49986+120500 | 102018x2 |
| | Refrigerant oil charge | ml | 1656+2513 | 1656+3253 | 2513x2 |
| Outdoor Coil | Number of rows | | 3 | 3.5 | 2.5 |
| | Fin spacing | mm | 1.5 | 1.6 | 1.5 |
| | | FPI | 17 | 16 | 17 |
| | Tube diameter | mm | 7 | 8 | 7 |
| inch | | 9/32 | 5/16 | 9/32 | |
| Outdoor Fan | Type | | Propeller | Propeller | Propeller |
| | Quantity | | 1 | 1 | 2 |
| | Drive type | | Direct | Direct | Direct |
| | Motors quantity | | 1 | 1 | 2 |
| | Motor model | | YDK550-6E | YS1100-6 | YDK550-6E |
| Refrigerant | Type | | R410A | R410A | R410A |
| | Refrigerant volume | Kg | 2.1+3.4 | 2.85+5.9 | 5.5+5.5 |
| | Refrigerant Control | | Piston | Piston | Piston |
| Net Weight | | kg | 451 | 492 | 615 |
| Gross Weight | | kg | 471 | 512 | 645 |
| Net Dimension | WxHxD | mm | 1965x1230x1130 | 1965x1230x1130 | 2192x1247x1670 |
| Packing | WxHxD | mm | 1990x1260x1140 | 1990x1260x1140 | 2212x1284x1695 |
| Shipping | Qty/Per 20'/40'/40'HQ | | 6/12/24 | 6/12/24 | 3/7/14 |

Note:

The data are based on the following conditions:

Cooling: : Indoor Temperature 26.7°C(80°F) DB / 19.4°C(67°F) WB; - Outdoor Temperature 35°C(95°F) DB.

Heating and Power input: Indoor Temperature 20°C(68°F) DB/15°C(59°F) WB; - Outdoor Temperature 7°C(44.6°F) DB/6°C(42.8°F) DB.

| Nominal ton | | (Ton) | 20 | 25 | 30 |
|------------------------|------------------------|---------|--------------------|-------------------|-------------------|
| Model | | | CMR4-200HWT | CMR4-250HWT | CMR4-300HWT |
| Power Supply | | V,Ph,Hz | 380~415V,3Ph,50Hz | 380~415V,3Ph,50Hz | 380~415V,3Ph,50Hz |
| Cooling | Cooling Capacity | Btu/h | 240000 | 300000 | 360000 |
| | | kW | 70.0 | 87.0 | 105.0 |
| | Power Input | kW | 22.6 | 28.85 | 35.29 |
| Heating | Heating Capacity | Btu/h | 260000 | 330000 | 380000 |
| | | kW | 75 | 97.0 | 111.5 |
| | Power Input | kW | 23.6 | 30.28 | 35.19 |
| Max. input consumption | | kW | 32.5 | 38.5 | 42.7 |
| Max. current | | A | 63.2 | 74.3 | 81.7 |
| Performance | Indoor fan air flow | CFM | 8800 | 10000 | 12000 |
| | ESP | Pa | 120 | 130 | 270 |
| | EER | Btu/h/W | 10.6 | 10.4 | 10.2 |
| | COP | Btu/h/W | 11 | 10.9 | 10.8 |
| Indoor Coil | Number of rows | | 4 | 4 | 4 |
| | Fin spacing | mm | 1.3 | 1.6 | 1.6 |
| | | FPI | 20 | 16 | 16 |
| | Tube diameter | mm | 7 | 8 | 8 |
| inch | | 9/32 | 5/16 | 5/16 | |
| Indoor fan | Type | | FC Centrifugal | FC Centrifugal | FC Centrifugal |
| | Quantity | | 1 | 1 | 1 |
| | Drive type | | Belt | Belt | Belt |
| | Motors quantity | | 1 | 1 | 1 |
| | Motor model | | YE2-132S-4-5.5KW | YE2-132M-4-7.5KW | YE2-132M-4-7.5KW |
| Compressor | Type | | Scroll | Scroll | Scroll |
| | Quantity | | 2 | 2 | 2 |
| | Model | | ZP144KCE-TFD-522x2 | SH161A4ALC*2 | SH184A4ALC*2 |
| | Brand | | Copeland | Danfoss | Danfoss |
| | Capacity | Btu/h | 120500x2 | 132386x2 | 152383x2 |
| | Refrigerant oil charge | ml | 3253x2 | 3300x2 | 3600x2 |
| Outdoor Coil | Number of rows | | 3 | 3+2 | 3+3 |
| | Fin spacing | mm | 1.5 | 1.5 | 1.5 |
| | | FPI | 17 | 16 | 16 |
| | Tube diameter | mm | 7 | 8 | 8 |
| inch | | 9/32 | 5/16 | 5/16 | |
| Outdoor Fan | Type | | Propeller | Propeller | Propeller |
| | Quantity | | 2 | 2 | 2 |
| | Drive type | | Direct | Direct | Direct |
| | Motors quantity | | 2 | 2 | 2 |
| | Motor model | | YS1100-6-3 | YS1500-6-2 | YS1500-6-2 |
| Refrigerant | Type | | R410A | R410A | R410A |
| | Refrigerant volume | kg | 6.7+6.7 | 6.0+6.0 | 7.6+7.6 |
| | Refrigerant Control | | Piston | Capillary | Capillary |
| Net Weight | | kg | 690 | 940 | 955 |
| Gross Weight | | kg | 720 | 970 | 985 |
| Net Dimension | WxHxD | mm | 2192x1247x1670 | 2220x1245x2320 | 2220x1245x2320 |
| Packing | WxHxD | mm | 2212x1284x1695 | 2230x1275x2330 | 2230x1275x2330 |
| Shipping | Qty/Per 20'/40'/40'HQ | | 3/7/14 | 2/5/10 | 2/5/10 |

Note:



The data are based on the following conditions:

Cooling: : Indoor Temperature 26.7°C(80°F) DB / 19.4°C(67°F) WB; - Outdoor Temperature 35°C(95°F) DB.



Heating and Power input: Indoor Temperature 20°C(68°F) DB/15°C(59°F) WB; - Outdoor Temperature 7°C(44.6°F) DB/6°C(42.8°F) DB.

6. Dimensional Drawings





6.1 6.2&7.5ton

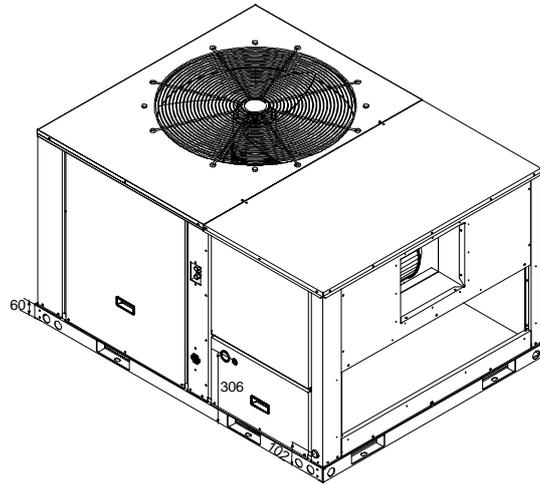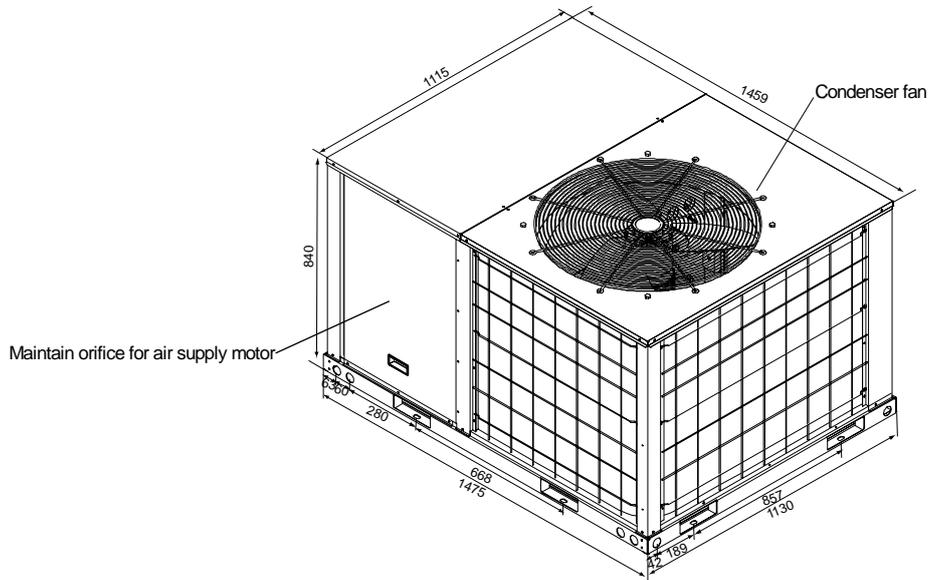



Hole for bottom installation
8 - 15 x 20

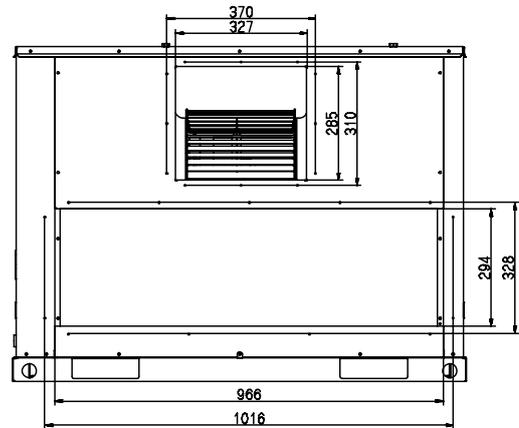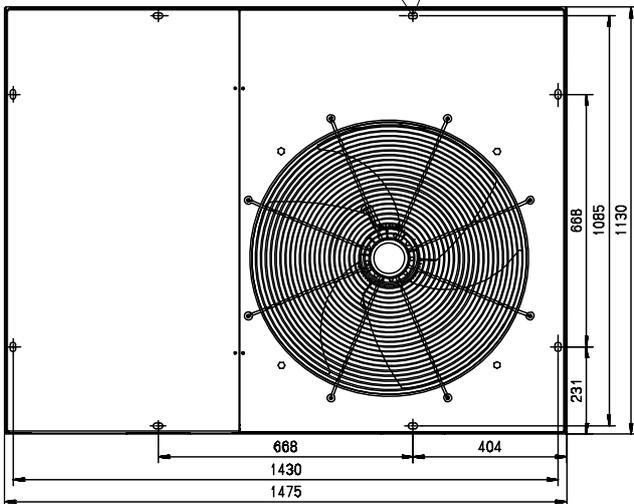



6.2 8.5&10ton

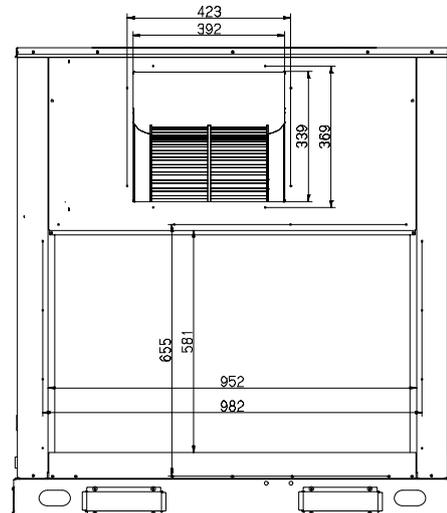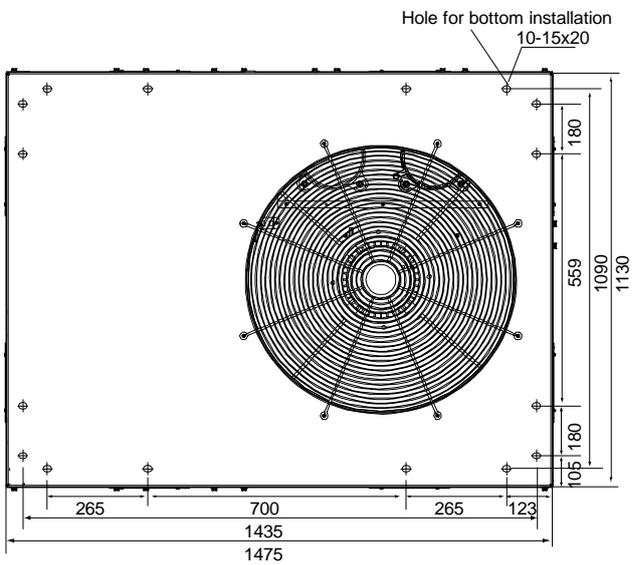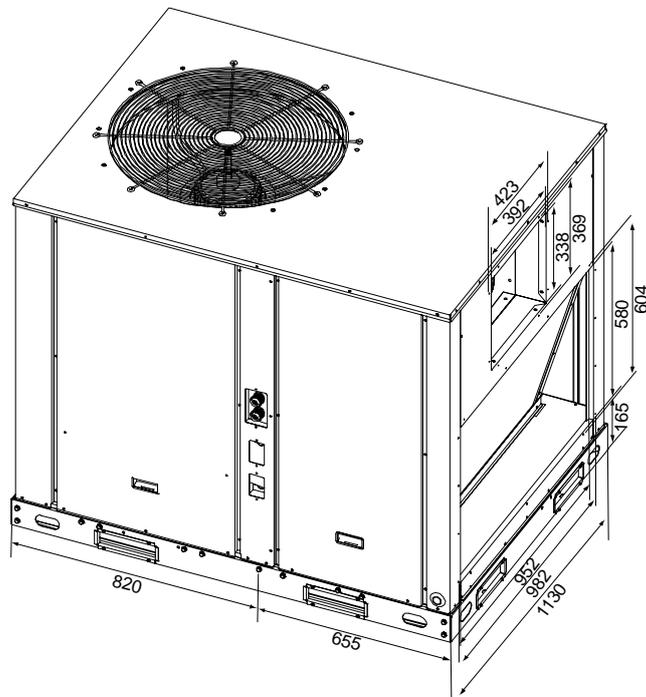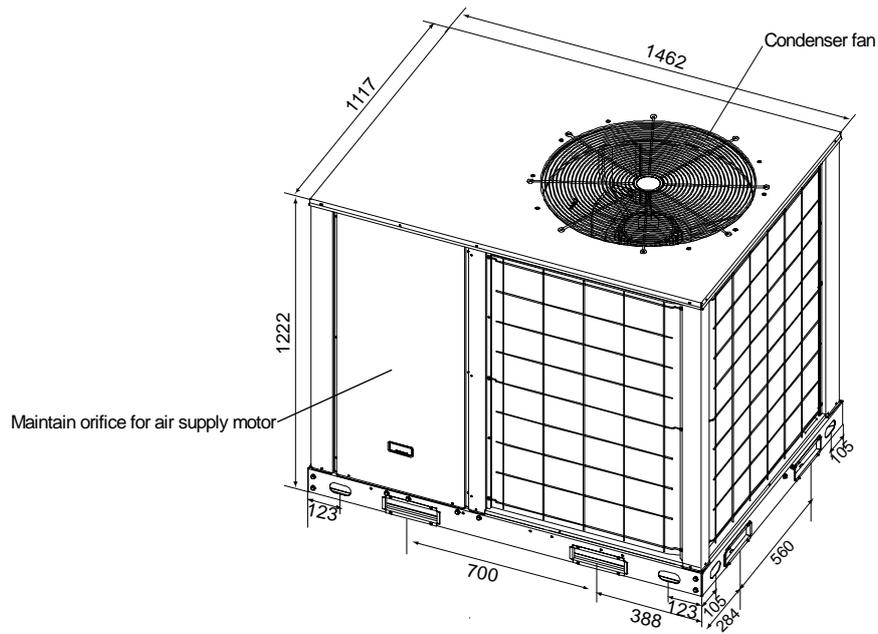



6.3 12.5&15ton

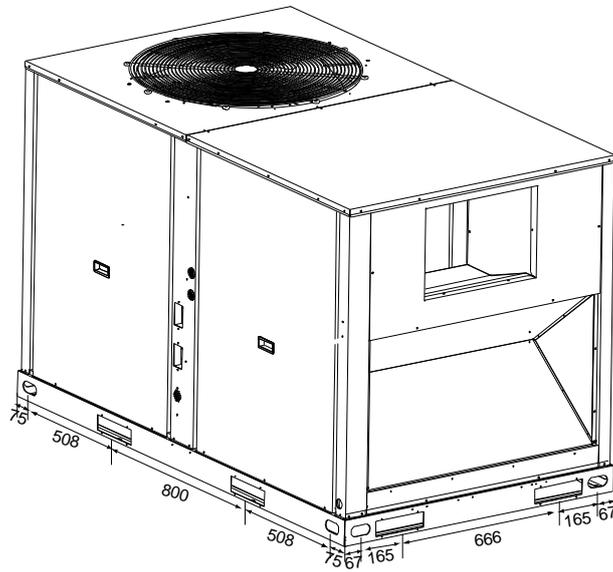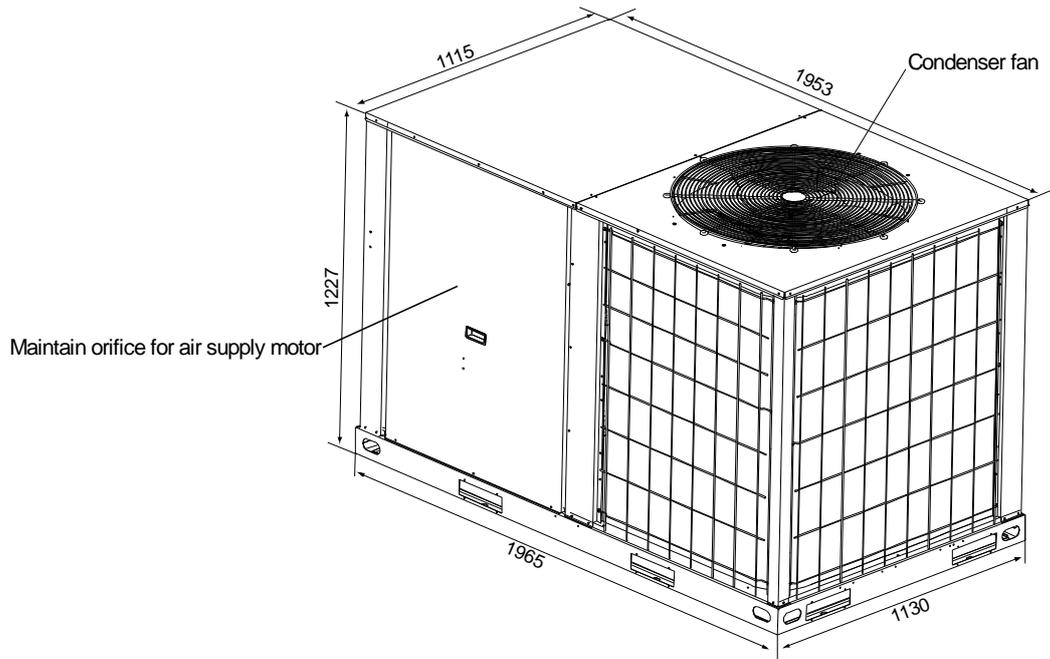



Hole for bottom installation,
12-15x20

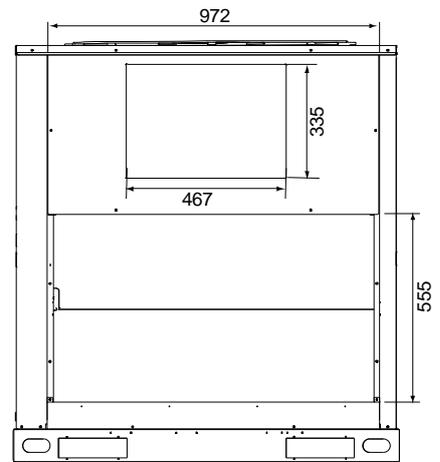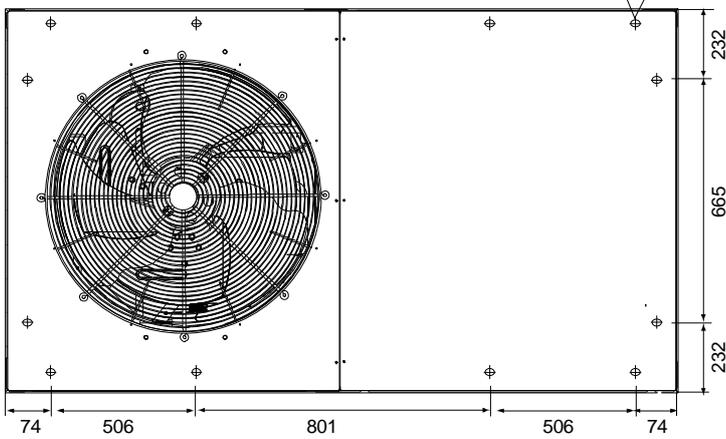





6.4 17.5&20on

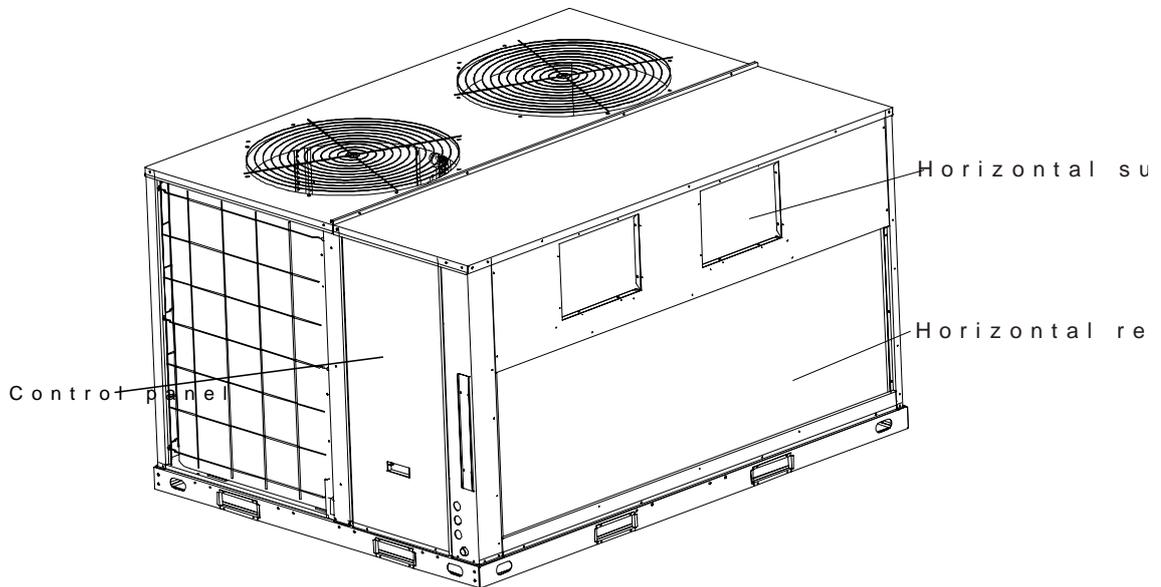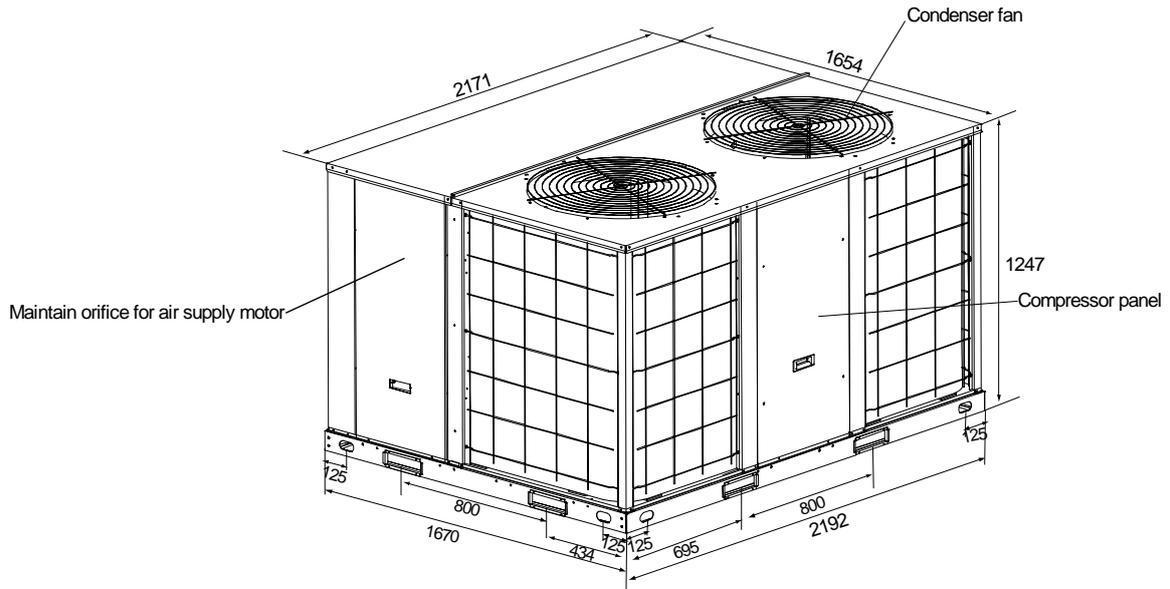

Hole for bottom installation
14-15x20

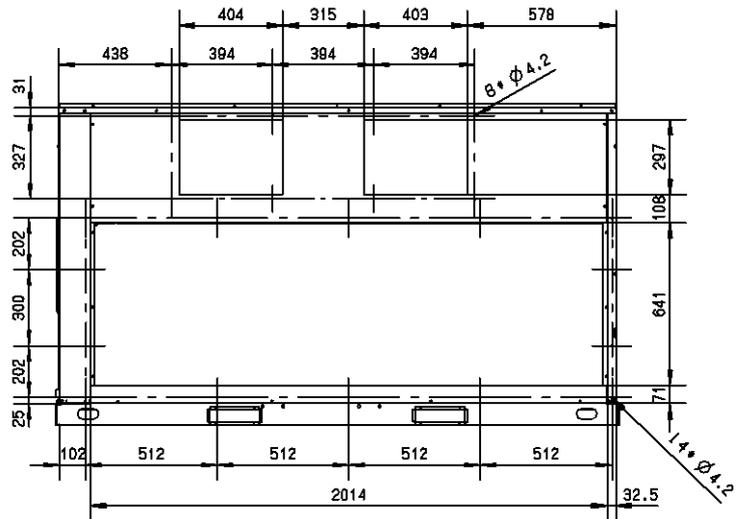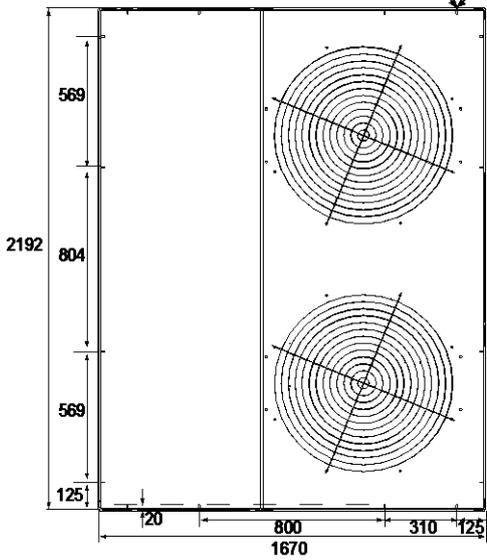


6.5 25&30ton

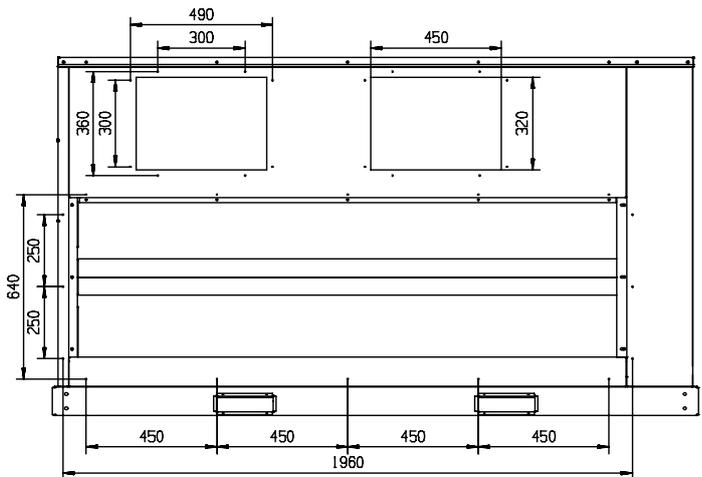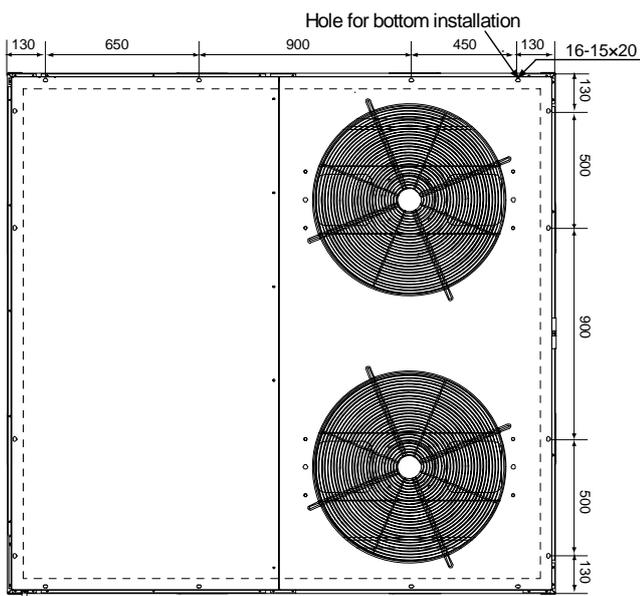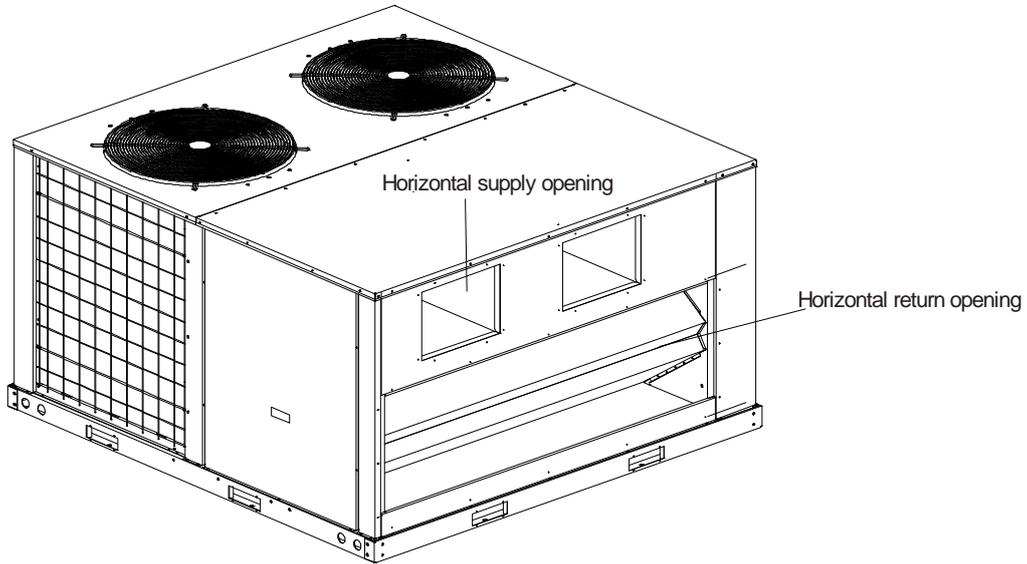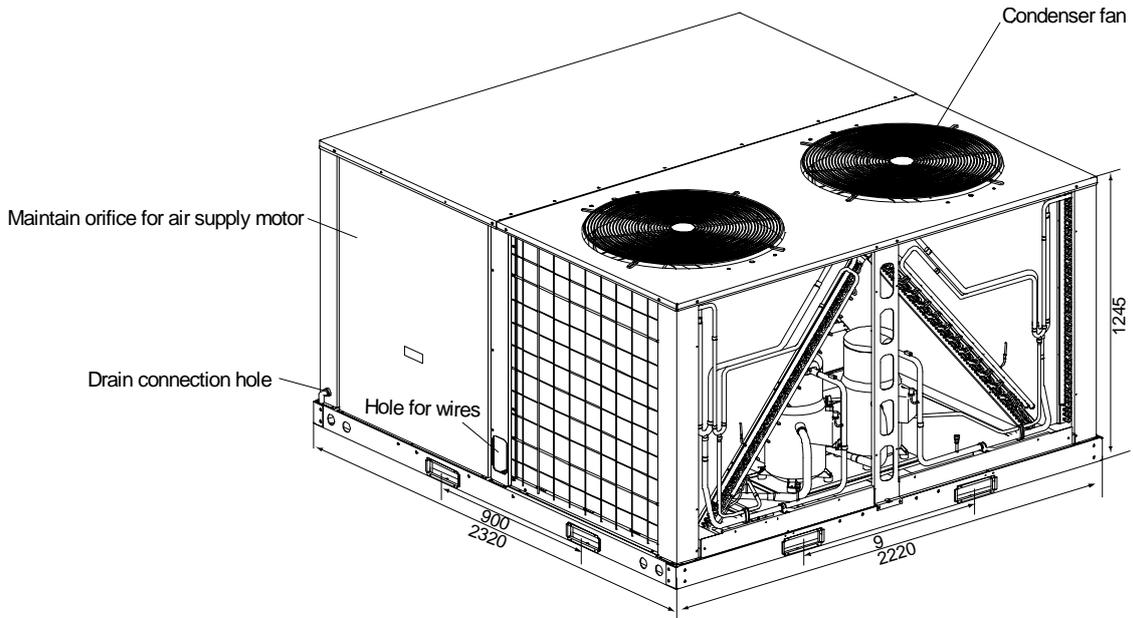


T1 application


7.13 CMR4-062HWT

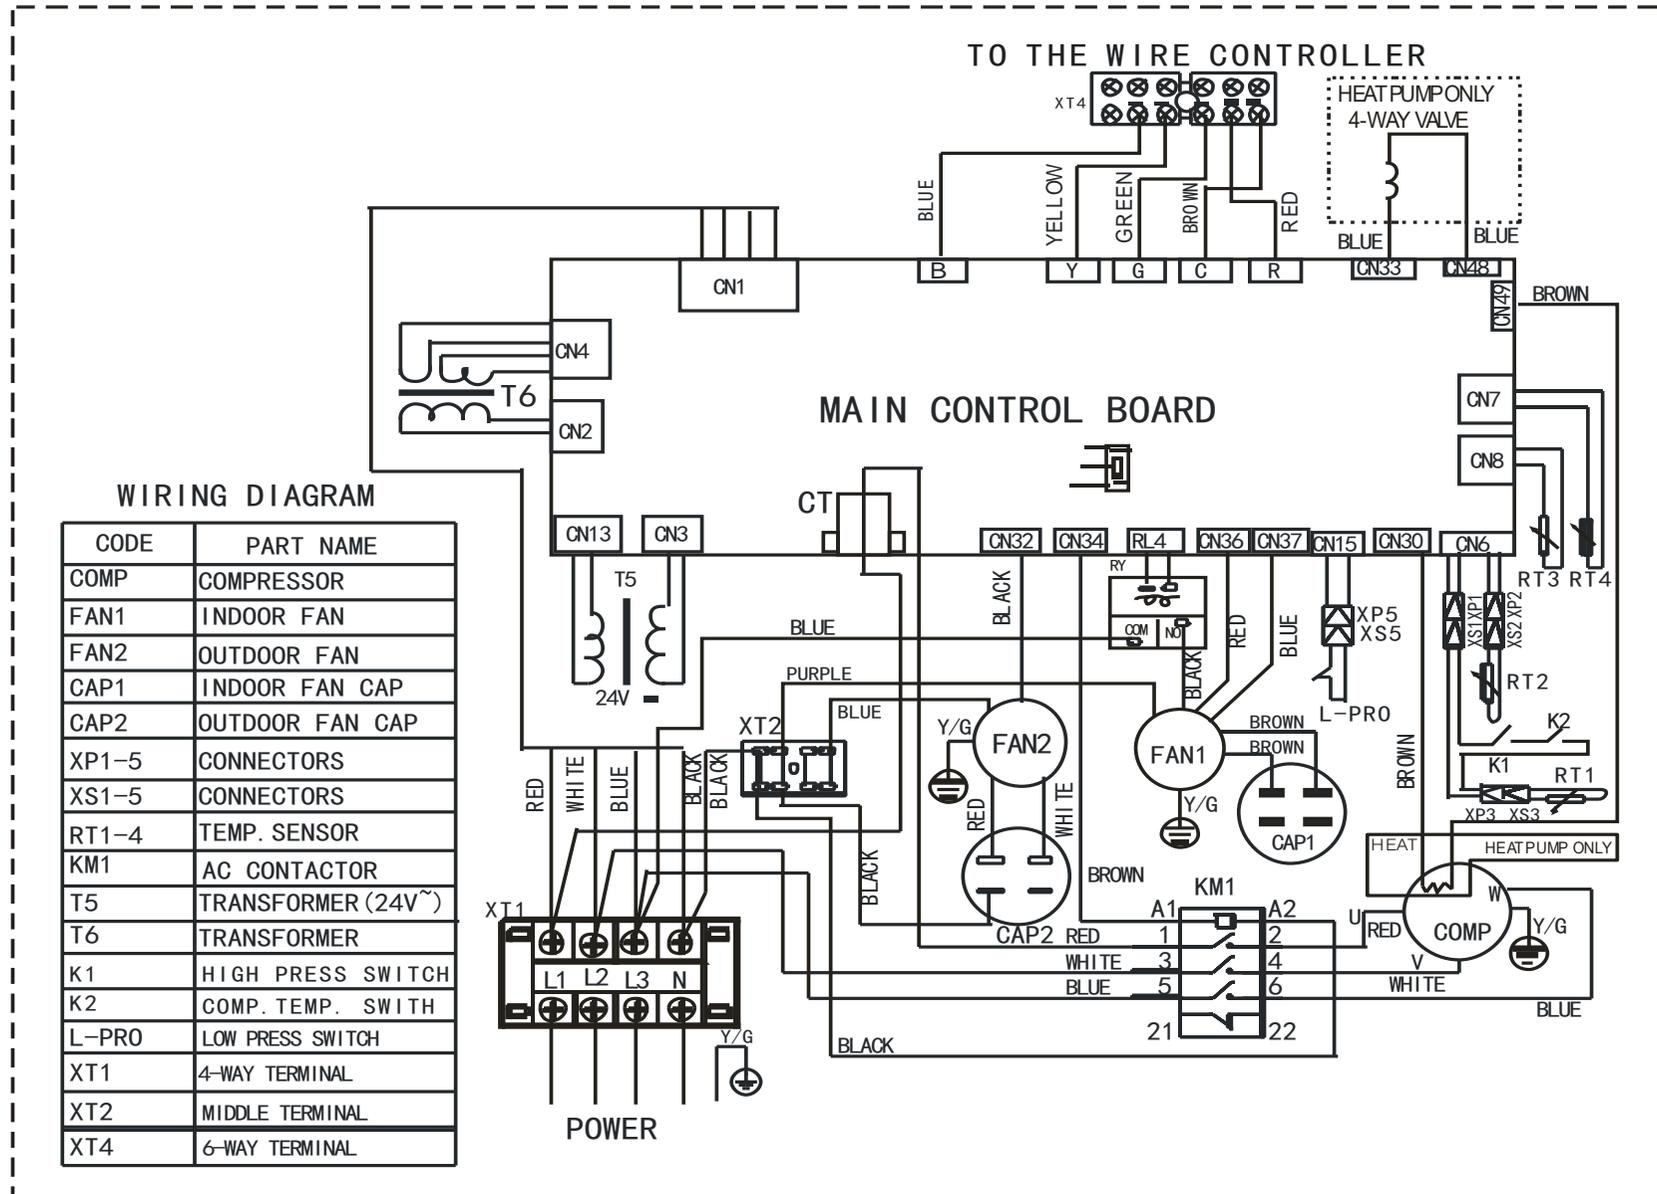


7.14 CMR4-075HWT

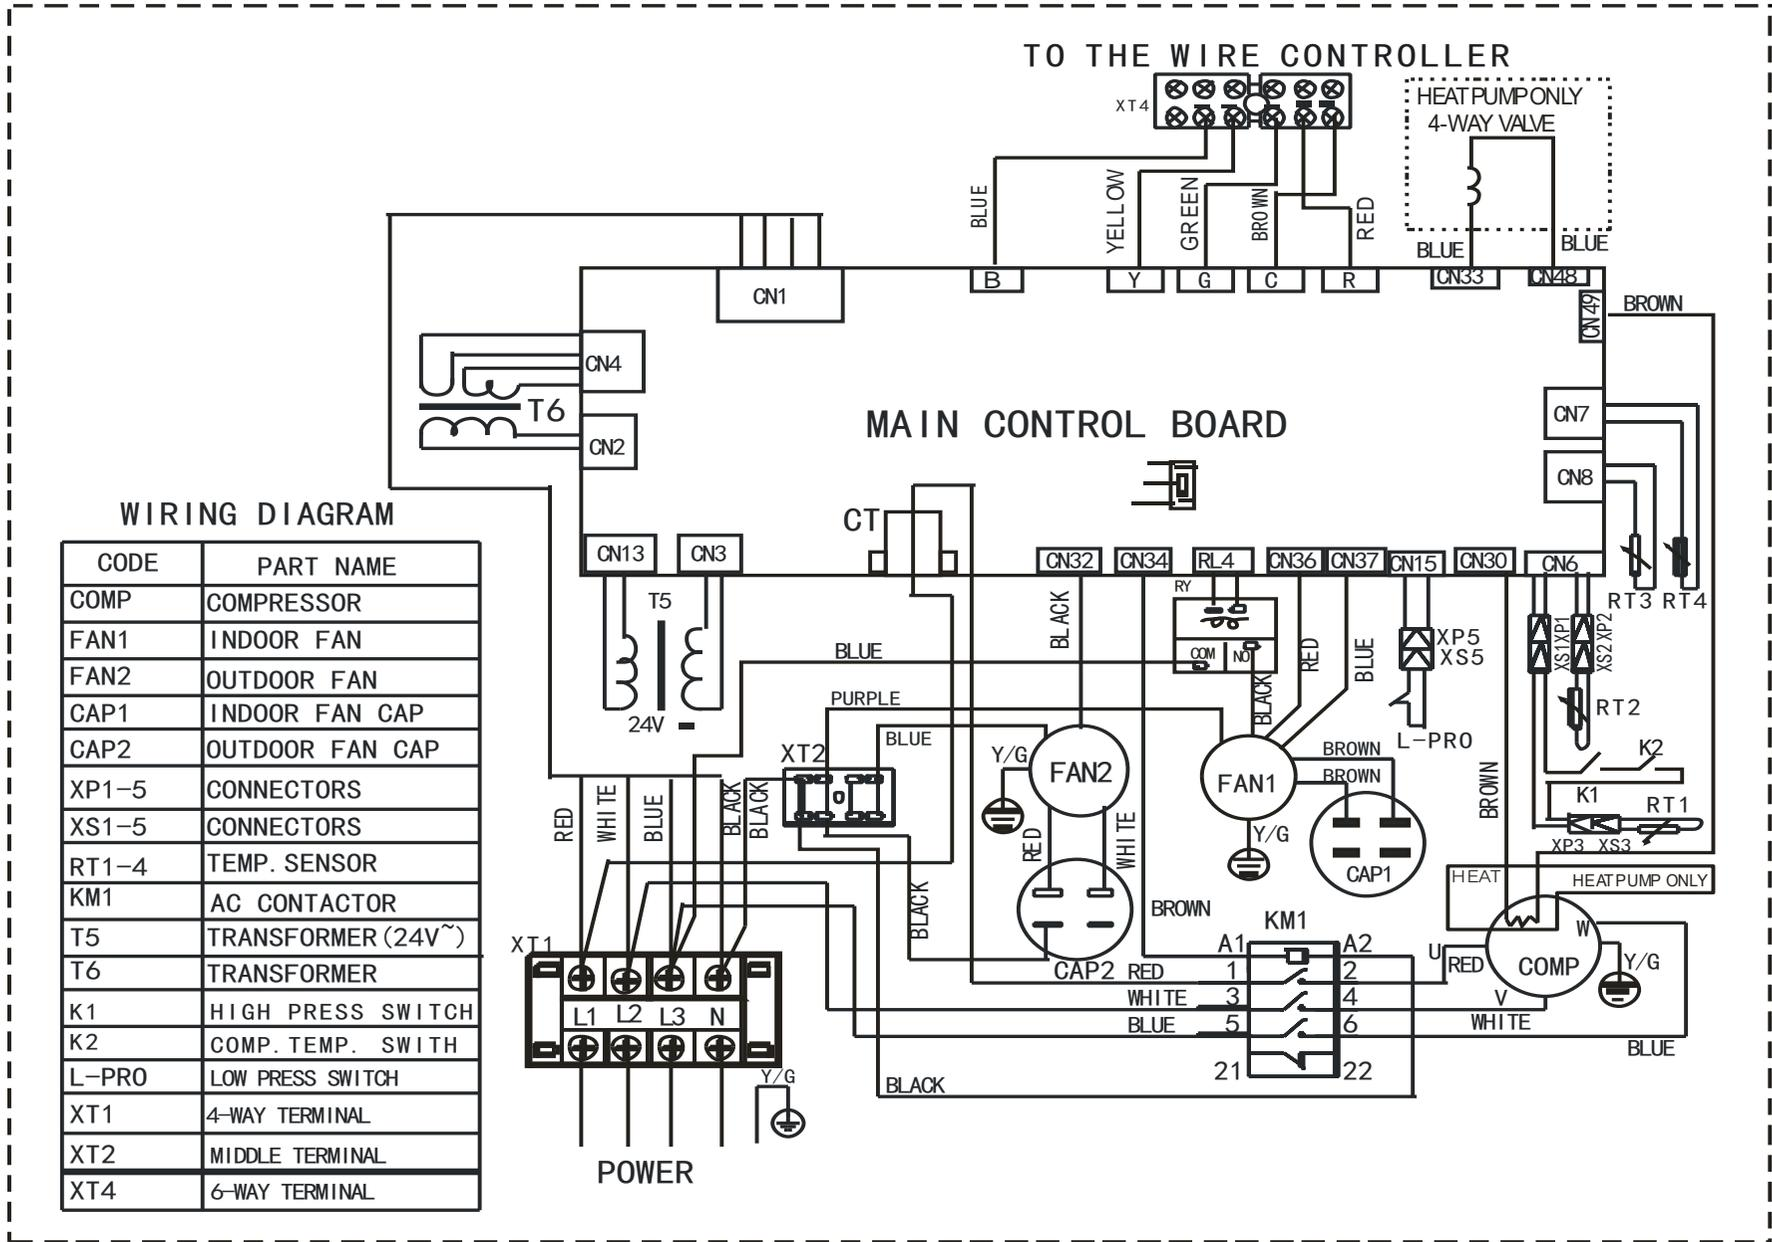


7.15 CMR4-085HWT

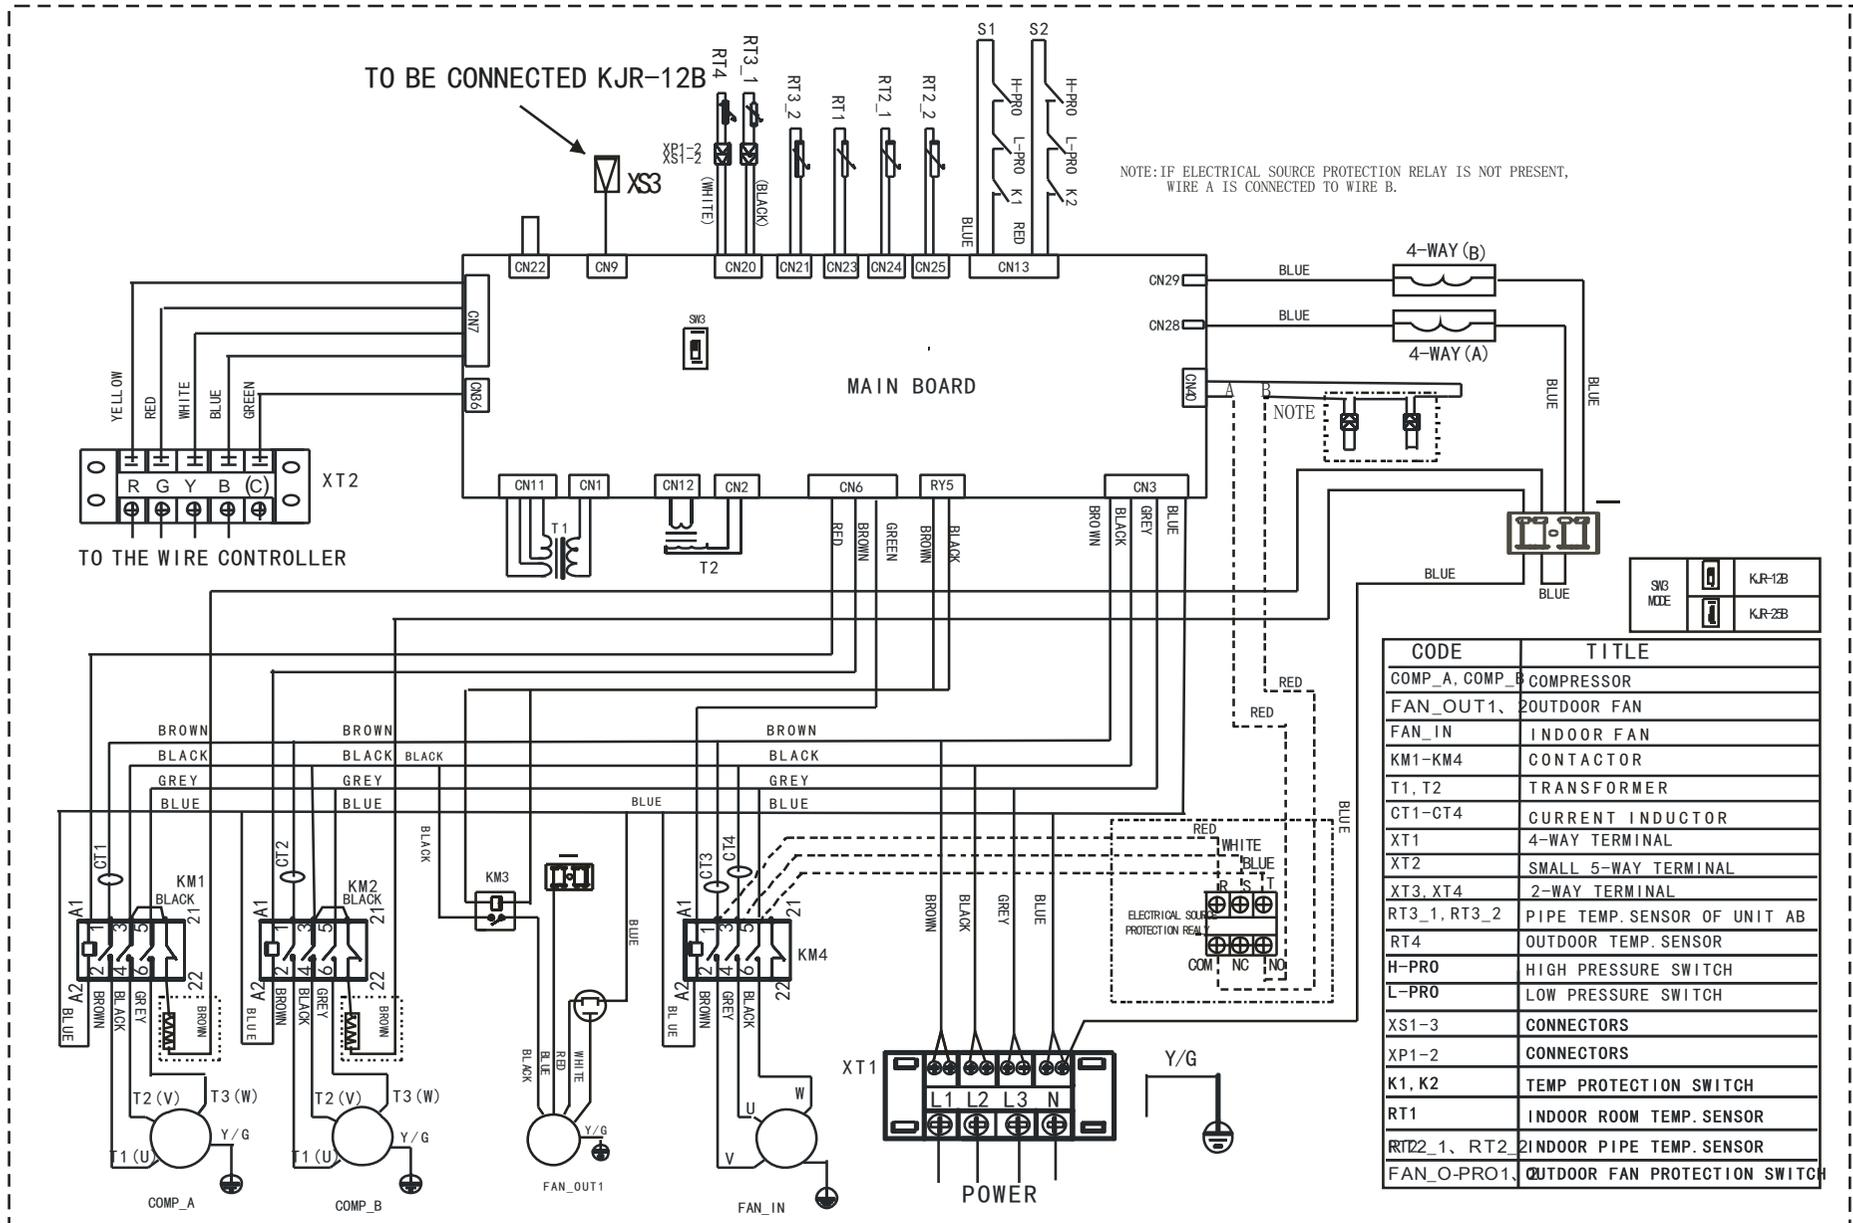


7.16 CMR4-100HWT

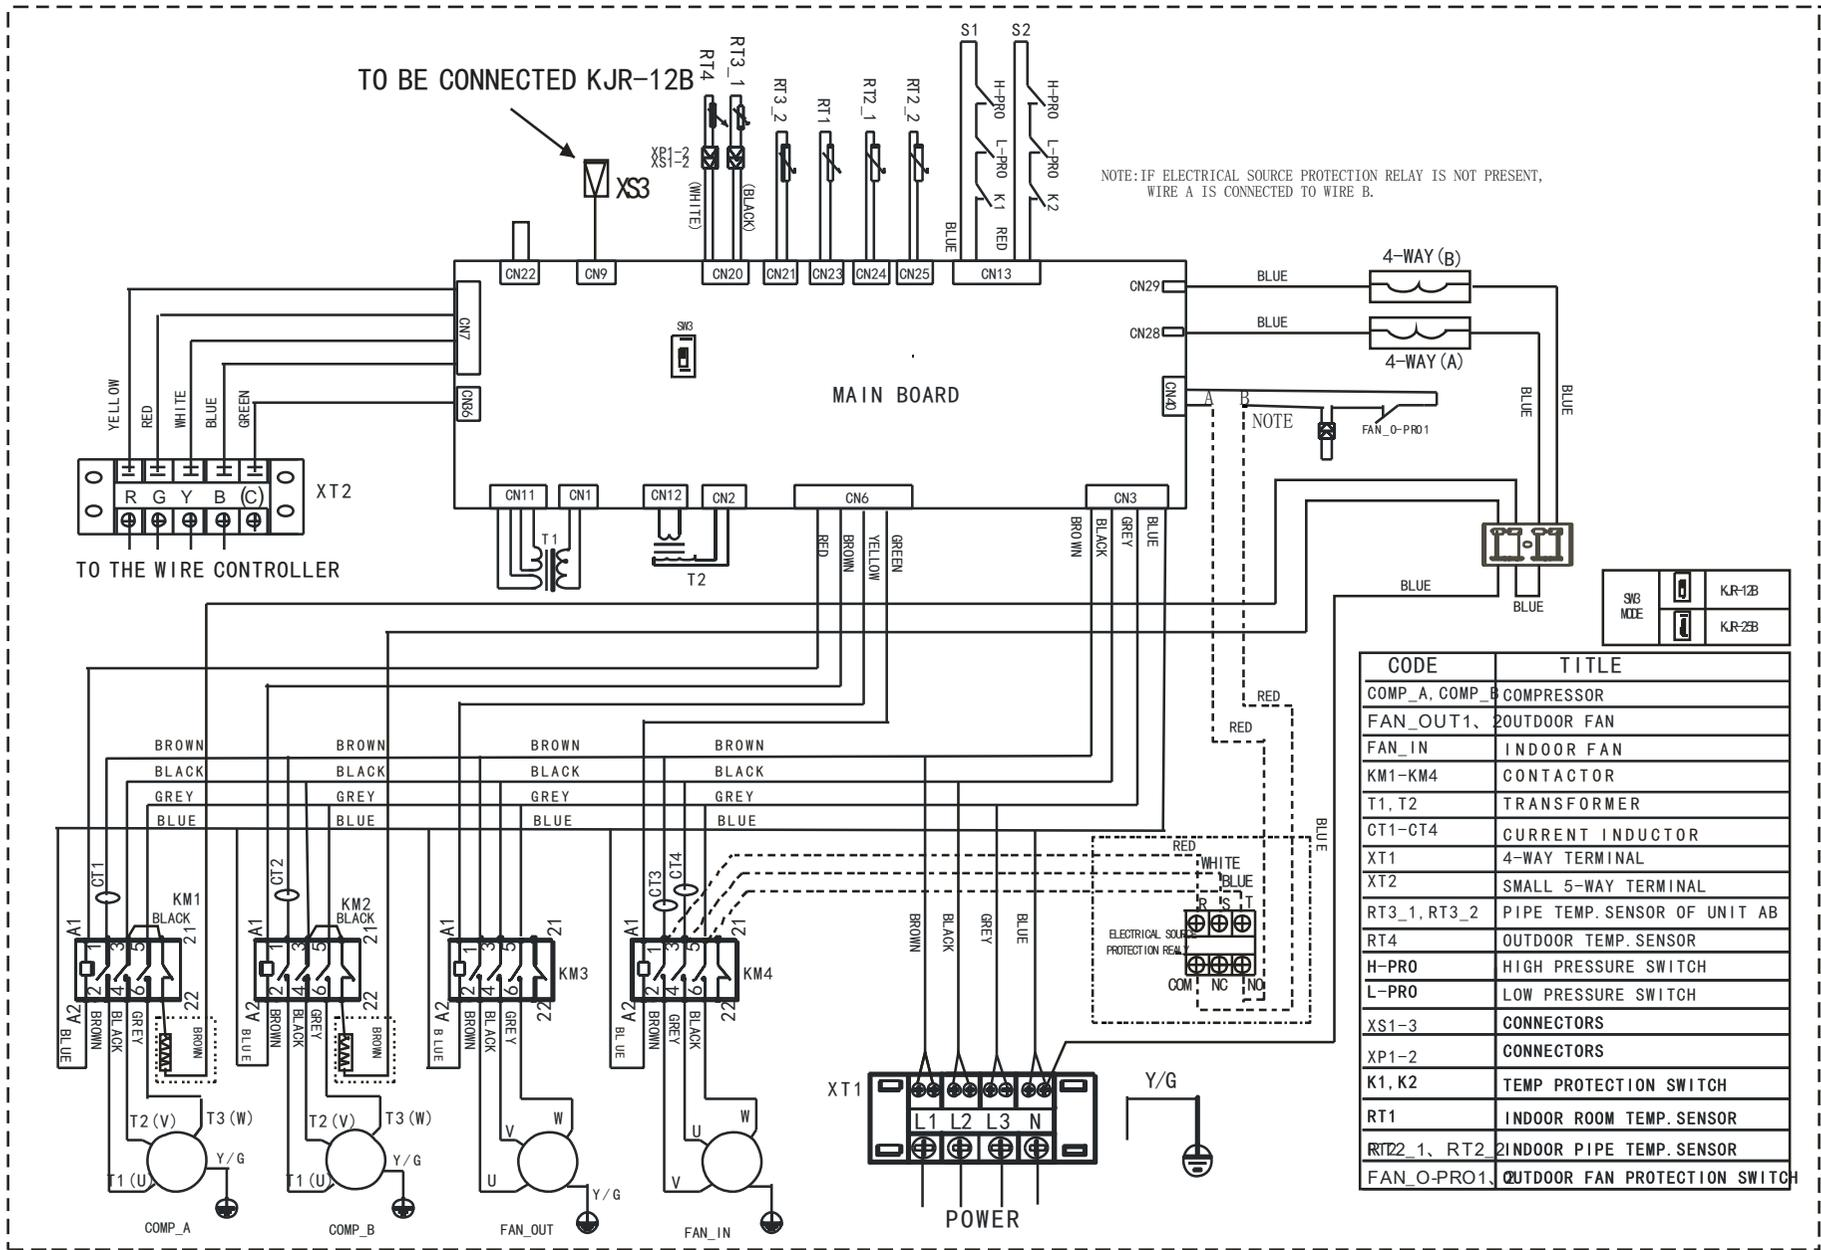


7.17 CMR4-125HWT

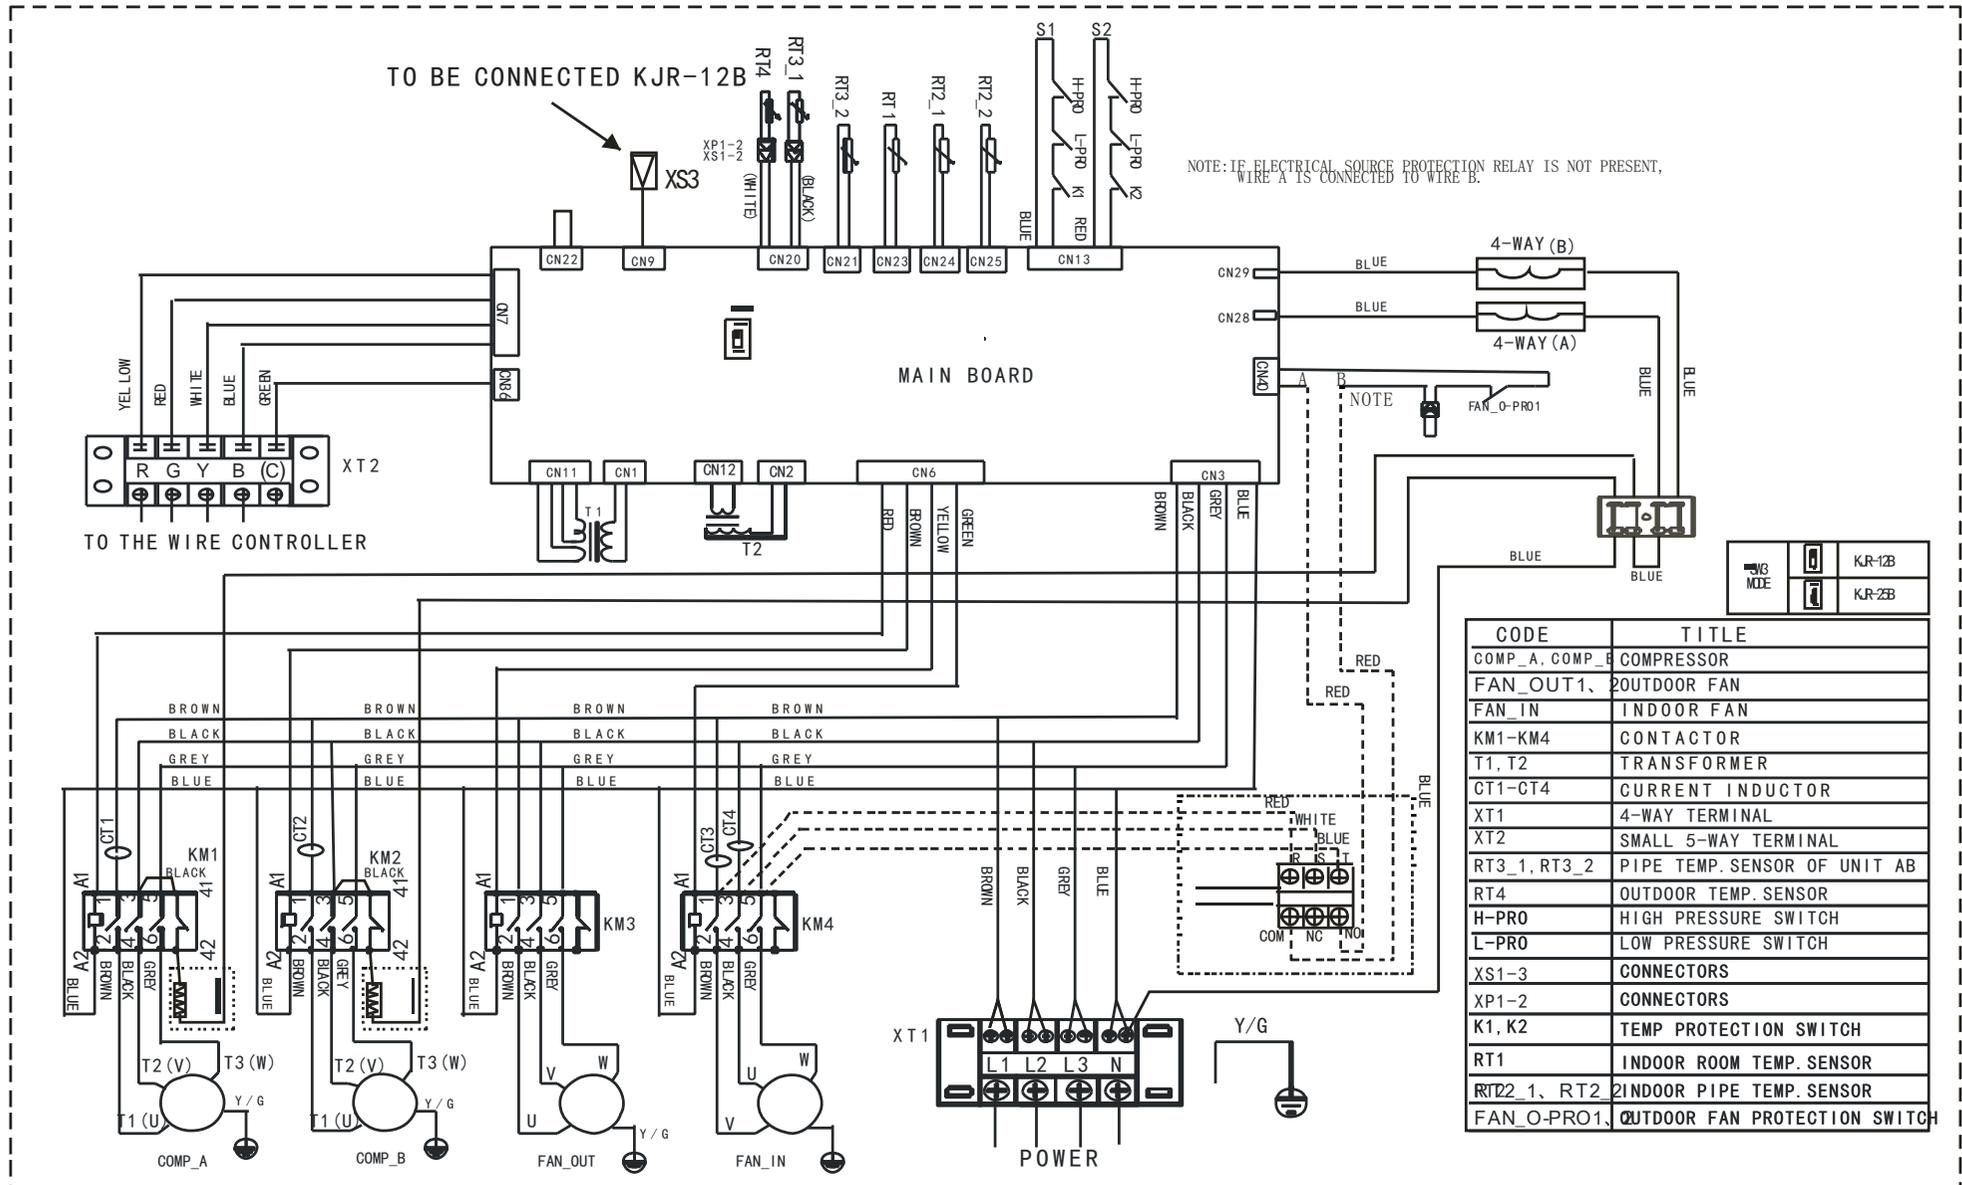


7.18 CMR4-150HWT

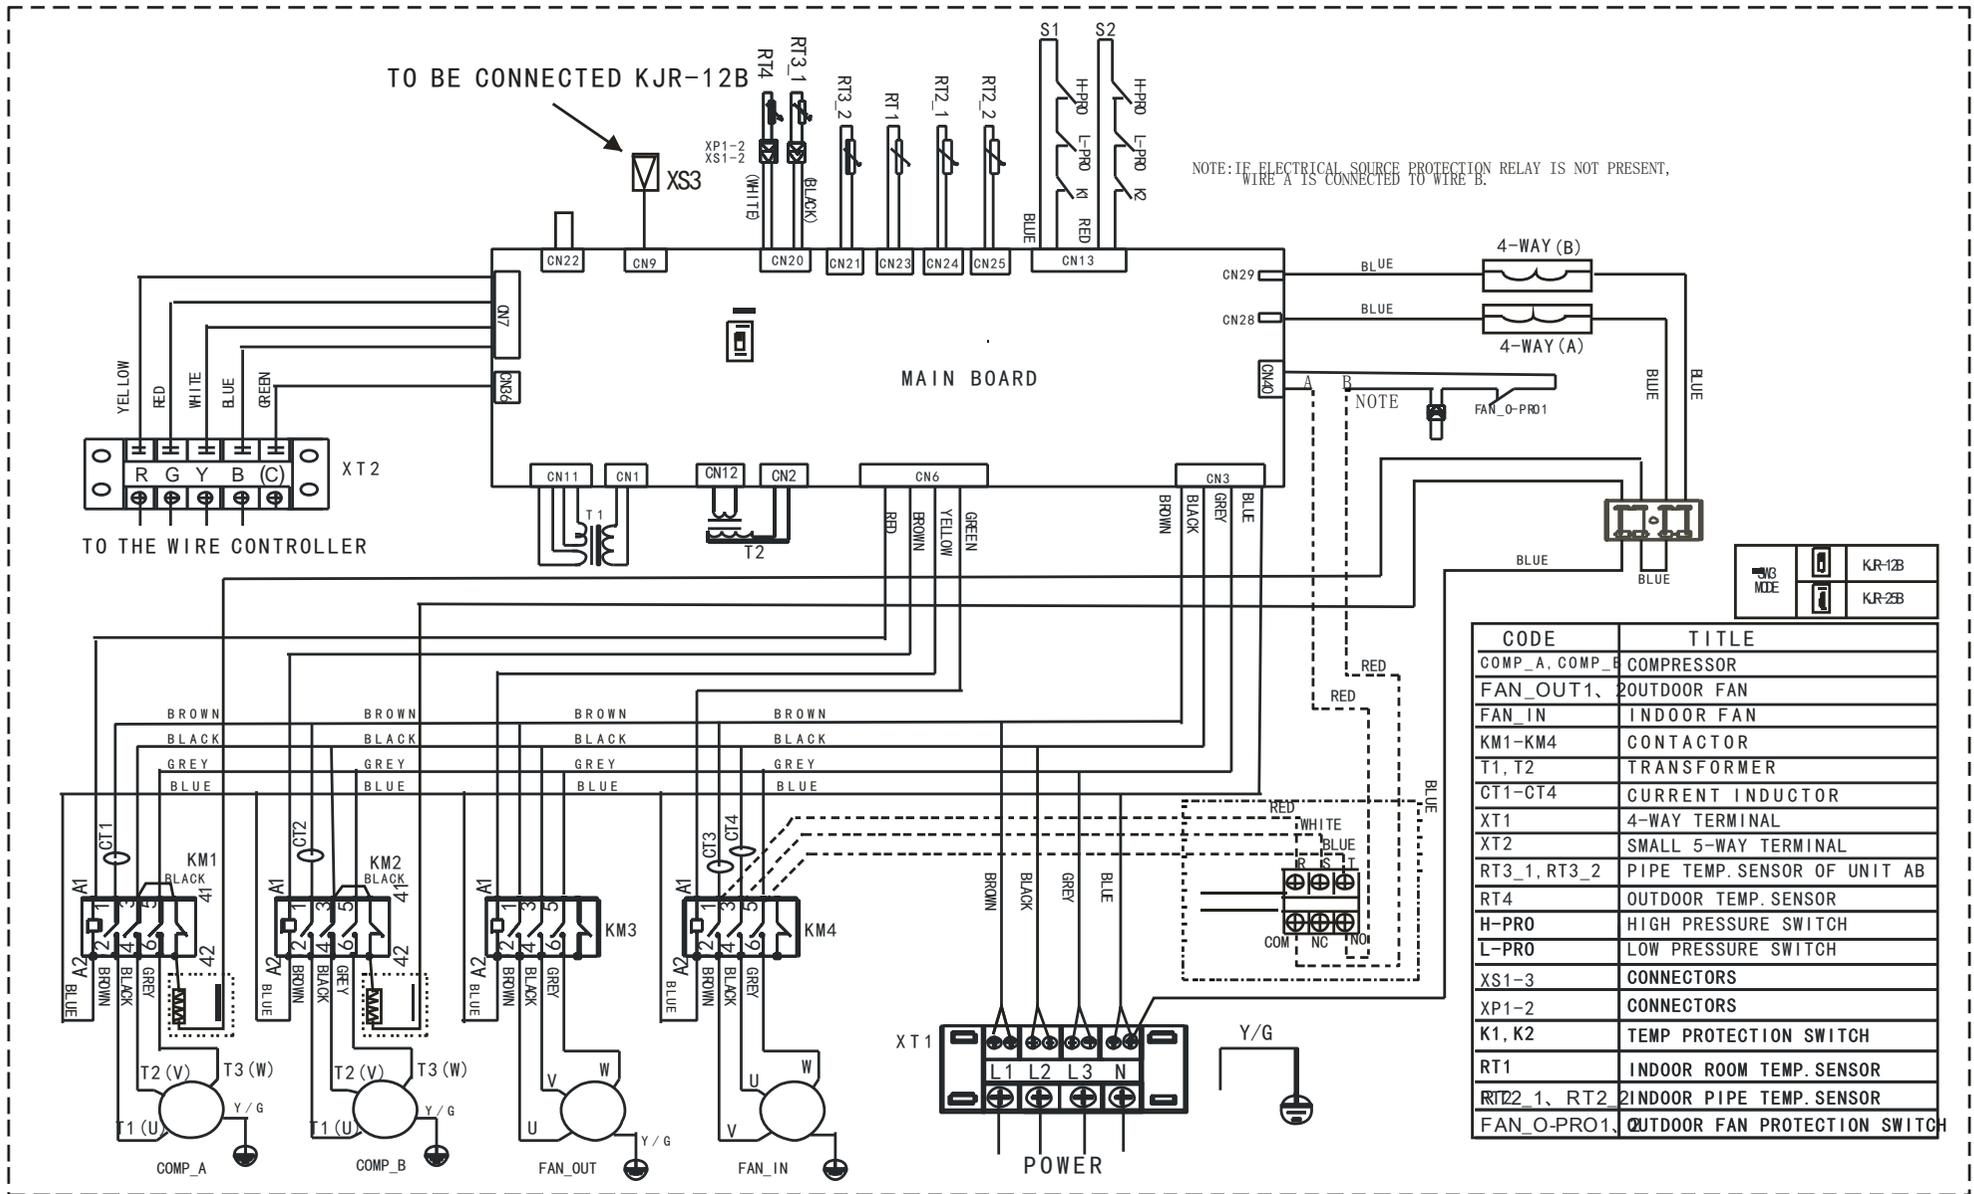


7.19 CMR4-175HWT

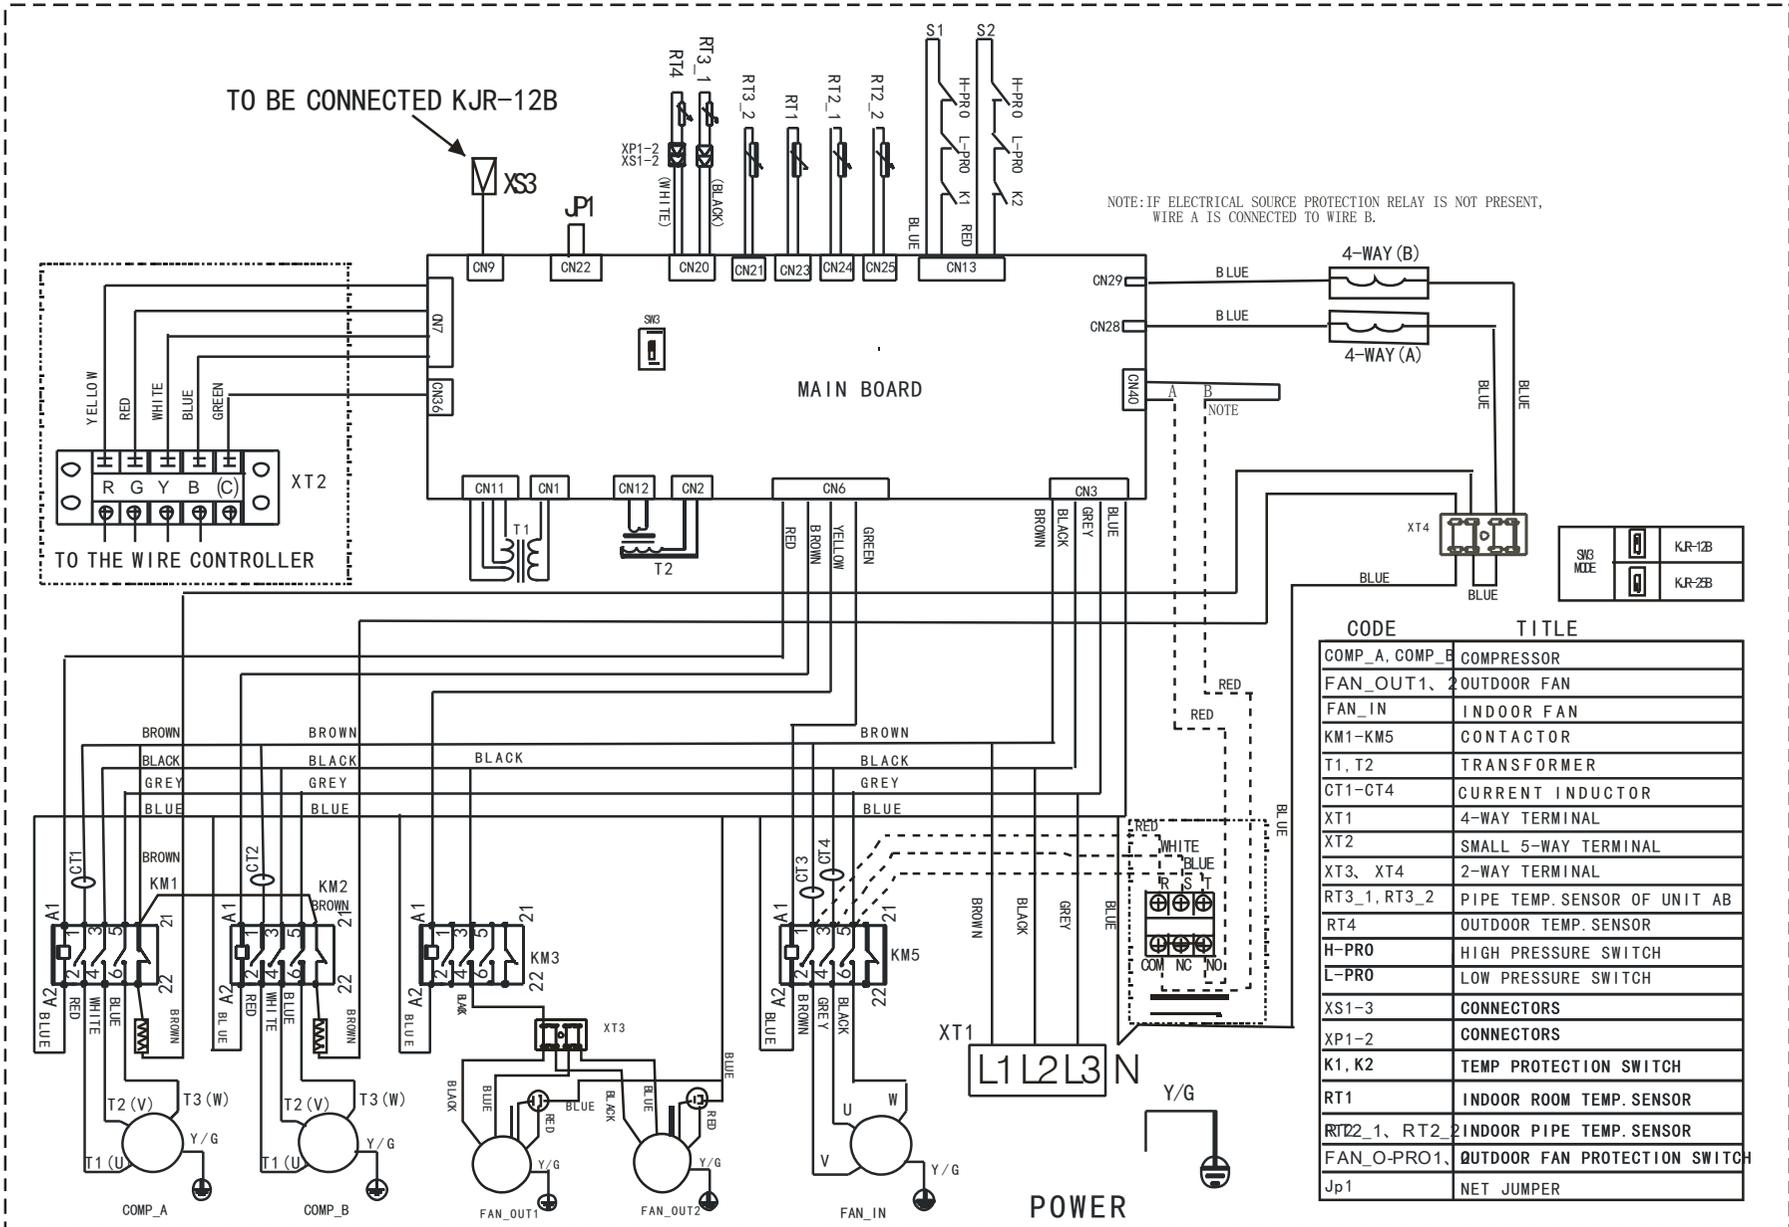


7.20 CMR4-200HWT

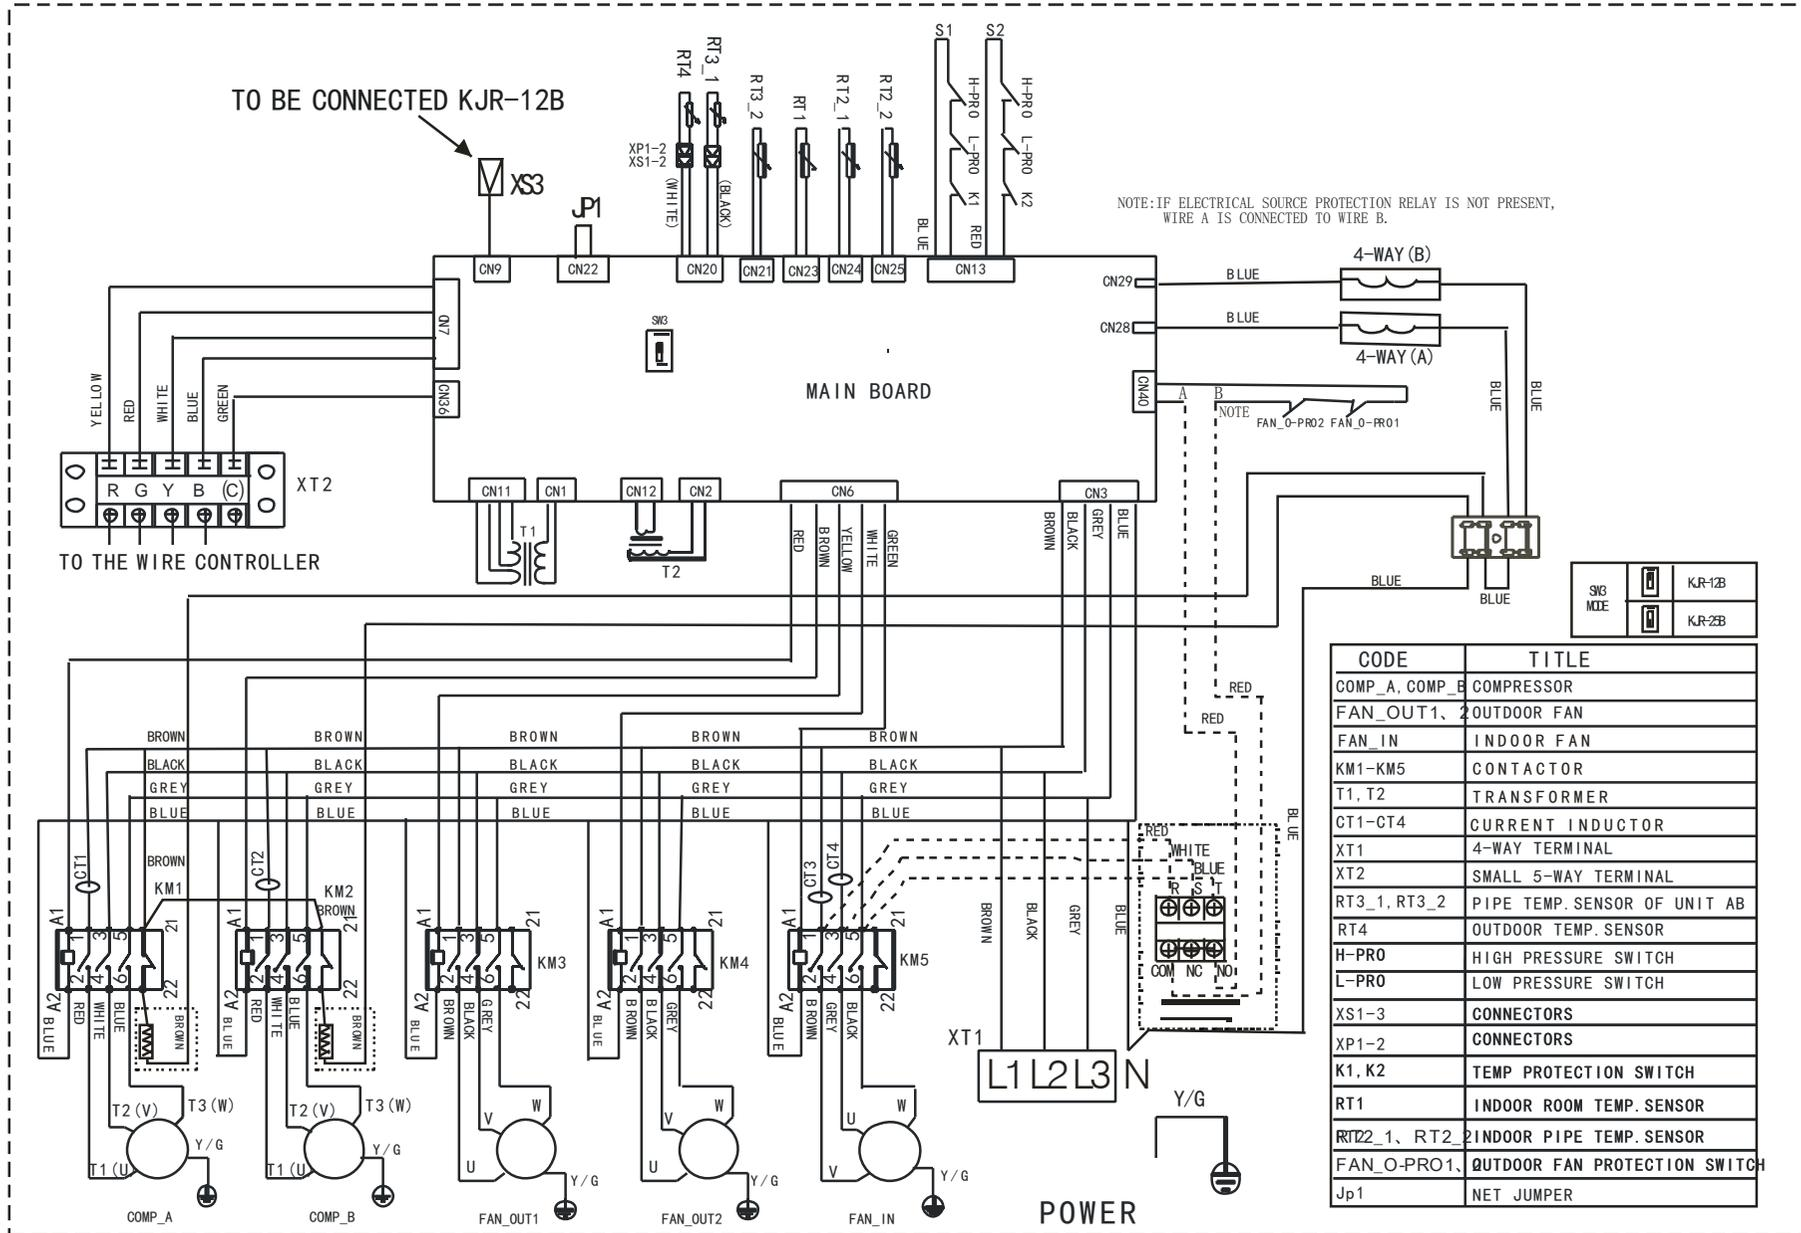

7.21 CMR4-250HWT

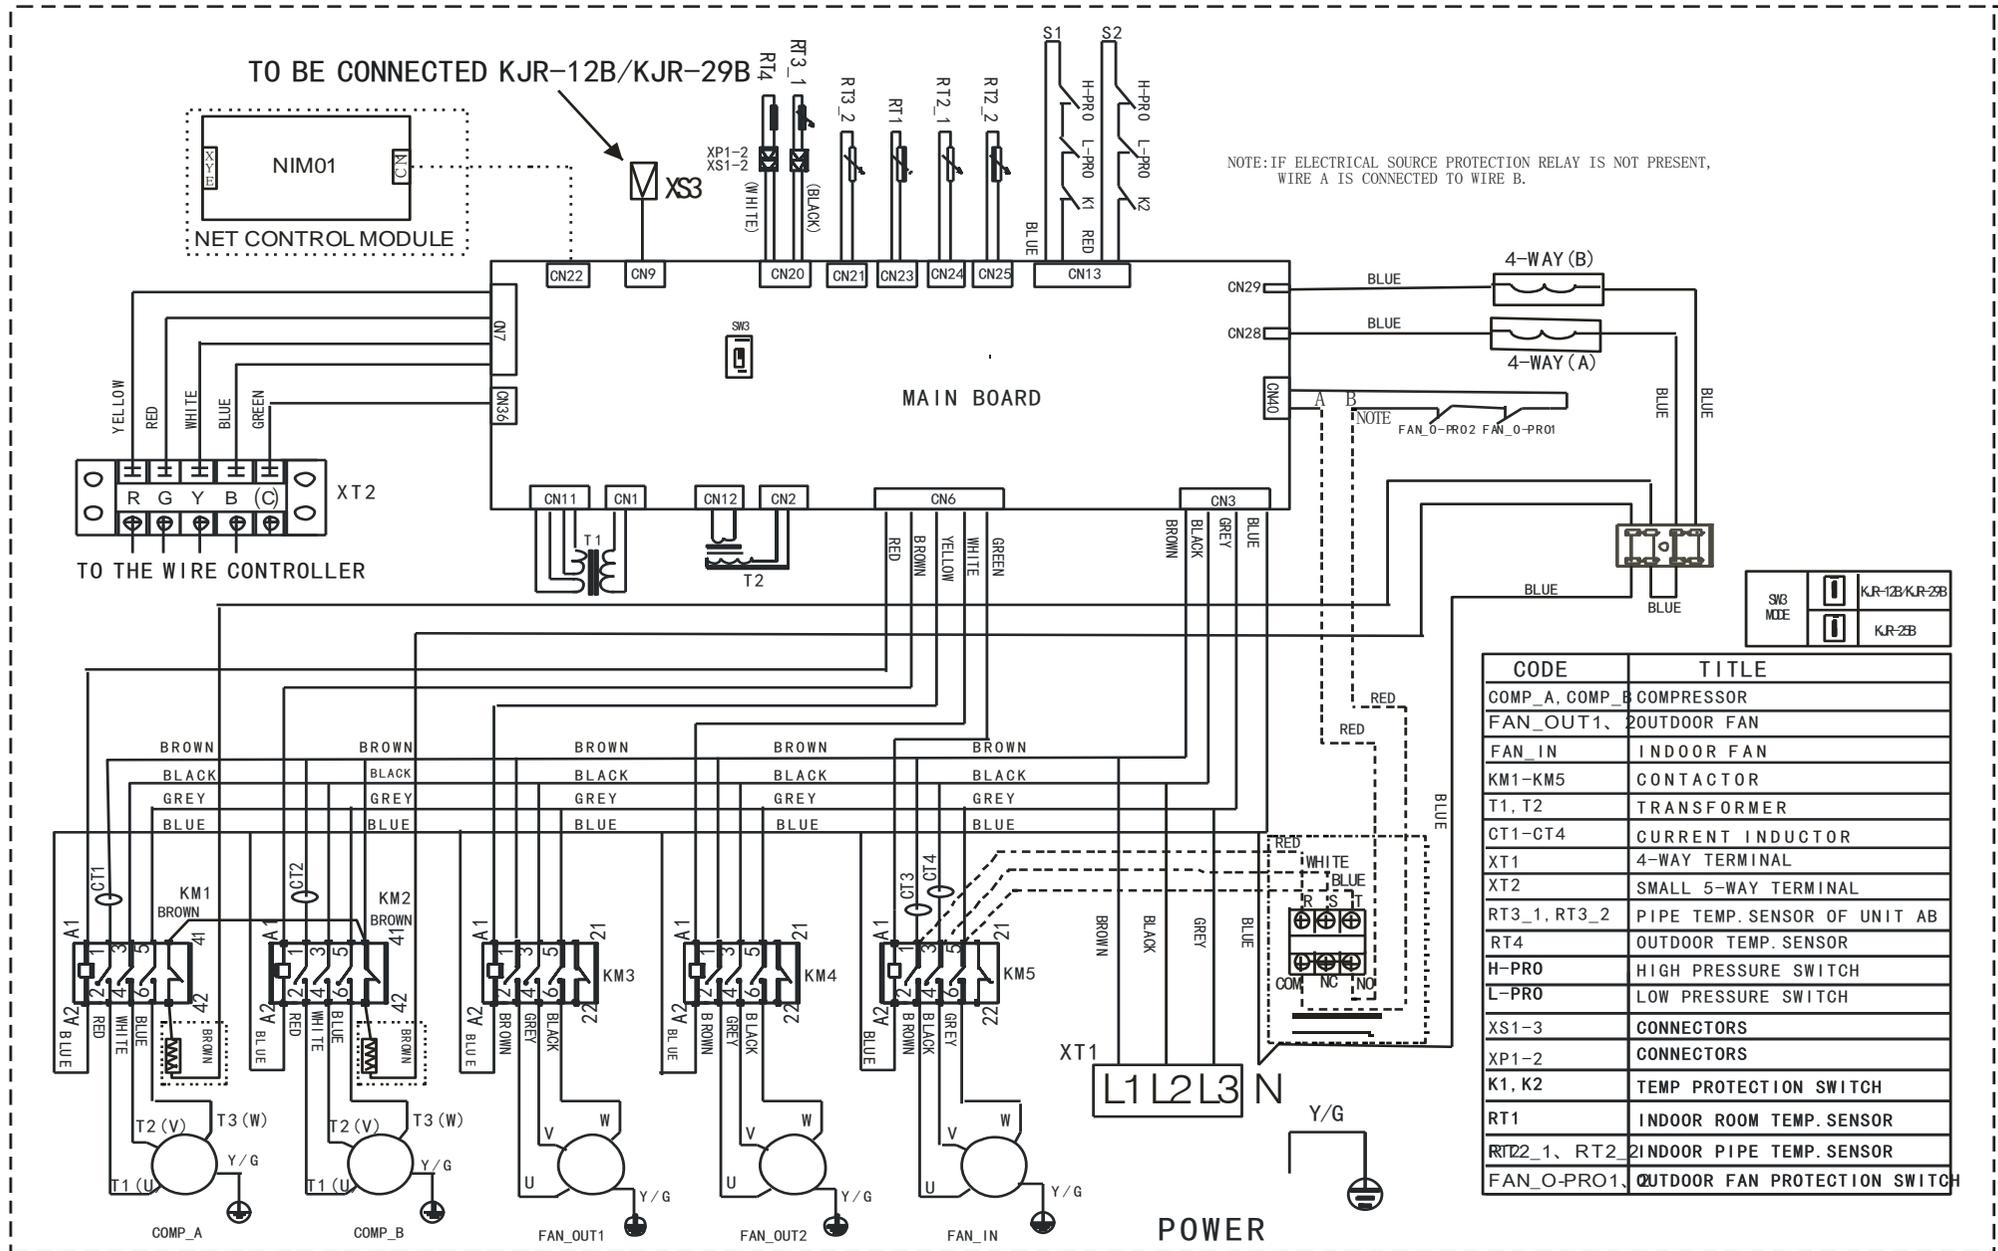

7.21 CMR4-300HWT

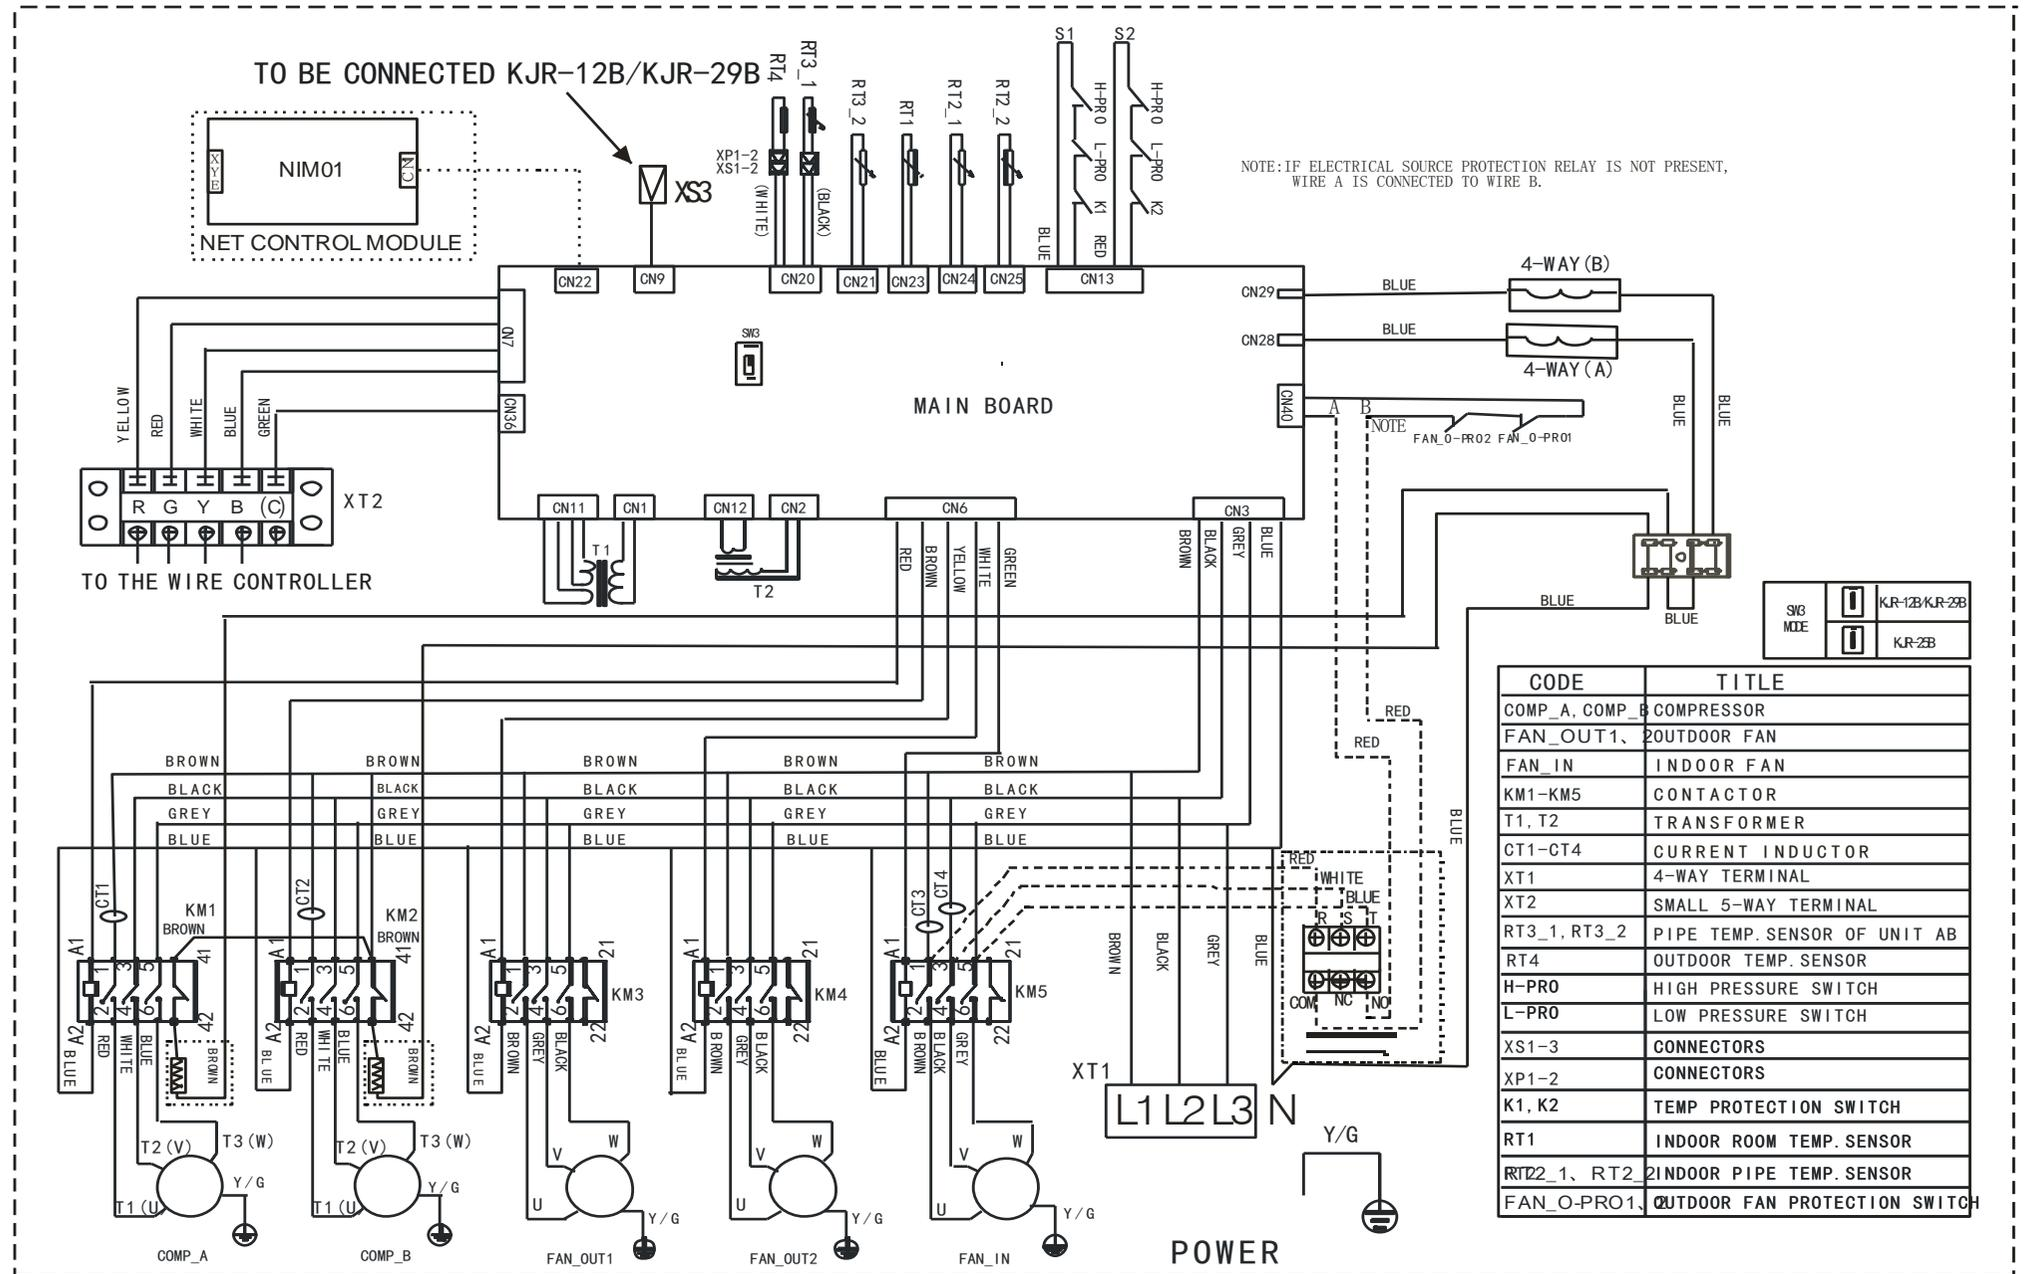

T1 application

8.11 Cooling capacity for 6.2Ton:

| Air Flow (CFM) | | | 2400 | | | | 2600 | | | | 2800 | | | | |
|---------------------|----------|--------|--------|--------|---------|---------|--------|--------|--------|---------|--------|--------|--------|--------|--------|
| Ambient Temperature | Ent (DB) | (°F) | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | |
| | | | 85 | 61 | TC | 61.3 | 62.8 | 64.0 | 65.3 | 65.4 | 66.8 | 68.2 | 69.6 | 69.5 | 70.9 |
| SC | 53.1 | 60.3 | | | 65.3 | 66.6 | 57.1 | 63.6 | 67.8 | 69.6 | 61.1 | 66.9 | 70.2 | 72.7 | |
| PI | 5325.4 | 5469.4 | | | 5710.3 | 5992.2 | 5614.7 | 5758.7 | 6011.6 | 6299.6 | 5904.0 | 6048.0 | 6313.0 | 6606.9 | |
| 67 | TC | 74.9 | | 76.5 | 78.0 | 79.7 | 75.8 | 77.4 | 79.0 | 80.7 | 76.7 | 78.4 | 80.0 | 81.7 | |
| | SC | 40.6 | | 50.6 | 61.8 | 73.7 | 42.6 | 53.8 | 64.8 | 75.4 | 44.7 | 57.0 | 67.9 | 77.1 | |
| | PI | 6104.2 | | 6279.2 | 6710.7 | 7060.7 | 6170.5 | 6345.5 | 6783.1 | 7133.1 | 6236.8 | 6411.8 | 6855.4 | 7205.4 | |
| 73 | TC | 78.5 | | 80.2 | 81.9 | 83.6 | 79.0 | 80.7 | 82.4 | 84.1 | 79.5 | 81.2 | 82.9 | 84.6 | |
| | SC | 26.3 | | 39.0 | 47.8 | 54.6 | 26.7 | 38.8 | 48.1 | 56.9 | 27.2 | 38.5 | 48.3 | 59.1 | |
| | PI | 7524.0 | | 7724.0 | 8074.0 | 8467.9 | 7560.1 | 7760.1 | 8110.1 | 8504.1 | 7596.3 | 7796.3 | 8146.3 | 8540.3 | |
| 95 | 61 | TC | | 60.1 | 61.4 | 62.7 | 64.0 | 62.1 | 63.5 | 64.8 | 66.2 | 64.1 | 65.5 | 66.9 | 68.4 |
| | | SC | | 52.2 | 57.0 | 58.9 | 61.2 | 54.5 | 59.6 | 61.6 | 64.5 | 56.8 | 62.1 | 64.3 | 67.8 |
| | | PI | | 6273.9 | 6452.9 | 6705.8 | 6993.8 | 6418.5 | 6597.5 | 6856.5 | 7150.5 | 6563.2 | 6742.2 | 7007.2 | 7307.2 |
| | 67 | TC | | 66.8 | 63.9 | 64.6 | 66.3 | 68.0 | 69.5 | 71.0 | 72.4 | 69.3 | 75.0 | 77.3 | 78.5 |
| | | SC | | 39.2 | 49.7 | 60.5 | 64.2 | 41.2 | 52.9 | 64.6 | 68.5 | 43.2 | 56.1 | 68.8 | 72.9 |
| | | PI | | 5975.0 | 5692.7 | 6039.1 | 6407.2 | 6065.4 | 6096.5 | 6491.2 | 6841.2 | 6155.8 | 6500.3 | 6943.2 | 7275.1 |
| | 73 | TC | | 77.9 | 79.6 | 81.3 | 83.0 | 78.4 | 80.0 | 81.7 | 83.4 | 78.8 | 80.5 | 82.2 | 83.9 |
| | | SC | | 25.4 | 37.2 | 46.8 | 56.3 | 25.8 | 38.1 | 48.3 | 58.6 | 26.2 | 38.9 | 49.8 | 61.0 |
| | | PI | | 7940.2 | 8190.2 | 8697.9 | 9097.9 | 7970.3 | 8220.3 | 8728.0 | 9128.0 | 8000.4 | 8250.4 | 8758.1 | 9158.1 |
| 105 | 61 | TC | | 54.7 | 55.8 | 57.0 | 58.2 | 56.6 | 57.8 | 59.1 | 60.3 | 58.6 | 59.8 | 61.1 | 62.4 |
| | | SC | | 47.7 | 49.9 | 51.7 | 53.1 | 51.8 | 53.4 | 55.9 | 57.5 | 55.8 | 56.9 | 60.2 | 61.9 |
| | | PI | | 6367.6 | 6590.5 | 6968.1 | 7256.1 | 6506.2 | 6735.2 | 7112.8 | 7406.7 | 6644.8 | 6879.8 | 7257.4 | 7557.4 |
| | 67 | TC | | 65.4 | 66.8 | 68.2 | 69.7 | 67.0 | 68.5 | 69.9 | 71.4 | 68.6 | 70.1 | 71.6 | 73.1 |
| | | SC | | 36.5 | 49.6 | 57.7 | 65.2 | 38.8 | 50.6 | 62.6 | 68.6 | 41.0 | 51.6 | 67.5 | 72.0 |
| | | PI | | 6575.5 | 6819.4 | 7197.0 | 7541.0 | 6690.0 | 6934.0 | 7317.6 | 7661.6 | 6804.5 | 7048.5 | 7438.1 | 7782.1 |
| | 73 | TC | 76.3 | 77.9 | 79.7 | 81.2 | 76.2 | 77.8 | 79.5 | 81.1 | 76.2 | 77.8 | 79.4 | 81.1 | |
| | | SC | 24.6 | 35.7 | 48.7 | 58.9 | 24.5 | 37.0 | 49.9 | 60.6 | 24.5 | 38.2 | 51.1 | 62.3 | |
| | | PI | 8604.0 | 8884.0 | 9497.7 | 9885.7 | 8597.9 | 8877.9 | 9485.7 | 9879.6 | 8591.9 | 8871.9 | 9473.6 | 9873.6 | |
| 115 | 61 | TC | 47.2 | 48.3 | 49.4 | 50.5 | 48.9 | 50.0 | 51.1 | 52.2 | 50.5 | 51.6 | 52.7 | 53.9 | |
| | | SC | 48.8 | 48.5 | 48.8 | 51.2 | 47.1 | 48.3 | 49.8 | 51.6 | 45.4 | 48.0 | 50.8 | 52.1 | |
| | | PI | 6978.7 | 7222.6 | 7440.6 | 7734.6 | 7093.2 | 7337.2 | 7561.1 | 7855.1 | 7207.7 | 7451.7 | 7681.7 | 7975.6 | |
| | 67 | TC | 57.0 | 58.2 | 59.5 | 60.9 | 58.5 | 59.8 | 61.1 | 62.5 | 60.0 | 61.4 | 62.7 | 64.1 | |
| | | SC | 31.8 | 42.8 | 54.9 | 59.9 | 34.0 | 46.1 | 57.4 | 61.5 | 36.3 | 49.4 | 59.9 | 63.1 | |
| | | PI | 7272.4 | 7599.6 | 7918.9 | 8262.9 | 7380.9 | 7649.8 | 8033.5 | 8377.4 | 7489.4 | 7700.1 | 8148.0 | 8491.9 | |
| | 73 | TC | 74.5 | 76.1 | 77.8 | 79.5 | 70.4 | 72.0 | 73.6 | 75.2 | 66.4 | 67.8 | 69.3 | 70.9 | |
| | | SC | 20.5 | 31.0 | 43.4 | 56.8 | 21.0 | 32.8 | 45.4 | 58.2 | 21.5 | 34.6 | 47.3 | 59.7 | |
| | | PI | 9130.1 | 9430.1 | 10043.9 | 10449.9 | 8840.8 | 9134.8 | 9742.5 | 10142.5 | 8551.5 | 8839.5 | 9441.2 | 9835.2 | |

- Notes: 1. All capacities are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat.
 2. TC=Total Capacity. (Unit: 1000Btu/h).
 3. SC=Sensible Capacity. (Unit: 1000Btu/h).

Heating capacity for 6.2Ton:

| Net Capacities(kW)-2800 CFM | | | | | | | | |
|-----------------------------|--|------|------|------|---|-----|------|------|
| Outdoor Temp(°F) 70% RH | Peak Net Heating(kW) at Indicated Dry Bulb(°F) | | | | Peak Total Power (kW) at Indicated Dry Bulb(°F) | | | |
| | 59 | 68 | 75.2 | 80.6 | 59 | 68 | 75.2 | 80.6 |
| 15.8 | 14.2 | 13.7 | 13.4 | 12.9 | 5.6 | 5.9 | 6.1 | 6.3 |
| 21.2 | 15.7 | 15.2 | 14.8 | 14.3 | 5.9 | 6.2 | 6.4 | 6.6 |
| 26.6 | 17.4 | 16.9 | 16.4 | 15.9 | 6.2 | 6.5 | 6.7 | 6.9 |
| 32 | 19.3 | 18.8 | 18.2 | 17.7 | 6.6 | 6.8 | 7.1 | 7.3 |
| 37.4 | 22.8 | 22.1 | 21.4 | 20.8 | 6.9 | 7.2 | 7.4 | 7.7 |
| 44.6 | 26.8 | 26 | 25.2 | 24.5 | 7.3 | 7.5 | 7.8 | 8.1 |
| 48.2 | 28.7 | 27.8 | 27 | 26.2 | 7.4 | 8.2 | 8.7 | 9.2 |
| 53.6 | 30.4 | 29.5 | 28.6 | 27.7 | 7.7 | 8.6 | 9 | 9.6 |
| 59 | 32.2 | 31.3 | 30.3 | 29.4 | 7.8 | 8.8 | 9.2 | 9.8 |
| 64.4 | 34.1 | 33.1 | 32.1 | 31.2 | 8.1 | 8.9 | 9.5 | 10.1 |
| 69.8 | 36.2 | 35.1 | 34.1 | 33 | 8.2 | 9.1 | 9.6 | 10.1 |
| 75.2 | 38.3 | 37.2 | 36.1 | 35 | 8.4 | 9.2 | 10 | 10.3 |

- Notes: 1. For other airflows, see heating capacity correction factor tables.
 2. Heating capacities and power are integrated to include the effects of defrost in the frost region.

8.12 Cooling capacity for 7.5Ton:

| Air Flow (CFM) | | 2400 | | | | 2600 | | | | 2830 | | | | | |
|---------------------|----------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Ambient Temperature | Ent (DB) | (°F) | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | |
| | | | 85 | 61 | TC | 72.8 | 74.6 | 76.1 | 77.8 | 77.6 | 79.4 | 81.1 | 82.9 | 82.4 | 84.2 |
| SC | 63.1 | 71.7 | | | 77.7 | 76.5 | 67.8 | 75.6 | 80.6 | 81.5 | 72.5 | 79.5 | 83.5 | 86.5 | |
| PI | 6775.5 | 6920.6 | | | 7165.9 | 7451.2 | 7012.8 | 7157.9 | 7413.1 | 7703.3 | 7250.1 | 7395.2 | 7660.3 | 7955.5 | |
| 67 | TC | 88.8 | | 90.8 | 92.7 | 94.8 | 89.9 | 91.9 | 93.9 | 96.0 | 91.0 | 93.0 | 95.1 | 97.2 | |
| | SC | 48.3 | | 60.2 | 73.5 | 87.7 | 50.7 | 64.0 | 77.1 | 89.7 | 53.1 | 67.8 | 80.7 | 91.7 | |
| | PI | 7405.6 | | 7580.7 | 7986.6 | 8336.7 | 7460.0 | 7635.1 | 8045.9 | 8396.0 | 7514.3 | 7689.4 | 8105.3 | 8455.4 | |
| 73 | TC | 93.1 | | 95.2 | 97.3 | 99.4 | 93.7 | 95.8 | 97.9 | 100.0 | 94.3 | 96.4 | 98.5 | 100.6 | |
| | SC | 31.4 | | 46.5 | 57.0 | 65.1 | 31.9 | 46.2 | 57.3 | 67.8 | 32.4 | 45.9 | 57.6 | 70.5 | |
| | PI | 8464.7 | | 8664.8 | 9014.9 | 9410.1 | 8494.4 | 8694.5 | 9044.6 | 9439.8 | 8524.1 | 8724.2 | 9074.3 | 9469.4 | |
| 95 | 61 | TC | | 71.3 | 73.0 | 74.6 | 76.2 | 73.7 | 75.4 | 77.1 | 78.8 | 76.1 | 77.8 | 79.6 | 81.4 |
| | | SC | | 62.0 | 67.8 | 70.1 | 72.9 | 64.7 | 70.8 | 73.3 | 76.8 | 67.4 | 73.8 | 76.5 | 80.7 |
| | | PI | | 7457.3 | 7637.5 | 7892.7 | 8182.9 | 7576.0 | 7756.1 | 8016.3 | 8311.4 | 7694.6 | 7874.8 | 8139.9 | 8440.0 |
| | 67 | TC | | 79.2 | 76.0 | 76.9 | 79.0 | 80.7 | 82.5 | 84.4 | 86.2 | 82.2 | 89.0 | 91.9 | 93.4 |
| | | SC | | 46.6 | 59.2 | 72.0 | 76.5 | 49.0 | 62.9 | 76.9 | 81.6 | 51.4 | 66.6 | 81.8 | 86.7 |
| | | PI | | 7223.0 | 7288.3 | 7359.1 | 7724.0 | 7297.2 | 7494.3 | 7729.9 | 8080.0 | 7371.3 | 7700.2 | 8100.7 | 8435.9 |
| | 73 | TC | | 92.4 | 94.5 | 96.6 | 98.7 | 92.9 | 95.0 | 97.1 | 99.2 | 93.4 | 95.5 | 97.6 | 99.7 |
| | | SC | | 30.3 | 44.4 | 55.8 | 67.1 | 30.8 | 45.4 | 57.6 | 69.9 | 31.3 | 46.4 | 59.4 | 72.7 |
| | | PI | | 8906.2 | 9156.3 | 9631.9 | 10032. | 8930.9 | 9181.0 | 9656.6 | 10056. | 8955.7 | 9205.8 | 9681.4 | 10081. |
| 105 | 61 | TC | | 64.9 | 66.3 | 67.9 | 69.4 | 67.2 | 68.7 | 70.3 | 71.9 | 69.5 | 71.1 | 72.7 | 74.4 |
| | | SC | | 56.7 | 59.4 | 61.6 | 63.4 | 61.5 | 63.5 | 66.6 | 68.6 | 66.3 | 67.6 | 71.6 | 73.8 |
| | | PI | | 7636.9 | 7862.2 | 8213.0 | 8503.2 | 7750.7 | 7980.8 | 8331.7 | 8626.8 | 7864.4 | 8099.5 | 8450.3 | 8750.4 |
| | 67 | TC | | 77.6 | 79.4 | 81.1 | 83.0 | 79.5 | 81.3 | 83.1 | 85.0 | 81.4 | 83.2 | 85.1 | 87.0 |
| | | SC | | 43.4 | 59.0 | 68.7 | 77.7 | 46.1 | 60.2 | 74.5 | 81.7 | 48.8 | 61.4 | 80.3 | 85.7 |
| | | PI | | 7823.2 | 8068.3 | 8419.2 | 8764.4 | 7917.1 | 8162.3 | 8518.1 | 8863.2 | 8011.0 | 8256.2 | 8617.0 | 8962.1 |
| | 73 | TC | 90.5 | 92.5 | 94.7 | 96.6 | 90.4 | 92.4 | 94.5 | 96.5 | 90.3 | 92.3 | 94.3 | 96.4 | |
| | | SC | 29.4 | 42.6 | 58.1 | 70.2 | 29.3 | 44.1 | 59.5 | 72.2 | 29.2 | 45.6 | 60.9 | 74.2 | |
| | | PI | 9655.2 | 9935.3 | 10515. | 10906. | 9650.3 | 9930.4 | 10506. | 10901. | 9645.3 | 9925.4 | 10496. | 10896. | |
| 115 | 61 | TC | 52.8 | 54.2 | 55.5 | 57.0 | 54.7 | 56.1 | 57.5 | 59.0 | 56.6 | 58.0 | 59.5 | 61.0 | |
| | | SC | 54.6 | 54.4 | 54.8 | 57.8 | 52.6 | 54.1 | 56.0 | 58.3 | 50.6 | 53.8 | 57.2 | 58.8 | |
| | | PI | 8213.5 | 8458.6 | 8678.9 | 8974.0 | 8307.4 | 8552.6 | 8777.7 | 9072.9 | 8401.4 | 8646.5 | 8876.6 | 9171.8 | |
| | 67 | TC | 64.3 | 65.8 | 67.5 | 69.2 | 66.1 | 67.7 | 69.4 | 71.1 | 67.9 | 69.6 | 71.3 | 73.0 | |
| | | SC | 34.5 | 47.7 | 62.1 | 68.0 | 37.2 | 51.6 | 65.0 | 69.9 | 39.9 | 55.5 | 67.9 | 71.8 | |
| | | PI | 8247.1 | 8512.3 | 8868.1 | 9213.3 | 8336.1 | 8606.2 | 8962.1 | 9307.2 | 8425.1 | 8700.2 | 9056.0 | 9401.2 | |
| | 73 | TC | 85.0 | 87.0 | 89.1 | 91.2 | 80.2 | 82.1 | 84.1 | 86.1 | 75.4 | 77.2 | 79.1 | 81.0 | |
| | | SC | 21.2 | 33.7 | 48.5 | 64.4 | 21.8 | 35.8 | 50.8 | 66.1 | 22.4 | 37.9 | 53.1 | 67.8 | |
| | | PI | 9958.8 | 10258. | 10839. | 11244. | 9721.5 | 10016. | 10592. | 10992. | 9484.2 | 9774.4 | 10345. | 10740. | |

- Notes: 1. All capacities are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat.
 2. TC=Total Capacity. (Unit: 1000Btu/h).
 3. SC=Sensible Capacity. (Unit: 1000Btu/h).

Heating capacity for 7.5Ton:

| Net Capacities(kW)-2830 CFM | | | | | | | | |
|-----------------------------|--|------|------|------|--|------|------|------|
| Outdoor Temp(°F) 70% RH | Peak Net Heating(kW) at Indicated Dry Bulb(°F) | | | | Peak Total Power(kW) at Indicated Dry Bulb(°F) | | | |
| | 59 | 68 | 75.2 | 80.6 | 59 | 68 | 75.2 | 80.8 |
| 15.8 | 17 | 16.5 | 16.4 | 16.4 | 7.2 | 7.9 | 8.3 | 8.9 |
| 21.2 | 17.8 | 17.3 | 17.1 | 16.9 | 7.3 | 8 | 8.4 | 9 |
| 26.6 | 18.8 | 18.5 | 18.4 | 18.1 | 7.4 | 8.1 | 8.6 | 9.2 |
| 32 | 20.3 | 20 | 19.7 | 19.4 | 7.5 | 8.2 | 8.7 | 9.3 |
| 37.4 | 23.3 | 23.1 | 22.7 | 22.4 | 7.6 | 8.4 | 8.9 | 9.4 |
| 44.6 | 30.3 | 30 | 29.6 | 29.2 | 7.9 | 8.9 | 9.2 | 9.7 |
| 48.2 | 30.5 | 30.2 | 29.9 | 29.6 | 8.2 | 9.1 | 9.6 | 10.2 |
| 53.6 | 32.4 | 33.5 | 33.4 | 33.1 | 8.5 | 9.5 | 10 | 10.6 |
| 59 | 35 | 34.4 | 34.2 | 33.8 | 8.7 | 9.7 | 10.2 | 10.8 |
| 64.4 | 37.1 | 36.4 | 36 | 35.7 | 9 | 9.9 | 10.5 | 11.1 |
| 69.8 | 39.8 | 38.9 | 38.4 | 37.9 | 9.1 | 10.1 | 10.6 | 11.1 |
| 75.2 | 42 | 40.9 | 40.2 | 39.8 | 9.3 | 10.2 | 11 | 11.4 |

- Notes: 1. For other airflows, see heating capacity correction factor tables.
 2. Heating capacities and power are integrated to include the effects of defrost in the frost region.

8.13 Cooling capacity for 8.5Ton:

| Air Flow (CFM) | | 3000 | | | | 3250 | | | | 3500 | | | | | |
|---------------------|------|------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Ent (DB) | (°F) | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | | |
| Ambient Temperature | 85 | 61 | TC | 86.6 | 88.5 | 90.5 | 92.5 | 89.1 | 91.0 | 93.1 | 95.2 | 91.5 | 93.6 | 95.7 | 97.8 |
| | | | SC | 71.5 | 73.0 | 74.8 | 76.5 | 77.0 | 78.7 | 80.5 | 82.3 | 82.5 | 84.4 | 86.3 | 88.2 |
| | | | PI | 8302.6 | 8445.9 | 8707.6 | 9001.0 | 8400.4 | 8547.1 | 8808.9 | 9105.6 | 8498.3 | 8648.4 | 8910.1 | 9210.2 |
| | | 67 | TC | 98.7 | 101.0 | 103.2 | 105.6 | 99.8 | 102.0 | 104.3 | 106.6 | 100.8 | 103.0 | 105.3 | 107.6 |
| | | | SC | 54.7 | 71.0 | 83.2 | 98.1 | 56.7 | 73.0 | 87.0 | 101.3 | 58.8 | 74.9 | 90.9 | 104.4 |
| | | | PI | 8784.5 | 8959.6 | 9207.0 | 9557.1 | 8825.0 | 9000.1 | 9247.5 | 9597.6 | 8865.5 | 9040.6 | 9288.0 | 9638.1 |
| | | 73 | TC | 103.3 | 105.6 | 107.9 | 110.2 | 103.6 | 106.0 | 108.3 | 110.6 | 104.0 | 106.3 | 108.6 | 111.0 |
| | | | SC | 34.4 | 49.0 | 61.1 | 74.8 | 34.9 | 49.7 | 62.4 | 76.0 | 35.4 | 50.5 | 63.8 | 77.2 |
| | | | PI | 9502.6 | 9702.7 | 10052. | 10446. | 9516.1 | 9716.2 | 10066. | 10463. | 9529.6 | 9729.7 | 10079. | 10479. |
| | 95 | 61 | TC | 79.5 | 81.4 | 83.2 | 85.0 | 82.1 | 84.0 | 85.9 | 87.8 | 84.8 | 86.7 | 88.7 | 90.6 |
| | | | SC | 67.9 | 69.5 | 71.0 | 72.7 | 73.5 | 75.2 | 76.8 | 78.6 | 79.0 | 80.8 | 82.7 | 84.6 |
| | | | PI | 8637.6 | 8819.3 | 9077.7 | 9367.7 | 8742.2 | 8923.9 | 9185.6 | 9479.0 | 8846.8 | 9028.5 | 9293.6 | 9590.3 |
| | | 67 | TC | 92.5 | 92.8 | 95.8 | 98.8 | 95.7 | 97.9 | 100.1 | 102.3 | 99.0 | 103.0 | 104.3 | 105.8 |
| | | | SC | 51.7 | 66.8 | 82.7 | 99.3 | 54.7 | 71.1 | 87.3 | 100.1 | 57.7 | 75.4 | 91.9 | 100.8 |
| | | | PI | 8508.3 | 8601.8 | 8890.3 | 9233.7 | 8636.5 | 8800.9 | 9059.0 | 9372.0 | 8764.7 | 9000.0 | 9227.7 | 9510.4 |
| | | 73 | TC | 102.4 | 104.7 | 107.0 | 109.4 | 102.7 | 104.9 | 107.3 | 109.7 | 102.9 | 105.2 | 107.5 | 109.9 |
| | | | SC | 32.9 | 49.0 | 61.7 | 74.6 | 33.7 | 50.2 | 64.1 | 78.1 | 34.5 | 51.3 | 66.5 | 81.6 |
| | | | PI | 10064. | 10310. | 10621. | 11025. | 10074. | 10320. | 10631. | 11035. | 10084. | 10331. | 10642. | 11045. |
| | 105 | 61 | TC | 72.2 | 73.8 | 75.5 | 77.3 | 75.0 | 76.7 | 78.5 | 80.3 | 77.8 | 79.6 | 81.5 | 83.3 |
| | | | SC | 64.3 | 65.8 | 67.4 | 68.9 | 69.9 | 71.6 | 73.2 | 74.9 | 75.6 | 77.3 | 79.1 | 80.9 |
| | | | PI | 8967.7 | 9196.1 | 9380.1 | 9676.9 | 9079.1 | 9310.8 | 9498.2 | 9795.0 | 9190.4 | 9425.5 | 9616.3 | 9913.0 |
| | | 67 | TC | 86.3 | 88.2 | 90.3 | 92.4 | 88.5 | 90.5 | 92.6 | 94.7 | 90.8 | 92.8 | 94.9 | 97.0 |
| | | | SC | 48.8 | 63.3 | 78.3 | 91.4 | 51.9 | 68.2 | 85.0 | 93.4 | 55.1 | 73.0 | 91.7 | 95.4 |
| | | | PI | 9225.3 | 9468.7 | 9659.4 | 10006. | 9313.0 | 9559.8 | 9750.5 | 10097. | 9400.8 | 9650.9 | 9841.6 | 10188. |
| 73 | | TC | 99.4 | 101.7 | 103.9 | 106.2 | 100.1 | 102.4 | 104.6 | 106.9 | 100.8 | 103.0 | 105.3 | 107.6 | |
| | | SC | 31.2 | 46.2 | 59.9 | 73.9 | 32.0 | 48.3 | 63.6 | 78.6 | 32.7 | 50.3 | 67.3 | 83.2 | |
| | | PI | 10661. | 10942. | 11349. | 11749. | 10688. | 10969. | 11376. | 11776. | 10715. | 10996. | 11403. | 11803. | |
| 115 | 61 | TC | 60.4 | 61.9 | 63.5 | 65.1 | 62.9 | 64.4 | 66.1 | 67.7 | 65.4 | 67.0 | 68.6 | 70.4 | |
| | | SC | 60.0 | 61.6 | 63.1 | 64.7 | 61.4 | 63.0 | 64.5 | 66.2 | 62.8 | 64.3 | 66.0 | 67.6 | |
| | | PI | 9314.2 | 9557.6 | 9784.3 | 10077. | 9412.1 | 9658.8 | 9885.5 | 10182. | 9509.9 | 9760.0 | 9986.7 | 10286. | |
| | 67 | TC | 74.1 | 74.4 | 77.7 | 79.6 | 75.7 | 77.5 | 79.4 | 81.3 | 77.4 | 80.7 | 81.2 | 83.1 | |
| | | SC | 40.1 | 56.0 | 73.9 | 75.6 | 43.3 | 60.3 | 76.6 | 78.4 | 46.6 | 64.6 | 79.4 | 81.3 | |
| | | PI | 9819.6 | 10210. | 10275. | 10622. | 9883.7 | 10155. | 10342. | 10689. | 9947.8 | 10100. | 10410. | 10757. | |
| | 73 | TC | 90.3 | 92.5 | 94.5 | 96.8 | 91.1 | 93.2 | 95.4 | 97.6 | 91.8 | 94.0 | 96.2 | 98.5 | |
| | | SC | 24.5 | 39.1 | 54.2 | 69.2 | 25.1 | 41.5 | 57.8 | 73.8 | 25.7 | 43.9 | 61.4 | 78.4 | |
| | | PI | 10834. | 11134. | 11538. | 11938. | 10864. | 11164. | 11572. | 11972. | 10894. | 11194. | 11605. | 12006. | |

- Notes: 1. All capacities are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat.
 2. TC=Total Capacity. (Unit: 1000Btu/h).
 3. SC=Sensible Capacity. (Unit: 1000Btu/h).

Heating capacity for 8.5Ton:

| Outdoor Temp(°F) 70% RH | Net Capacities(kW)-3500 CFM | | | | | | | |
|-------------------------|--|------|------|------|--|------|------|------|
| | Peak Net Heating(kW) at Indicated Dry Bulb(°F) | | | | Peak Total Power(kW) at Indicated Dry Bulb(°F) | | | |
| | 59 | 68 | 75.2 | 80.6 | 59 | 68 | 75.2 | 80.8 |
| 15.8 | 21.4 | 20.8 | 20.6 | 20.6 | 9.3 | 9.5 | 10 | 10.5 |
| 21.2 | 22.4 | 21.8 | 21.6 | 21.3 | 9.4 | 9.7 | 10.3 | 10.7 |
| 26.6 | 23.7 | 23.4 | 23.2 | 22.8 | 9.5 | 10 | 10.5 | 10.9 |
| 32 | 25.5 | 25.2 | 24.8 | 24.5 | 9.6 | 10.2 | 10.7 | 11.2 |
| 37.4 | 29.4 | 29.1 | 28.7 | 28.3 | 9.8 | 10.4 | 10.9 | 11.4 |
| 44.6 | 35.4 | 35 | 33 | 32.8 | 10.1 | 10.6 | 11.1 | 11.6 |
| 48.2 | 38.5 | 38 | 37.7 | 37.3 | 10.3 | 10.8 | 11.3 | 11.9 |
| 53.6 | 40.9 | 42.3 | 42.1 | 41.7 | 10.5 | 11 | 11.5 | 12.1 |
| 59 | 44.1 | 43.4 | 43.1 | 42.7 | 10.7 | 11.3 | 11.8 | 12.5 |
| 64.4 | 46.7 | 45.9 | 45.4 | 45 | 10.9 | 11.5 | 12.1 | 12.7 |
| 69.8 | 50.1 | 49.1 | 48.4 | 47.8 | 11.3 | 11.8 | 12.3 | 12.9 |
| 75.2 | 53 | 51.6 | 50.7 | 50.1 | 11.5 | 12 | 12.6 | 13.2 |

- Notes: 1. For other airflows, see heating capacity correction factor tables.
 2. Heating capacities and power are integrated to include the effects of defrost in the frost region.

8.14 Cooling capacity for 10Ton:

| Air Flow (CFM) | | | 3500 | | | | 3800 | | | | 4100 | | | | |
|---------------------|----------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Ambient Temperature | Ent (DB) | (°F) | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | |
| | | | 85 | 61 | TC | 103.6 | 106.0 | 108.4 | 110.7 | 106.6 | 109.0 | 111.4 | 113.7 | 109.6 | 112.0 |
| SC | 89.5 | 91.6 | | | 93.7 | 95.7 | 92.5 | 94.6 | 96.7 | 98.7 | 95.5 | 97.6 | 99.7 | 101.7 | |
| PI | 9115.8 | 9427.3 | | | 9784.5 | 10298. | 9374.6 | 9686.2 | 10043. | 10557. | 9633.5 | 9945.0 | 10302. | 10816. | |
| 67 | TC | 116.1 | | 118.8 | 121.4 | 124.0 | 119.1 | 121.8 | 124.4 | 127.0 | 122.1 | 124.8 | 127.4 | 130.0 | |
| | SC | 65.9 | | 84.9 | 101.3 | 117.8 | 68.9 | 87.9 | 104.3 | 120.8 | 71.9 | 90.9 | 107.3 | 123.8 | |
| | PI | 10196. | | 10531. | 10906. | 11439. | 10455. | 10790. | 11165. | 11698. | 10714. | 11049. | 11423. | 11956. | |
| 73 | TC | 120.6 | | 123.4 | 126.1 | 128.7 | 123.6 | 126.4 | 129.1 | 131.7 | 126.6 | 129.4 | 132.1 | 134.7 | |
| | SC | 40.4 | | 57.8 | 72.6 | 88.3 | 43.4 | 60.8 | 75.6 | 91.3 | 46.4 | 63.8 | 78.6 | 94.3 | |
| | PI | 10578. | | 10928. | 11311. | 11853. | 10837. | 11187. | 11570. | 12111. | 11096. | 11446. | 11829. | 12370. | |
| 95 | 61 | TC | | 95.5 | 97.8 | 100.0 | 102.1 | 98.5 | 100.8 | 103.0 | 105.1 | 101.5 | 103.8 | 106.0 | 108.1 |
| | | SC | | 85.4 | 87.5 | 89.4 | 91.4 | 88.4 | 90.5 | 92.4 | 94.4 | 91.4 | 93.5 | 95.4 | 97.4 |
| | | PI | | 8494.5 | 8814.7 | 9240.9 | 9755.3 | 8753.4 | 9073.6 | 9499.7 | 10014. | 9012.2 | 9332.4 | 9758.6 | 10273. |
| | 67 | TC | | 111.4 | 114.0 | 116.5 | 119.0 | 114.4 | 117.0 | 119.5 | 122.0 | 117.4 | 120.0 | 122.5 | 125.0 |
| | | SC | | 63.5 | 82.7 | 101.6 | 116.4 | 66.5 | 85.7 | 104.6 | 119.4 | 69.5 | 88.7 | 107.6 | 122.4 |
| | | PI | | 9848.5 | 10022. | 10454. | 11065. | 10107. | 10261. | 10713. | 11324. | 10366. | 10500. | 10972. | 11582. |
| | 73 | TC | | 119.5 | 122.2 | 124.9 | 127.6 | 122.5 | 125.2 | 127.9 | 130.6 | 125.5 | 128.2 | 130.9 | 133.6 |
| | | SC | | 39.0 | 58.3 | 74.5 | 90.8 | 42.0 | 61.3 | 77.5 | 93.8 | 45.0 | 64.3 | 80.5 | 96.8 |
| | | PI | | 10569. | 10920. | 11389. | 11939. | 10828. | 11178. | 11648. | 12198. | 11087. | 11437. | 11907. | 12457. |
| 105 | 61 | TC | | 87.2 | 89.3 | 91.3 | 93.3 | 90.2 | 92.3 | 94.3 | 96.3 | 93.2 | 95.3 | 97.3 | 99.3 |
| | | SC | | 81.3 | 83.3 | 85.2 | 87.0 | 84.3 | 86.3 | 88.2 | 90.0 | 87.3 | 89.3 | 91.2 | 93.0 |
| | | PI | | 9806.0 | 10117. | 10457. | 10980. | 10064. | 10376. | 10716. | 11239. | 10323. | 10635. | 10975. | 11498. |
| | 67 | TC | | 103.0 | 105.4 | 107.8 | 110.1 | 106.0 | 108.4 | 110.8 | 113.1 | 109.0 | 111.4 | 113.8 | 116.1 |
| | | SC | | 60.3 | 79.3 | 98.9 | 108.6 | 63.3 | 82.3 | 101.9 | 111.6 | 66.3 | 85.3 | 104.9 | 114.6 |
| | | PI | | 11180. | 11506. | 11881. | 12414. | 11439. | 11765. | 12140. | 12673. | 11697. | 12024. | 12398. | 12931. |
| | 73 | TC | 116.5 | 119.2 | 121.8 | 124.4 | 119.5 | 122.2 | 124.8 | 127.4 | 122.5 | 125.2 | 127.8 | 130.4 | |
| | | SC | 37.0 | 56.1 | 74.0 | 91.3 | 40.0 | 59.1 | 77.0 | 94.3 | 43.0 | 62.1 | 80.0 | 97.3 | |
| | | PI | 12347. | 12697. | 13089. | 13639. | 12606. | 12956. | 13348. | 13898. | 12865. | 13215. | 13606. | 14156. | |
| 115 | 61 | TC | 77.0 | 78.9 | 80.8 | 82.6 | 80.0 | 81.9 | 83.8 | 85.6 | 83.0 | 84.9 | 86.8 | 88.6 | |
| | | SC | 75.3 | 77.2 | 79.0 | 80.8 | 78.3 | 80.2 | 82.0 | 83.8 | 81.3 | 83.2 | 85.0 | 86.8 | |
| | | PI | 10435. | 10746. | 11242. | 11756. | 10694. | 11005. | 11500. | 12015. | 10953. | 11264. | 11759. | 12274. | |
| | 67 | TC | 92.0 | 94.2 | 96.4 | 98.5 | 95.0 | 97.2 | 99.4 | 101.5 | 98.0 | 100.2 | 102.4 | 104.5 | |
| | | SC | 54.2 | 74.1 | 93.1 | 95.1 | 57.2 | 77.1 | 96.1 | 98.1 | 60.2 | 80.1 | 99.1 | 101.1 | |
| | | PI | 11802. | 11982. | 12503. | 13036. | 12061. | 12241. | 12762. | 13295. | 12320. | 12500. | 13021. | 13554. | |
| | 73 | TC | 109.9 | 112.5 | 115.0 | 117.5 | 112.9 | 115.5 | 118.0 | 120.5 | 115.9 | 118.5 | 121.0 | 123.5 | |
| | | SC | 32.9 | 52.2 | 71.1 | 89.7 | 35.9 | 55.2 | 74.1 | 92.7 | 38.9 | 58.2 | 77.1 | 95.7 | |
| | | PI | 13295. | 13646. | 14193. | 14743. | 13554. | 13904. | 14451. | 15001. | 13813. | 14163. | 14710. | 15260. | |

- Notes: 1. All capacities are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat.
 2. TC=Total Capacity. (Unit: 1000Btu/h).
 3. SC=Sensible Capacity. (Unit: 1000Btu/h)

Heating capacity for 10Ton:

| Outdoor Temp(°F) 70% RH | Net Capacities(kW)-4100 CFM | | | | | | | |
|-------------------------|--|------|------|------|--|------|------|------|
| | Peak Net Heating(kW) at Indicated Dry Bulb(°F) | | | | Peak Total Power(KW) at Indicated Dry Bulb(°F) | | | |
| | 59 | 68 | 75.2 | 80.6 | 59 | 68 | 75.2 | 80.8 |
| 15.8 | 25.6 | 25 | 24.8 | 24.8 | 10.5 | 11.4 | 11.9 | 12.7 |
| 21.2 | 26.7 | 26 | 25.8 | 25.5 | 10.6 | 11.5 | 12.1 | 12.9 |
| 26.6 | 28.1 | 27.7 | 27.5 | 27.1 | 10.7 | 11.6 | 12.3 | 13.1 |
| 32 | 30 | 29.6 | 29.2 | 28.9 | 10.8 | 11.8 | 12.5 | 13.2 |
| 37.4 | 34.1 | 33.8 | 33.3 | 32.9 | 11 | 12 | 12.7 | 13.4 |
| 44.6 | 40.8 | 40 | 39.3 | 38.7 | 11.4 | 11.9 | 12.9 | 13.8 |
| 48.2 | 43.7 | 43.2 | 42.8 | 42.4 | 11.8 | 13 | 13.7 | 14.5 |
| 53.6 | 46.2 | 47.7 | 47.5 | 47.1 | 12.2 | 13.5 | 14.2 | 15 |
| 59 | 49.6 | 48.9 | 48.6 | 48.1 | 12.5 | 13.8 | 14.5 | 15.3 |
| 64.4 | 52.4 | 51.5 | 51 | 50.6 | 12.8 | 14.1 | 14.9 | 15.6 |
| 69.8 | 56 | 54.9 | 54.2 | 53.5 | 13 | 14.3 | 15 | 15.7 |
| 75.2 | 59 | 57.5 | 56.6 | 56 | 13.3 | 14.5 | 15.5 | 16 |

- Notes: 1. For other airflows, see heating capacity correction factor tables.
 2. Heating capacities and power are integrated to include the effects of defrost in the frost region.

8.15 Cooling capacity for 12.5Ton:

| Air Flow (CFM) | | 4000 | | | | | | 5000 | | | | 5500 | | | |
|---------------------|----------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Ambient Temperature | Ent (DB) | (°F) | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | |
| | | | 85 | 61 | TC | 127.3 | 129.8 | 132.7 | 135.3 | 130.8 | 133.4 | 136.3 | 139.0 | 134.3 | 137.0 |
| SC | 106.2 | 108.2 | | | 110.6 | 112.9 | 113.9 | 116.1 | 118.6 | 121.0 | 121.5 | 124.1 | 126.7 | 129.2 | |
| PI | 10063. | 10360. | | | 10811. | 11311. | 10392. | 10700. | 11151. | 11663. | 10721. | 11041. | 11492. | 12015. | |
| 67 | TC | 144.3 | | 147.3 | 150.4 | 153.6 | 145.8 | 148.8 | 151.9 | 155.0 | 147.2 | 150.2 | 153.3 | 156.4 | |
| | SC | 82.7 | | 105.3 | 122.4 | 143.1 | 85.5 | 108.1 | 127.8 | 147.6 | 88.4 | 110.9 | 133.2 | 152.0 | |
| | PI | 11682. | | 12017. | 12490. | 13023. | 11818. | 12153. | 12626. | 13159. | 11954. | 12289. | 12762. | 13295. | |
| 73 | TC | 150.7 | | 153.8 | 157.0 | 160.0 | 151.2 | 154.3 | 157.5 | 160.6 | 151.7 | 154.8 | 158.0 | 161.2 | |
| | SC | 54.2 | | 74.5 | 91.4 | 110.5 | 54.9 | 75.6 | 93.3 | 112.2 | 55.7 | 76.7 | 95.2 | 113.8 | |
| | PI | 12280. | | 12630. | 13114. | 13642. | 12325. | 12675. | 13160. | 13698. | 12370. | 12720. | 13205. | 13755. | |
| 95 | 61 | TC | | 117.3 | 119.9 | 122.4 | 124.8 | 121.1 | 123.6 | 126.2 | 128.7 | 124.8 | 127.3 | 130.0 | 132.7 |
| | | SC | | 101.1 | 103.3 | 105.3 | 107.6 | 108.9 | 111.2 | 113.5 | 115.9 | 116.7 | 119.1 | 121.6 | 124.2 |
| | | PI | | 10131. | 10440. | 11072. | 11561. | 10483. | 10792. | 11435. | 11936. | 10835. | 11144. | 11798. | 12310. |
| | 67 | TC | | 135.6 | 136.0 | 140.0 | 144.1 | 140.1 | 143.0 | 146.0 | 149.0 | 144.7 | 150.0 | 152.0 | 153.9 |
| | | SC | | 78.5 | 99.5 | 121.6 | 144.8 | 82.7 | 105.5 | 128.1 | 145.9 | 86.9 | 111.4 | 134.6 | 147.0 |
| | | PI | | 11768. | 11661. | 12440. | 12951. | 12199. | 12330. | 13008. | 13416. | 12631. | 13000. | 13575. | 13881. |
| | 73 | TC | | 149.5 | 152.5 | 155.7 | 159.0 | 149.9 | 152.9 | 156.1 | 159.3 | 150.2 | 153.2 | 156.4 | 159.7 |
| | | SC | | 52.2 | 74.6 | 92.2 | 110.2 | 53.3 | 76.2 | 95.6 | 115.2 | 54.3 | 77.7 | 99.0 | 120.1 |
| | | PI | | 13188. | 13527. | 14227. | 14788. | 13222. | 13561. | 14261. | 14822. | 13256. | 13595. | 14295. | 14856. |
| 105 | 61 | TC | | 107.1 | 109.3 | 111.6 | 114.0 | 111.1 | 113.4 | 115.8 | 118.2 | 115.1 | 117.5 | 120.0 | 122.4 |
| | | SC | | 96.1 | 98.1 | 100.3 | 102.2 | 104.0 | 106.2 | 108.4 | 110.6 | 111.9 | 114.2 | 116.6 | 119.0 |
| | | PI | | 11661. | 11959. | 12387. | 12898. | 12036. | 12344. | 12784. | 13295. | 12410. | 12730. | 13181. | 13693. |
| | 67 | TC | | 126.9 | 129.5 | 132.3 | 135.1 | 130.1 | 132.7 | 135.6 | 138.3 | 133.2 | 135.9 | 138.8 | 141.6 |
| | | SC | | 74.4 | 94.5 | 115.5 | 133.8 | 78.8 | 101.4 | 124.9 | 136.5 | 83.3 | 108.2 | 134.2 | 139.3 |
| | | PI | | 13553. | 13865. | 14350. | 14871. | 13848. | 14171. | 14656. | 15178. | 14143. | 14478. | 14963. | 15484. |
| | 73 | TC | 145.3 | 148.3 | 151.4 | 154.5 | 146.3 | 149.3 | 152.4 | 155.5 | 147.2 | 150.2 | 153.3 | 156.4 | |
| | | SC | 49.8 | 70.7 | 89.8 | 109.3 | 50.9 | 73.5 | 95.0 | 115.8 | 51.9 | 76.4 | 100.2 | 122.2 | |
| | | PI | 15297. | 15647. | 16154. | 16704. | 15387. | 15737. | 16245. | 16795. | 15478. | 15828. | 16336. | 16886. | |
| 115 | 61 | TC | 97.1 | 99.0 | 101.3 | 103.3 | 100.6 | 102.6 | 104.9 | 107.0 | 104.0 | 106.2 | 108.5 | 110.7 | |
| | | SC | 96.6 | 98.6 | 100.7 | 102.8 | 98.5 | 100.6 | 102.7 | 104.9 | 100.4 | 102.5 | 104.7 | 106.9 | |
| | | PI | 13281. | 13578. | 14018. | 14518. | 13610. | 13919. | 14358. | 14870. | 13939. | 14259. | 14699. | 15222. | |
| | 67 | TC | 116.3 | 116.5 | 121.2 | 123.7 | 118.6 | 121.0 | 123.6 | 126.1 | 120.8 | 125.4 | 126.0 | 128.5 | |
| | | SC | 68.6 | 90.8 | 115.8 | 118.1 | 73.2 | 96.8 | 119.6 | 122.0 | 77.8 | 102.8 | 123.5 | 126.0 | |
| | | PI | 14941. | 15060. | 15726. | 16248. | 15156. | 15480. | 15953. | 16475. | 15372. | 15900. | 16180. | 16702. | |
| | 73 | TC | 139.0 | 141.8 | 144.7 | 147.7 | 140.0 | 142.9 | 145.9 | 148.9 | 141.1 | 144.0 | 147.1 | 150.1 | |
| | | SC | 46.8 | 67.2 | 88.2 | 109.1 | 47.6 | 70.6 | 93.2 | 115.5 | 48.5 | 73.9 | 98.3 | 122.0 | |
| | | PI | 17280. | 17630. | 18126. | 18676. | 17382. | 17732. | 18239. | 18789. | 17484. | 17834. | 18353. | 18903. | |

Notes: 1. All capacities are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat.
 2. TC=Total Capacity. (Unit: 1000Btu/h).

3. SC=Sensible Capacity. (Unit: 1000Btu/h)

Heating capacity for 12.5Ton:

| Net Capacities(kW)-5500 CFM | | | | | | | | |
|-----------------------------|--|------|------|------|--|------|------|------|
| Outdoor Temp(°F) 70% RH | Peak Net Heating(kW) at Indicated Dry Bulb(°F) | | | | Peak Total Power(KW) at Indicated Dry Bulb(°F) | | | |
| | 59 | 68 | 75.2 | 80.6 | 59 | 68 | 75.2 | 80.8 |
| 15.8 | 30.6 | 30 | 29.8 | 29.8 | 11.8 | 12.7 | 13.2 | 14 |
| 21.2 | 31.7 | 31 | 30.8 | 30.5 | 11.9 | 12.8 | 13.4 | 14.2 |
| 26.6 | 33.1 | 32.7 | 32.5 | 32.1 | 12 | 12.9 | 13.6 | 14.4 |
| 32 | 35 | 34.6 | 34.2 | 33.9 | 12.1 | 13.1 | 13.8 | 14.5 |
| 37.4 | 39.1 | 38.8 | 38.3 | 37.9 | 12.3 | 13.3 | 14 | 14.7 |
| 44.6 | 45.8 | 45 | 44.3 | 43.7 | 12.7 | 13.2 | 14.2 | 15.1 |
| 48.2 | 48.7 | 48.2 | 47.8 | 47.4 | 13.1 | 14.3 | 15 | 15.8 |
| 53.6 | 51.2 | 52.7 | 52.5 | 52.1 | 13.5 | 14.8 | 15.5 | 16.3 |
| 59 | 54.6 | 53.9 | 53.6 | 53.1 | 13.8 | 15.1 | 15.8 | 16.6 |
| 64.4 | 57.4 | 56.5 | 56 | 55.6 | 14.1 | 15.4 | 16.2 | 16.9 |
| 69.8 | 61 | 59.9 | 59.2 | 58.5 | 14.3 | 15.6 | 16.3 | 17 |
| 75.2 | 64 | 62.5 | 61.6 | 61 | 14.6 | 15.8 | 16.8 | 17.3 |

Notes: 1. For other airflows, see heating capacity correction factor tables.
 2. Heating capacities and power are integrated to include the effects of defrost in the frost region.

8.16 Cooling capacity for 15Ton:

| Air Flow (CFM) | | | 6000 | | | | 6500 | | | | 7000 | | | | |
|---------------------|----------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Ambient Temperature | Ent (DB) | (°F) | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | |
| | | | 85 | 61 | TC | 159.1 | 159.6 | 166.9 | 176.9 | 163.5 | 165.6 | 173.0 | 182.9 | 167.9 | 171.6 |
| SC | 124.2 | 146.0 | | | 158.5 | 167.8 | 131.4 | 155.8 | 166.1 | 175.5 | 138.6 | 165.6 | 173.7 | 183.2 | |
| PI | 14891. | 15171. | | | 15852. | 16075. | 15041. | 15321. | 16002. | 16225. | 15191. | 15471. | 16152. | 16375. | |
| 67 | TC | 177.8 | | 181.0 | 184.2 | 188.2 | 183.2 | 185.5 | 187.7 | 190.4 | 188.6 | 190.0 | 191.2 | 192.6 | |
| | SC | 100.0 | | 122.9 | 142.6 | 165.8 | 104.6 | 127.8 | 149.9 | 173.1 | 109.2 | 132.7 | 157.2 | 180.4 | |
| | PI | 15238. | | 15518. | 16148. | 16371. | 15388. | 15668. | 16298. | 16521. | 15538. | 15818. | 16448. | 16671. | |
| 73 | TC | 191.3 | | 196.1 | 197.5 | 200.1 | 193.5 | 197.3 | 199.9 | 202.4 | 195.7 | 198.5 | 202.3 | 204.7 | |
| | SC | 70.7 | | 94.6 | 114.5 | 134.4 | 72.1 | 96.8 | 117.1 | 136.6 | 73.5 | 99.0 | 119.7 | 138.8 | |
| | PI | 15738. | | 16018. | 16648. | 16871. | 15888. | 16168. | 16798. | 17021. | 16038. | 16318. | 16948. | 17171. | |
| 95 | 61 | TC | | 151.4 | 152.2 | 157.4 | 169.6 | 153.3 | 157.1 | 164.6 | 175.6 | 155.2 | 162.0 | 171.8 | 181.6 |
| | | SC | | 117.8 | 142.5 | 152.5 | 164.4 | 125.2 | 149.8 | 159.6 | 170.3 | 132.6 | 157.1 | 166.7 | 176.2 |
| | | PI | | 15248. | 15498. | 16028. | 16551. | 15398. | 15648. | 16178. | 16701. | 15548. | 15798. | 16328. | 16851. |
| | 67 | TC | | 164.3 | 168.4 | 170.6 | 176.7 | 171.6 | 174.2 | 176.7 | 180.4 | 178.9 | 180.0 | 182.8 | 184.1 |
| | | SC | | 95.6 | 117.0 | 138.8 | 159.6 | 99.8 | 123.0 | 146.2 | 169.4 | 104.0 | 129.0 | 153.6 | 179.2 |
| | | PI | | 15320. | 15601. | 15893. | 16416. | 15470. | 15751. | 16043. | 16566. | 15620. | 15901. | 16193. | 16716. |
| | 73 | TC | | 187.3 | 190.0 | 191.9 | 193.9 | 188.7 | 191.1 | 193.6 | 196.3 | 190.1 | 192.2 | 195.3 | 198.7 |
| | | SC | | 67.4 | 89.9 | 111.9 | 130.5 | 68.9 | 93.1 | 114.9 | 135.4 | 70.4 | 96.3 | 117.9 | 140.3 |
| | | PI | | 16120. | 16401. | 16693. | 17216. | 16270. | 16551. | 16843. | 17366. | 16420. | 16701. | 16993. | 17516. |
| 105 | 61 | TC | | 137.7 | 141.5 | 144.1 | 161.4 | 142.6 | 146.4 | 153.9 | 166.3 | 147.5 | 151.3 | 163.7 | 171.2 |
| | | SC | | 111.2 | 135.8 | 138.3 | 154.9 | 119.5 | 140.5 | 147.7 | 159.6 | 127.8 | 145.2 | 157.1 | 164.3 |
| | | PI | | 16460. | 16690. | 16921. | 17644. | 16610. | 16840. | 17071. | 17794. | 16760. | 16990. | 17221. | 17944. |
| | 67 | TC | | 162.3 | 163.7 | 166.1 | 166.3 | 163.5 | 166.1 | 169.8 | 171.2 | 164.7 | 168.5 | 173.5 | 176.1 |
| | | SC | | 80.1 | 112.0 | 132.9 | 161.0 | 94.5 | 118.1 | 141.4 | 165.9 | 108.9 | 124.2 | 149.9 | 170.8 |
| | | PI | | 16864. | 16994. | 17487. | 18210. | 17014. | 17144. | 17637. | 18360. | 17164. | 17294. | 17787. | 18510. |
| | 73 | TC | 183.1 | 184.6 | 185.8 | 185.9 | 185.6 | 187.0 | 188.3 | 189.6 | 188.1 | 189.4 | 190.8 | 193.3 | |
| | | SC | 64.1 | 86.1 | 108.0 | 126.9 | 65.5 | 89.2 | 111.8 | 133.0 | 66.9 | 92.3 | 115.6 | 139.1 | |
| | | PI | 17364. | 17494. | 17987. | 18710. | 17514. | 17644. | 18137. | 18860. | 17664. | 17794. | 18287. | 19010. | |
| 115 | 61 | TC | 113.9 | 116.4 | 128.8 | 141.2 | 117.6 | 122.6 | 135.0 | 147.4 | 121.3 | 128.8 | 141.2 | 153.6 | |
| | | SC | 94.6 | 113.9 | 126.2 | 138.3 | 101.7 | 118.5 | 130.6 | 142.6 | 108.8 | 123.1 | 135.0 | 146.9 | |
| | | PI | 17061. | 17546. | 18032. | 19010. | 17211. | 17696. | 18182. | 19160. | 17361. | 17846. | 18332. | 19310. | |
| | 67 | TC | 139.8 | 141.0 | 141.1 | 145.7 | 141.0 | 143.5 | 144.8 | 148.4 | 142.2 | 146.0 | 148.5 | 151.1 | |
| | | SC | 80.7 | 94.2 | 115.3 | 143.7 | 85.6 | 100.7 | 123.9 | 147.4 | 90.5 | 107.2 | 132.5 | 151.1 | |
| | | PI | 18071. | 18201. | 18894. | 19644. | 18221. | 18351. | 19044. | 19794. | 18371. | 18501. | 19194. | 19944. | |
| | 73 | TC | 155.6 | 158.3 | 162.2 | 163.4 | 160.6 | 163.2 | 165.8 | 167.1 | 165.6 | 168.1 | 169.4 | 170.8 | |
| | | SC | 47.9 | 68.7 | 92.0 | 114.2 | 49.3 | 72.9 | 96.3 | 119.1 | 50.7 | 77.1 | 100.6 | 124.0 | |
| | | PI | 18751. | 18881. | 19574. | 20324. | 18901. | 19031. | 19724. | 20474. | 19051. | 19181. | 19874. | 20624. | |

- Notes: 1. All capacities are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat.
 2. TC=Total Capacity. (Unit: 1000Btu/h).
 3. SC=Sensible Capacity. (Unit: 1000Btu/h).

Heating capacity for 15Ton:

| Outdoor Temp(°F) 70% RH | Net Capacities(kW)-7000 CFM | | | | | | | |
|-------------------------|--|------|------|------|--|------|------|------|
| | Peak Net Heating(kW) at Indicated Dry Bulb(°F) | | | | Peak Total Power(KW) at Indicated Dry Bulb(°F) | | | |
| | 59 | 68 | 75.2 | 80.6 | 59 | 68 | 75.2 | 80.8 |
| 15.8 | 33.9 | 33 | 32.7 | 32.7 | 14 | 15.3 | 16.1 | 17.3 |
| 21.2 | 35.6 | 34.5 | 34.2 | 33.8 | 14.1 | 15.5 | 16.4 | 17.6 |
| 26.6 | 37.7 | 37.1 | 36.8 | 36.2 | 14.3 | 15.6 | 16.7 | 17.9 |
| 32 | 40.5 | 39.9 | 39.3 | 38.9 | 14.4 | 15.9 | 17 | 18 |
| 37.4 | 46.7 | 46.2 | 45.5 | 44.9 | 14.7 | 16.2 | 17.3 | 18.3 |
| 44.6 | 56.7 | 56 | 54.3 | 53.7 | 15.3 | 17.2 | 17.9 | 18.9 |
| 48.2 | 61.1 | 60.3 | 59.7 | 59.1 | 15.9 | 17.7 | 18.8 | 20 |
| 53.6 | 64.8 | 67.1 | 66.8 | 66.2 | 16.5 | 18.5 | 19.5 | 20.7 |
| 59 | 69.9 | 68.9 | 68.4 | 67.7 | 17 | 18.9 | 20 | 21.2 |
| 64.4 | 74.1 | 72.8 | 72 | 71.4 | 17.4 | 19.4 | 20.6 | 21.6 |
| 69.8 | 79.5 | 77.9 | 76.8 | 75.8 | 17.7 | 19.7 | 20.7 | 21.8 |
| 75.2 | 84 | 81.8 | 80.4 | 79.5 | 18.2 | 20 | 21.5 | 22.2 |

- Notes: 1. For other airflows, see heating capacity correction factor tables.
 2. Heating capacities and power are integrated to include the effects of defrost in the frost region.

8.17 Cooling capacity for 17.5Ton:

| Air Flow (CFM) | | Ent (DB) | | (°F) | | 6400 | | | | 7000 | | | | 7600 | | | |
|---------------------|-----|----------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|----|----|
| | | | | | | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 |
| Ambient Temperature | 85 | 61 | TC | 185.6 | 188.0 | 196.5 | 207.7 | 190.7 | 193.1 | 201.6 | 212.8 | 195.8 | 198.2 | 206.7 | 217.9 | | |
| | | | SC | 148.8 | 176.8 | 188.5 | 199.2 | 153.9 | 181.9 | 193.6 | 204.3 | 159.0 | 187.0 | 198.7 | 209.4 | | |
| | | | PI | 13087. | 13343. | 15919. | 16204. | 13977. | 14237. | 16404. | 16689. | 14868. | 15130. | 16889. | 17175. | | |
| | | 67 | TC | 208.2 | 210.8 | 213.3 | 216.3 | 213.3 | 215.9 | 218.4 | 221.4 | 218.4 | 221.0 | 223.5 | 226.5 | | |
| | | | SC | 118.1 | 144.6 | 170.0 | 196.5 | 123.2 | 149.7 | 175.1 | 201.6 | 128.3 | 154.8 | 180.2 | 206.7 | | |
| | | | PI | 15361. | 15617. | 18193. | 18478. | 16251. | 16511. | 18678. | 18964. | 17142. | 17404. | 19163. | 19449. | | |
| | | 73 | TC | 220.0 | 224.3 | 227.3 | 230.1 | 225.1 | 229.4 | 232.4 | 235.2 | 230.2 | 234.5 | 237.5 | 240.3 | | |
| | | | SC | 80.8 | 109.1 | 132.4 | 154.6 | 85.9 | 114.2 | 137.5 | 159.7 | 91.0 | 119.3 | 142.6 | 164.8 | | |
| | | | PI | 16528. | 16785. | 19060. | 19445. | 17368. | 17628. | 19545. | 19881. | 18209. | 18472. | 20031. | 20316. | | |
| | 95 | 61 | TC | 173.9 | 178.2 | 186.8 | 199.3 | 179.0 | 183.3 | 191.9 | 204.4 | 184.1 | 188.4 | 197.0 | 209.5 | | |
| | | | SC | 141.7 | 169.9 | 181.1 | 193.2 | 146.8 | 175.0 | 186.2 | 198.3 | 151.9 | 180.1 | 191.3 | 203.4 | | |
| | | | PI | 14883. | 15139. | 17415. | 17800. | 15723. | 15983. | 17900. | 18236. | 16564. | 16826. | 18385. | 18671. | | |
| | | 67 | TC | 194.9 | 197.8 | 200.7 | 204.8 | 200.0 | 202.9 | 205.8 | 209.9 | 205.1 | 208.0 | 210.9 | 215.0 | | |
| | | | SC | 112.6 | 139.1 | 165.7 | 192.2 | 117.7 | 144.2 | 170.8 | 197.3 | 122.8 | 149.3 | 175.9 | 202.4 | | |
| | | | PI | 16657. | 16915. | 19189. | 19574. | 17497. | 17757. | 19674. | 20010. | 18338. | 18600. | 20160. | 20445. | | |
| | | 73 | TC | 214.5 | 217.2 | 220.1 | 223.1 | 219.6 | 222.3 | 225.2 | 228.2 | 224.7 | 227.4 | 230.3 | 233.3 | | |
| | | | SC | 77.1 | 104.9 | 129.8 | 153.2 | 82.2 | 110.0 | 134.9 | 158.3 | 87.3 | 115.1 | 140.0 | 163.4 | | |
| | | | PI | 18324. | 18581. | 20606. | 21092. | 19115. | 19374. | 21091. | 21477. | 19905. | 20168. | 21577. | 21862. | | |
| | 105 | 61 | TC | 161.6 | 166.0 | 174.6 | 188.7 | 166.7 | 171.1 | 179.7 | 193.8 | 171.8 | 176.2 | 184.8 | 198.9 | | |
| | | | SC | 135.1 | 159.2 | 167.4 | 181.0 | 140.2 | 164.3 | 172.5 | 186.1 | 145.3 | 169.4 | 177.6 | 191.2 | | |
| | | | PI | 16679. | 16936. | 18961. | 19446. | 17469. | 17729. | 19446. | 19832. | 18260. | 18523. | 19932. | 20217. | | |
| | | 67 | TC | 185.6 | 188.6 | 192.8 | 194.3 | 190.7 | 193.7 | 197.9 | 199.4 | 195.8 | 198.8 | 203.0 | 204.5 | | |
| | | | SC | 106.5 | 133.5 | 160.2 | 188.2 | 111.6 | 138.6 | 165.3 | 193.3 | 116.7 | 143.7 | 170.4 | 198.4 | | |
| | | | PI | 18953. | 19210. | 21185. | 21671. | 19744. | 20003. | 21670. | 22056. | 20534. | 20797. | 22156. | 22441. | | |
| 73 | | TC | 210.9 | 212.5 | 214.0 | 215.4 | 216.0 | 217.6 | 219.1 | 220.5 | 221.1 | 222.7 | 224.2 | 225.6 | | | |
| | | SC | 73.2 | 100.4 | 126.3 | 150.5 | 78.3 | 105.5 | 131.4 | 155.6 | 83.4 | 110.6 | 136.5 | 160.7 | | | |
| | | PI | 21383. | 21640. | 23438. | 24023. | 22124. | 22384. | 23923. | 24358. | 22864. | 23127. | 24408. | 24694. | | | |
| 115 | 61 | TC | 141.2 | 146.9 | 161.1 | 175.3 | 146.3 | 152.0 | 166.2 | 180.4 | 151.4 | 157.1 | 171.3 | 185.5 | | | |
| | | SC | 123.0 | 142.2 | 156.1 | 169.7 | 128.1 | 147.3 | 161.2 | 174.8 | 133.2 | 152.4 | 166.3 | 179.9 | | | |
| | | PI | 18759. | 19016. | 20813. | 21399. | 19500. | 19759. | 21299. | 21734. | 20240. | 20503. | 21784. | 22069. | | | |
| | 67 | TC | 168.1 | 168.0 | 172.4 | 175.3 | 173.2 | 176.0 | 177.5 | 180.4 | 178.3 | 184.0 | 182.6 | 185.5 | | | |
| | | SC | 104.5 | 121.8 | 148.4 | 175.3 | 109.6 | 126.9 | 153.5 | 180.4 | 114.7 | 132.0 | 158.6 | 185.5 | | | |
| | | PI | 20893. | 20986. | 22897. | 23482. | 21633. | 21893. | 23382. | 23818. | 22374. | 22800. | 23867. | 24153. | | | |
| | 73 | TC | 190.5 | 193.5 | 196.5 | 197.8 | 195.6 | 198.6 | 201.6 | 202.9 | 200.7 | 203.7 | 206.7 | 208.0 | | | |
| | | SC | 62.9 | 90.0 | 116.8 | 142.8 | 68.0 | 95.1 | 121.9 | 147.9 | 73.1 | 100.2 | 127.0 | 153.0 | | | |
| | | PI | 23197. | 23454. | 25101. | 25787. | 23888. | 24147. | 25587. | 26072. | 24578. | 24841. | 26072. | 26357. | | | |

- Notes: 1. All capacities are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat.
 2. TC=Total Capacity. (Unit: 1000Btu/h).
 3. SC=Sensible Capacity. (Unit: 1000Btu/h).

Heating capacity for 17.5Ton:

| Outdoor Temp(°F) 70% RH | Net Capacities(kW)-7600 CFM | | | | | | | |
|-------------------------|--|------|------|------|--|------|------|------|
| | Peak Net Heating(kW) at Indicated Dry Bulb(°F) | | | | Peak Total Power(KW) at Indicated Dry Bulb(°F) | | | |
| | 59 | 68 | 75.2 | 80.6 | 59 | 68 | 75.2 | 80.8 |
| 15.8 | 37.7 | 36.6 | 36.2 | 36.2 | 15.9 | 17.3 | 18.2 | 19.6 |
| 21.2 | 39.7 | 38.4 | 38 | 37.6 | 16 | 17.6 | 18.6 | 19.9 |
| 26.6 | 42.2 | 41.5 | 41.2 | 40.4 | 16.2 | 17.7 | 18.9 | 20.3 |
| 32 | 45.6 | 44.9 | 44.2 | 43.7 | 16.3 | 18 | 19.2 | 20.4 |
| 37.4 | 53 | 52.4 | 51.6 | 50.9 | 16.7 | 18.3 | 19.6 | 20.7 |
| 44.6 | 65.5 | 64 | 59.9 | 59.5 | 17.3 | 19.5 | 20.3 | 21.4 |
| 48.2 | 70.3 | 69.4 | 68.6 | 67.9 | 18 | 20 | 21.3 | 22.6 |
| 53.6 | 74.8 | 77.5 | 77.2 | 76.4 | 18.7 | 20.9 | 22.1 | 23.4 |
| 59 | 80.9 | 79.7 | 79.1 | 78.2 | 19.2 | 21.4 | 22.6 | 24 |
| 64.4 | 85.9 | 84.4 | 83.4 | 82.7 | 19.7 | 22 | 23.3 | 24.4 |
| 69.8 | 92.4 | 90.5 | 89.2 | 88 | 20 | 22.3 | 23.4 | 24.7 |
| 75.2 | 97.8 | 95.2 | 93.5 | 92.4 | 20.6 | 22.6 | 24.3 | 25.1 |

- Notes: 1. For other airflows, see heating capacity correction factor tables.
 2. Heating capacities and power are integrated to include the effects of defrost in the frost region.

8.18 Cooling capacity for 20Ton:

| Air Flow (CFM) | | | 6800 | | | | 7800 | | | | 8800 | | | | |
|---------------------|---------|------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|
| Ambient Temperature | Ent(DB) | (°F) | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | |
| | | 85 | 61 | TC | 210.3 | 210.8 | 220.7 | 233.4 | 216.2 | 218.8 | 228.6 | 241.4 | 222.1 | 226.8 | 236.5 |
| SC | 164.2 | | | 193.2 | 214.0 | 226.5 | 173.8 | 206.0 | 221.7 | 234.2 | 183.4 | 218.8 | 229.4 | 241.9 | |
| PI | 19958.3 | | | 20056.5 | 20886.8 | 20830.5 | 20278.5 | 20347.6 | 20902.9 | 20918.6 | 20598.6 | 20638.7 | 20919.0 | 21006.7 | |
| 67 | TC | | 235.0 | 239.2 | 243.2 | 248.3 | 242.2 | 245.2 | 247.9 | 251.3 | 249.4 | 251.2 | 252.6 | 254.3 | |
| | SC | | 132.2 | 162.4 | 188.4 | 219.0 | 138.4 | 168.9 | 198.0 | 228.6 | 144.6 | 175.4 | 207.6 | 238.2 | |
| | PI | | 20905.1 | 21063.9 | 21358.2 | 21680.3 | 21474.3 | 21613.6 | 21796.9 | 22002.3 | 22043.4 | 22163.4 | 22235.5 | 22324.4 | |
| 73 | TC | | 253.0 | 259.2 | 260.7 | 264.3 | 255.9 | 260.8 | 264.0 | 267.3 | 258.8 | 262.4 | 267.3 | 270.3 | |
| | SC | | 93.7 | 125.1 | 151.1 | 177.4 | 95.5 | 128.0 | 154.6 | 180.3 | 97.3 | 130.9 | 158.1 | 183.2 | |
| | PI | | 22679.2 | 22774.2 | 22901.9 | 22957.4 | 22772.2 | 22857.5 | 23029.6 | 23085.1 | 22865.2 | 22940.7 | 23157.3 | 23212.8 | |
| 95 | 61 | | TC | 200.1 | 201.1 | 207.8 | 223.8 | 202.7 | 207.6 | 217.4 | 231.8 | 205.3 | 214.1 | 227.0 | 239.8 |
| | | | SC | 156.0 | 190.4 | 203.7 | 219.6 | 165.7 | 198.0 | 210.8 | 224.9 | 175.4 | 205.6 | 217.9 | 230.2 |
| | | | PI | 19336.4 | 19495.2 | 20325.4 | 20269.2 | 19646.9 | 19786.3 | 20341.6 | 20357.3 | 19957.4 | 20077.4 | 20357.7 | 20445.4 |
| | 67 | | TC | 217.5 | 220.4 | 225.6 | 233.4 | 227.0 | 230.2 | 233.5 | 238.2 | 236.5 | 240.0 | 241.4 | 243.0 |
| | | | SC | 126.6 | 154.6 | 183.5 | 210.9 | 132.1 | 162.6 | 193.2 | 223.7 | 137.6 | 170.6 | 202.9 | 236.5 |
| | | | PI | 20283.3 | 20502.6 | 20796.9 | 21118.9 | 20842.7 | 21052.3 | 21235.5 | 21441.0 | 21402.1 | 21602.0 | 21674.2 | 21763.1 |
| | 73 | | TC | 247.7 | 251.1 | 253.4 | 255.8 | 249.5 | 252.6 | 255.7 | 259.1 | 251.3 | 254.1 | 258.0 | 262.4 |
| | | | SC | 89.4 | 118.9 | 147.6 | 172.2 | 91.3 | 123.1 | 151.7 | 178.7 | 93.2 | 127.3 | 155.8 | 185.2 |
| | | | PI | 22057.3 | 22212.8 | 22340.5 | 22396.1 | 22140.6 | 22296.1 | 22468.2 | 22523.8 | 22223.9 | 22379.4 | 22596.0 | 22651.5 |
| 105 | 61 | | TC | 182.1 | 187.0 | 190.2 | 213.0 | 188.6 | 193.5 | 203.2 | 219.5 | 195.1 | 200.0 | 216.2 | 226.0 |
| | | | SC | 147.1 | 181.4 | 184.5 | 206.6 | 158.1 | 187.7 | 197.1 | 212.9 | 169.1 | 194.0 | 209.7 | 219.2 |
| | | | PI | 22036.1 | 22194.9 | 23025.1 | 22968.9 | 22346.6 | 22486.0 | 23041.2 | 23057.0 | 22657.1 | 22777.1 | 23057.4 | 23145.1 |
| | 67 | | TC | 214.5 | 216.3 | 219.6 | 219.5 | 216.2 | 219.5 | 224.4 | 226.0 | 217.9 | 222.7 | 229.2 | 232.5 |
| | | | SC | 106.1 | 148.0 | 175.6 | 228.8 | 125.1 | 156.1 | 186.8 | 219.0 | 144.1 | 164.2 | 198.0 | 209.2 |
| | | | PI | 22231.1 | 22450.5 | 22744.8 | 23066.8 | 22790.6 | 23000.2 | 23183.4 | 23388.9 | 23350.0 | 23549.9 | 23622.1 | 23710.9 |
| | 73 | TC | 242.3 | 243.8 | 245.4 | 245.6 | 245.5 | 247.1 | 248.7 | 250.4 | 248.7 | 250.4 | 252.0 | 255.2 | |
| | | SC | 84.7 | 113.7 | 142.7 | 167.6 | 86.7 | 117.9 | 147.7 | 175.6 | 88.7 | 122.1 | 152.7 | 183.6 | |
| | | PI | 24905.2 | 25060.7 | 25188.4 | 25243.9 | 24988.5 | 25144.0 | 25316.1 | 25371.6 | 25071.8 | 25227.2 | 25443.8 | 25499.3 | |
| 115 | 61 | TC | 174.1 | 177.3 | 193.5 | 209.8 | 178.9 | 185.4 | 201.6 | 217.9 | 183.7 | 193.5 | 209.7 | 226.0 | |
| | | SC | 148.5 | 172.1 | 188.0 | 203.6 | 157.9 | 180.0 | 195.8 | 211.5 | 167.3 | 187.9 | 203.6 | 219.4 | |
| | | PI | 23618.2 | 23777.0 | 24607.2 | 24551.0 | 23928.7 | 24068.1 | 24623.4 | 24639.1 | 24239.2 | 24359.2 | 24639.5 | 24727.2 | |
| | 67 | TC | 191.0 | 192.8 | 192.7 | 196.1 | 192.7 | 196.0 | 197.6 | 200.9 | 194.4 | 199.2 | 202.5 | 205.7 | |
| | | SC | 113.1 | 130.8 | 158.6 | 196.1 | 119.6 | 139.4 | 170.0 | 200.9 | 126.1 | 148.0 | 181.4 | 205.7 | |
| | | PI | 23813.3 | 24064.6 | 24326.9 | 24648.9 | 24372.7 | 24582.3 | 24765.5 | 24971.0 | 24932.1 | 25100.0 | 25204.2 | 25293.1 | |
| | 73 | TC | 212.2 | 215.5 | 220.3 | 222.1 | 218.7 | 222.0 | 225.2 | 226.9 | 225.2 | 228.5 | 230.1 | 231.7 | |
| | | SC | 69.9 | 97.2 | 127.7 | 157.0 | 71.7 | 102.7 | 133.4 | 163.5 | 73.5 | 108.2 | 139.1 | 170.0 | |
| | | PI | 26910.5 | 27066.0 | 27193.7 | 27249.2 | 26993.8 | 27149.3 | 27321.4 | 27376.9 | 27077.1 | 27232.6 | 27449.1 | 27504.6 | |

- Notes: 1. All capacities are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat.
 2. TC=Total Capacity. (Unit: 1000Btu/h).
 3. SC=Sensible Capacity. (Unit: 1000Btu/h).

Heating capacity for 20Ton:

| Outdoor Temp(°F) 70% RH | Net Capacities(kW)-8800 CFM | | | | | | | |
|-------------------------|--|-------|-------|------|--|------|------|------|
| | Peak Net Heating(kW) at Indicated Dry Bulb(°F) | | | | Peak Total Power(KW) at Indicated Dry Bulb(°F) | | | |
| | 59 | 68 | 75.2 | 80.6 | 59 | 68 | 75.2 | 80.6 |
| 15.8 | 45.2 | 44 | 43.6 | 43.6 | 19 | 20.8 | 21.8 | 23.4 |
| 21.2 | 47.4 | 46 | 45.6 | 45 | 19.2 | 21 | 22.2 | 23.8 |
| 26.6 | 50.2 | 49.4 | 49 | 48.2 | 19.4 | 21.2 | 22.6 | 24.2 |
| 32 | 54 | 53.2 | 52.4 | 51.8 | 19.6 | 21.6 | 23 | 24.4 |
| 37.4 | 62.2 | 61.6 | 60.6 | 59.8 | 20 | 22 | 23.4 | 24.8 |
| 44.6 | 75.8 | 75 | 74.2 | 73.6 | 20.8 | 23.6 | 24.2 | 25.6 |
| 48.2 | 81.4 | 80.4 | 79.6 | 78.8 | 21.6 | 24 | 25.4 | 27 |
| 53.6 | 86.4 | 89.4 | 89 | 88.2 | 22.4 | 25 | 26.4 | 28 |
| 59 | 93.2 | 91.8 | 91.2 | 90.2 | 23 | 25.6 | 27 | 28.6 |
| 64.4 | 98.8 | 97 | 96 | 95.2 | 23.6 | 26.2 | 27.8 | 29.2 |
| 69.8 | 106 | 103.8 | 102.4 | 101 | 24 | 26.6 | 28 | 29.4 |
| 75.2 | 112 | 109 | 107.2 | 106 | 24.6 | 27 | 29 | 30 |

- Notes: 1. For other airflows, see heating capacity correction factor tables.
 2. Heating capacities and power are integrated to include the effects of defrost in the frost region.

8.19 Cooling capacity for 30Ton:

| Air Flow (CFM) | | Ent | | (°F) | | 9000 | | | | 105000 | | | | 12000 | | | |
|---------------------|-----|-----|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|----|----|
| | | | | | | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 | 75 | 80 | 85 | 90 |
| Ambient Temperature | 85 | 61 | TC | 311.2 | 312.0 | 325.9 | 345.1 | 319.7 | 323.6 | 337.7 | 356.7 | 328.2 | 335.2 | 349.5 | 368.3 | | |
| | | | SC | 248.1 | 289.9 | 314.0 | 337.7 | 262.0 | 308.9 | 328.7 | 346.6 | 275.9 | 327.9 | 343.4 | 355.5 | | |
| | | | PI | 27143. | 27752. | 28995. | 30630. | 27343. | 27952. | 29195. | 30830. | 27543. | 28152. | 29395. | 31030. | | |
| | | 67 | TC | 347.3 | 353.4 | 359.3 | 367.0 | 357.8 | 362.1 | 366.1 | 371.2 | 368.3 | 370.8 | 372.9 | 375.4 | | |
| | | | SC | 201.2 | 245.3 | 283.1 | 327.9 | 210.1 | 254.8 | 297.3 | 342.0 | 219.0 | 264.3 | 311.5 | 356.1 | | |
| | | | PI | 30430. | 30648. | 30830. | 31048. | 30730. | 30948. | 31130. | 31348. | 31030. | 31248. | 31430. | 31648. | | |
| | | 73 | TC | 373.4 | 382.6 | 385.0 | 390.0 | 377.7 | 384.9 | 389.7 | 394.4 | 382.0 | 387.2 | 394.4 | 398.8 | | |
| | | | SC | 144.6 | 190.7 | 228.8 | 267.1 | 147.3 | 194.9 | 233.9 | 271.4 | 150.0 | 199.1 | 239.0 | 275.7 | | |
| | | | PI | 31422. | 31874. | 32500. | 32883. | 31822. | 32274. | 32900. | 33283. | 32222. | 32674. | 33300. | 33683. | | |
| | 95 | 61 | TC | 296.3 | 270.5 | 307.6 | 330.9 | 300.0 | 307.2 | 321.5 | 342.5 | 303.7 | 343.9 | 335.4 | 354.1 | | |
| | | | SC | 235.7 | 287.9 | 302.4 | 325.2 | 250.0 | 297.3 | 316.1 | 336.6 | 264.3 | 306.7 | 329.8 | 348.0 | | |
| | | | PI | 27535. | 31366. | 30556. | 32337. | 27735. | 31566. | 30756. | 32537. | 27935. | 31766. | 30956. | 32737. | | |
| | | 67 | TC | 338.6 | 341.0 | 343.4 | 354.9 | 345.7 | 350.5 | 355.2 | 362.1 | 352.8 | 360.0 | 367.0 | 369.3 | | |
| | | | SC | 140.8 | 181.9 | 247.9 | 325.8 | 200.9 | 245.5 | 290.2 | 334.8 | 261.0 | 309.1 | 332.5 | 343.8 | | |
| | | | PI | 32014. | 32700. | 33366. | 33586. | 32314. | 33000. | 33666. | 33886. | 32614. | 33300. | 33966. | 34186. | | |
| | | 73 | TC | 365.8 | 370.8 | 374.2 | 378.0 | 368.5 | 372.9 | 377.5 | 382.6 | 371.2 | 375.0 | 380.8 | 387.2 | | |
| | | | SC | 138.2 | 181.5 | 223.9 | 259.6 | 141.1 | 187.7 | 229.7 | 269.1 | 144.0 | 193.9 | 235.5 | 278.6 | | |
| | | | PI | 33567. | 33929. | 34481. | 35091. | 33967. | 34329. | 34881. | 35491. | 34367. | 34729. | 35281. | 35891. | | |
| | 105 | 61 | TC | 269.8 | 277.0 | 281.9 | 315.2 | 279.3 | 286.5 | 300.8 | 324.6 | 288.8 | 296.0 | 319.7 | 334.0 | | |
| | | | SC | 223.0 | 270.4 | 274.9 | 306.8 | 239.0 | 279.4 | 293.1 | 315.9 | 255.0 | 288.4 | 311.3 | 325.0 | | |
| | | | PI | 34180. | 35067. | 37987. | 39749. | 34380. | 35267. | 38187. | 39949. | 34580. | 35467. | 38387. | 40149. | | |
| | | 67 | TC | 317.3 | 320.0 | 324.3 | 324.5 | 319.7 | 324.6 | 331.5 | 334.0 | 322.1 | 329.2 | 338.7 | 343.5 | | |
| | | | SC | 162.7 | 224.4 | 264.5 | 318.6 | 190.6 | 236.1 | 280.9 | 328.1 | 218.5 | 247.8 | 297.3 | 337.6 | | |
| | | | PI | 38083. | 38957. | 40128. | 40719. | 38383. | 39257. | 40428. | 41019. | 38683. | 39557. | 40728. | 41319. | | |
| 73 | | TC | 357.7 | 360.4 | 362.5 | 362.4 | 362.5 | 365.0 | 367.3 | 369.6 | 367.3 | 369.6 | 372.1 | 376.8 | | | |
| | | SC | 131.9 | 174.2 | 216.4 | 252.7 | 134.6 | 180.2 | 223.7 | 264.5 | 137.3 | 186.2 | 231.0 | 276.3 | | | |
| | | PI | 43451. | 43735. | 44043. | 44622. | 43851. | 44135. | 44443. | 45022. | 44251. | 44535. | 44843. | 45422. | | | |
| 115 | 61 | TC | 264.3 | 269.0 | 292.8 | 316.6 | 271.5 | 281.0 | 304.8 | 328.6 | 278.7 | 293.0 | 316.8 | 340.6 | | | |
| | | SC | 221.4 | 258.5 | 282.1 | 305.3 | 235.1 | 267.4 | 290.6 | 313.6 | 248.8 | 276.3 | 299.1 | 321.9 | | | |
| | | PI | 34244. | 36021. | 38980. | 41938. | 34444. | 36221. | 39180. | 42138. | 34644. | 36421. | 39380. | 42338. | | | |
| | 67 | TC | 324.5 | 326.5 | 328.5 | 331.5 | 326.8 | 331.4 | 333.7 | 338.6 | 329.1 | 336.3 | 338.9 | 345.7 | | | |
| | | SC | 220.2 | 246.1 | 286.5 | 331.7 | 229.6 | 258.6 | 303.2 | 327.7 | 239.0 | 271.1 | 319.9 | 323.7 | | | |
| | | PI | 39509. | 40404. | 40727. | 41572. | 40609. | 41504. | 41827. | 42672. | 41709. | 42604. | 42927. | 43772. | | | |
| | 73 | TC | 335.1 | 340.0 | 347.3 | 349.6 | 344.7 | 349.5 | 354.3 | 356.7 | 354.3 | 359.0 | 361.3 | 363.8 | | | |
| | | SC | 128.1 | 171.1 | 216.0 | 258.8 | 133.8 | 179.2 | 224.3 | 268.2 | 139.5 | 187.3 | 232.6 | 277.6 | | | |
| | | PI | 43241. | 43826. | 44112. | 44422. | 43641. | 44226. | 44512. | 44822. | 44041. | 44626. | 44912. | 45222. | | | |

- Notes: 1. All capacities are gross and have not considered indoor fan heat. To obtain NET cooling capacity subtract indoor fan heat.
 2. TC=Total Capacity. (Unit: 1000Btu/h).
 3. SC=Sensible Capacity. (Unit: 1000Btu/h).

Heating capacity for 30Ton:

| Outdoor Temp(°F) 70% RH | Net Capacities(kW)-11200 CFM | | | | | | | |
|----------------------------|--|-------|-------|-------|---|------|------|------|
| | Peak Net Heating(kW) at Indicated Dry Bulb(°F) | | | | Peak Total Power (kW) at Indicated Dry Bulb(°F) | | | |
| | 59 | 70 | 75 | 80 | 59 | 70 | 75 | 80 |
| 23 | 76.5 | 74.3 | 73.7 | 72.9 | 31.7 | 34.5 | 36.3 | 38.7 |
| 27 | 80.7 | 79.5 | 78.9 | 77.7 | 32.1 | 34.7 | 36.9 | 39.3 |
| 32 | 86.3 | 85.1 | 83.9 | 83.1 | 32.3 | 35.3 | 37.5 | 39.5 |
| 37 | 98.7 | 97.7 | 96.3 | 95.1 | 32.9 | 35.9 | 38.1 | 40.1 |
| 43 | 112.7 | 111.3 | 110.1 | 109.5 | 34.1 | 36.5 | 39.3 | 41.3 |
| 48 | 127.5 | 125.9 | 124.7 | 123.5 | 35.3 | 38.9 | 41.1 | 43.5 |
| 54 | 134.9 | 139.5 | 138.9 | 137.7 | 36.5 | 40.5 | 42.5 | 44.9 |
| 60 | 145.1 | 143.1 | 142.1 | 140.7 | 37.5 | 41.3 | 43.5 | 45.9 |
| 64 | 153.5 | 150.9 | 149.3 | 148.1 | 38.3 | 42.3 | 44.7 | 46.7 |
| 70 | 164.3 | 161.1 | 158.9 | 156.9 | 38.9 | 42.9 | 44.9 | 47.1 |
| 75 | 173.3 | 168.9 | 166.1 | 164.3 | 39.9 | 43.5 | 46.5 | 47.9 |

- Notes: 1. For other airflows, see heating capacity correction factor tables.
 2. Heating capacities and power are integrated to include the effects of defrost in the frost region.

9. Electrical Data

T1 Application

| Model | Power Supply | | | Compressor | | | | Evaporator fan motor | | | Condenser fan motor | | |
|------------------|--------------|-------|-------|------------|----------|-----------|-----|----------------------|------|-----|---------------------|------------|-----|
| | MCA | TOCA | MFA | STC | RNC | IPT | Qty | RNC | IPT | Qty | RNC (each) | IPT (each) | Qty |
| MRC-062HWN1-R(C) | 23.5 | 28.9 | 33.2 | 75 | 9.7 | 5.65 | 1 | 7.22 | 1.62 | 1 | 3.65 | 0.83 | 1 |
| MRC-075HWN1-R(C) | 29.4 | 36.5 | 43.7 | 121.2 | 14.3 | 8.08 | 1 | 7.18 | 1.61 | 1 | 3.93 | 0.88 | 1 |
| MRC-085HWN1-R(C) | 29.6 | 36.3 | 47.2 | 62 | 8.8 | 5.13 | 2 | 2.90 | 1.39 | 1 | 3.93 | 0.88 | 1 |
| MRC-100HWN1-R(C) | 30.2 | 37.3 | 49.4 | 66 | 9.6 | 5.7 | 2 | 3.50 | 1.84 | 1 | 2.51 | 0.98 | 1 |
| MRC-125HWN1-R(C) | 41.5 | 52.9 | 66.4 | 64+139 | 8.3+16.6 | 4.75+9.16 | 1+1 | 4.84 | 2.03 | 1 | 3.66 | 0.83 | 1 |
| MRC-150HWN1-R(C) | 45.4 | 58.1 | 72.4 | 64+144 | 8.3+18.7 | 4.75+10.8 | 1+1 | 7.50 | 3.97 | 1 | 2.80 | 1.27 | 1 |
| MRC-175HWN1-R(C) | 57.4 | 68.1 | 90.6 | 139 | 16.6 | 9.16 | 2 | 6.60 | 3.03 | 1 | 3.53 | 0.80 | 2 |
| MRC-200HWN1-R(C) | 64.1 | 77.9 | 101.5 | 144 | 18.7 | 10.8 | 2 | 8.90 | 4.35 | 1 | 2.84 | 1.29 | 2 |
| MRC-250HWN1-R(C) | 74.7 | 93.4 | 116.0 | 158 | 20.66 | 12.1 | 2 | 9.70 | 4.40 | 1 | 3.71 | 2.07 | 2 |
| MRC-300HWN1-R(C) | 84.3 | 104.6 | 133.4 | 197 | 24.52 | 13.7 | 2 | 13.60 | 7.40 | 1 | 3.71 | 2.07 | 2 |

Voltage imbalance between phases to be <2%

MCA: Min. Current Amps. (A)

TOCA: Total Over-current Amps. (A)

MFA: Max. Fuse Amps. (A)

STC: Starting Current (A)

RNC: Running Current (A)

IPT: Input (kW)

10. Fan performance data

10.1 Blower drive options

| Power supply | Nominal capacity(ton) | MOTOR | | | | BLOWER | | |
|-------------------------|-----------------------|-----------------|------------------|------|--------------------------|-------------------|---------|--------------------------|
| | | Input Power(Kw) | Output Power(Kw) | RPM | PULLEY PITCH DIA. (INCH) | SPEED RANGE (RPM) | | PULLEY PITCH DIA. (INCH) |
| | | | | | | MINIMUM | MAXIMUM | |
| 380-415V 3N~ 50Hz | 8.5 | 1.79 | 1.5 | 1400 | 4.53~5.25 | 821 | 918 | 8.35 |
| | 10 | 2.02 | 1.5 | 1400 | 4.53~5.25 | 931 | 1016 | 7.48 |
| | 12.5 | 3.53 | 3 | 1420 | 4.53~5.25 | 769 | 871 | 8.82 |
| | 15 | 5.145 | 4 | 1440 | 4.53~5.25 | 949 | 1112 | 7.48 |
| | 17.5 | 4.751 | 5.5 | 1440 | 4.53~5.25 | 927 | 1045 | 9.84 |
| | 20 | 6.738 | 5.5 | 1440 | 4.53~5.25 | 1081 | 1284 | 5.91 |
| | 25 | 6.962 | 7.5 | 1440 | 4.53~5.25 | 925 | 1088 | 7.09 |
| | 30 | 8.203 | 7.5 | 1440 | 4.53~5.25 | 1022 | 1195 | 6.30 |

Example for selection process:

The following data are the rated design points for model 8.5 ton:

Air flow(CFM)=3520CFM, External static pressure(ESP)=75Pa

Fan speed(RPM)=862, Power input(W)=1405, The no. of turns (N) =1

To increase the ESP to 100Pa, but maintain the airflow rate at 3500CFM,

Please follow the steps below:

Step 1: Selection of new desired point.

From the table data, select the point that can meet both of the requirements (ESP = 100Pa and airflow rate(near or equal to) = 3500CFM).

Step 2: Read Fan speed(RPM), Power input(W):

Air flow(CFM)=3483CFM, Fan speed(RPM)=896, Power input(W)=1400

Step 3: Read number of turns for variable pitch pulley.

Similarly, use this RPM value to read the no. of turns (N) by referring to the table of 'Motor Variable Pitch Pulley Data'. The variable pitch pulley for motor shall be adjusted to this 'N' in order to achieve the desired point (ESP = 100Pa and airflow rate =3483cfm).

For instance, from the table, no. of turns (N) =0.25 in order to get 3483CFM. First, adjust the motor pulley to 0 turns. Then, makes 0.25 turns on the pulley. Cross check the dimension 'X', which stands for regulation space of motor pulley. In this case, X =1mm.

10.2 Model: 6.2Ton

| Static pressure(Pa) | | High speed | Middle speed | Low speed |
|---------------------|----------------|-------------|--------------|-----------|
| 0 | Fan speed(RPM) | 1001 | 901 | 810 |
| | Power input(W) | 1665 | 1386 | 1164 |
| | Air flow(CFM) | 3001 | 2647 | 2356 |
| 50 | Fan speed(RPM) | 1063 | 972 | 899 |
| | Power input(W) | 1607 | 1341 | 1133 |
| | Air flow(CFM) | 2909 | 2564 | 2270 |
| 80 | Fan speed(RPM) | 1098 | 1016 | 946 |
| | Power input(W) | 1582 | 1317 | 1120 |
| | Air flow(CFM) | 2825 | 2503 | 2190 |
| 100 | Fan speed(RPM) | 1122 | 1047 | 977 |
| | Power input(W) | 1526 | 1280 | 1079 |
| | Air flow(CFM) | 2759 | 2401 | 2105 |
| 150 | Fan speed(RPM) | 1173 | 1106 | / |
| | Power input(W) | 1452 | 1230 | / |
| | Air flow(CFM) | 2560 | 2250 | / |
| 200 | Fan speed(RPM) | 1219 | 1162 | / |
| | Power input(W) | 1375 | 1182 | / |
| | Air flow(CFM) | 2367 | 2109 | / |
| 250 | Fan speed(RPM) | 1265 | / | / |
| | Power input(W) | 1305 | / | / |
| | Air flow(CFM) | 2182 | / | / |

10.3 Model: 7.5Ton

| Static pressure(Pa) | | High speed | Middle speed | Low speed |
|---------------------|----------------|-------------|--------------|-----------|
| 0 | Fan speed(RPM) | 1035 | 936 | 844 |
| | Power input(W) | 1716 | 1432 | 1197 |
| | Air flow(CFM) | 3074 | 2697 | 2403 |
| 50 | Fan speed(RPM) | 1081 | 991 | 909 |
| | Power input(W) | 1652 | 1409 | 1160 |
| | Air flow(CFM) | 2981 | 2596 | 2284 |
| 80 | Fan speed(RPM) | 1110 | 1026 | 954 |
| | Power input(W) | 1650 | 1360 | 1137 |
| | Air flow(CFM) | 2951 | 2574 | 2223 |
| 100 | Fan speed(RPM) | 1127 | 1051 | 984 |
| | Power input(W) | 1591 | 1377 | 1126 |
| | Air flow(CFM) | 2825 | 2438 | 2146 |
| 150 | Fan speed(RPM) | 1173 | 1110 | / |
| | Power input(W) | 1525 | 1338 | / |
| | Air flow(CFM) | 2657 | 2313 | / |
| 200 | Fan speed(RPM) | 1217 | 1165 | / |
| | Power input(W) | 1449 | 1281 | / |
| | Air flow(CFM) | 2483 | 2187 | / |
| 250 | Fan speed(RPM) | 1263 | / | / |
| | Power input(W) | 1420 | / | / |
| | Air flow(CFM) | 2331 | / | / |

10.4 Model: 8.5Ton

| ESP(Pa) | N | 0 | 0.25 | 0.5 | 0.75 | 1 | 1.25 | 1.5 | 1.75 | 2 |
|---------|----------------|------|------|------|------|-------------|------|------|------|------|
| | X | 0.5 | 1 | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 |
| 0 | Fan speed(RPM) | 896 | 887 | 876 | 866 | 855 | 847 | 839 | 830 | 821 |
| | Power input(W) | 1790 | 1720 | 1710 | 1665 | 1620 | 1560 | 1500 | 1445 | 1390 |
| | Air flow(CFM) | 4320 | 4213 | 4166 | 4130 | 4094 | 4041 | 3988 | 3946 | 3905 |
| 25 | Fan speed(RPM) | 899 | 890 | 878 | 867 | 857 | 849 | 842 | 849 | 823 |
| | Power input(W) | 1710 | 1640 | 1630 | 1590 | 1550 | 1490 | 1430 | 1378 | 1325 |
| | Air flow(CFM) | 4134 | 4035 | 3987 | 3943 | 3899 | 3855 | 3810 | 3761 | 3713 |
| 50 | Fan speed(RPM) | 902 | 893 | 880 | 869 | 858 | 851 | 844 | 851 | 825 |
| | Power input(W) | 1630 | 1560 | 1550 | 1515 | 1480 | 1420 | 1360 | 1310 | 1260 |
| | Air flow(CFM) | 3947 | 3858 | 3808 | 3756 | 3705 | 3669 | 3632 | 3577 | 3521 |
| 75 | Fan speed(RPM) | 904 | 896 | 880 | 871 | 862 | 854 | 847 | 854 | 827 |
| | Power input(W) | 1555 | 1485 | 1467 | 1436 | 1405 | 1345 | 1285 | 1235 | 1185 |
| | Air flow(CFM) | 3770 | 3675 | 3620 | 3570 | 3520 | 3470 | 3420 | 3364 | 3307 |
| 100 | Fan speed(RPM) | 907 | 896 | 885 | 876 | 866 | 858 | 849 | 858 | 828 |
| | Power input(W) | 1470 | 1400 | 1390 | 1360 | 1330 | 1265 | 1200 | 1150 | 1100 |
| | Air flow(CFM) | 3582 | 3483 | 3428 | 3321 | 3215 | 3215 | 3215 | 3154 | 3092 |
| 125 | Fan speed(RPM) | 910 | 900 | 886 | 877 | 869 | 860 | 852 | 860 | 830 |
| | Power input(W) | 1375 | 1310 | 1295 | 1265 | 1235 | 1175 | 1115 | 1065 | 1015 |
| | Air flow(CFM) | 3362 | 3266 | 3206 | 3122 | 3039 | 3005 | 2971 | 2901 | 2831 |
| 150 | Fan speed(RPM) | 913 | 903 | 887 | 879 | 871 | 863 | 854 | 863 | 832 |
| | Power input(W) | 1280 | 1220 | 1200 | 1170 | 1140 | 1085 | 1030 | 980 | 930 |
| | Air flow(CFM) | 3141 | 3048 | 2984 | 2924 | 2864 | 2795 | 2727 | 2649 | 2570 |
| 175 | Fan speed(RPM) | 915 | 906 | 892 | 883 | 874 | 865 | 857 | / | / |
| | Power input(W) | 1170 | 1115 | 1095 | 1068 | 1040 | 945 | 850 | / | / |
| | Air flow(CFM) | 2851 | 2761 | 2683 | 2619 | 2555 | 2325 | 2094 | / | / |
| 200 | Fan speed(RPM) | 918 | 909 | 897 | 887 | 876 | 868 | 859 | / | / |
| | Power input(W) | 1060 | 1010 | 990 | 965 | 940 | 805 | 670 | / | / |
| | Air flow(CFM) | 2560 | 2473 | 2383 | 2315 | 2246 | 1854 | 1462 | / | / |

Notes:

1. Legend: X: Regulation Space of Motor Pulley (mm); N: Number of Turns; ESP: External Static Pressure (Pa);
2. PULLEY PITCH Factory set point: The table, no. of turns (N) =1.5;
3. Bold data is the performance testing set point;
4. Shading data are rated airflow.

10.5 Model: 10Ton

| ESP(Pa) | N | 0 | 0.25 | 0.5 | 0.75 | 1 | 1.25 | 1.5 | 1.75 | 2 |
|---------|----------------|------|------|-------------|------|------|------|------|------|------|
| | X | 0.5 | 1 | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 |
| 0 | Fan speed(RPM) | / | / | / | / | / | / | 962 | 946 | 931 |
| | Power input(W) | / | / | / | / | / | / | 2020 | 1945 | 1870 |
| | Air flow(CFM) | / | / | / | / | / | / | 4571 | 4500 | 4428 |
| 25 | Fan speed(RPM) | / | / | / | / | / | 969 | 964 | 969 | 933 |
| | Power input(W) | / | / | / | / | / | 2010 | 1930 | 1855 | 1780 |
| | Air flow(CFM) | / | / | / | / | / | 4442 | 4398 | 4323 | 4248 |
| 50 | Fan speed(RPM) | / | / | / | / | 977 | 972 | 967 | 972 | 935 |
| | Power input(W) | / | / | / | / | 1990 | 1915 | 1840 | 1765 | 1690 |
| | Air flow(CFM) | / | / | / | / | 4320 | 4272 | 4224 | 4146 | 4067 |
| 75 | Fan speed(RPM) | / | / | / | 981 | 980 | 975 | 970 | 975 | 937 |
| | Power input(W) | / | / | / | 1998 | 1915 | 1843 | 1770 | 1695 | 1620 |
| | Air flow(CFM) | / | / | / | 4214 | 4183 | 4127 | 4072 | 3997 | 3922 |
| 100 | Fan speed(RPM) | / | / | 986 | 984 | 982 | 977 | 972 | 977 | 938 |
| | Power input(W) | / | / | 2000 | 1900 | 1800 | 1730 | 1660 | 1590 | 1520 |
| | Air flow(CFM) | / | / | 4129 | 4052 | 3974 | 3905 | 3835 | 3771 | 3707 |
| 125 | Fan speed(RPM) | / | 989 | 989 | 987 | 985 | 980 | 975 | 980 | 940 |
| | Power input(W) | / | 1980 | 1960 | 1833 | 1705 | 1635 | 1565 | 1495 | 1425 |
| | Air flow(CFM) | / | 3953 | 4065 | 3927 | 3789 | 3719 | 3648 | 3579 | 3509 |
| 150 | Fan speed(RPM) | 1009 | 991 | 991 | 990 | 988 | 983 | 978 | 983 | 942 |
| | Power input(W) | 2050 | 1880 | 1865 | 1738 | 1610 | 1540 | 1470 | 1400 | 1330 |
| | Air flow(CFM) | 3830 | 3778 | 3891 | 3748 | 3605 | 3532 | 3460 | 3386 | 3312 |
| 175 | Fan speed(RPM) | 1011 | 993 | 994 | 992 | 990 | / | / | / | / |
| | Power input(W) | 1945 | 1775 | 1770 | 1638 | 1505 | / | / | / | / |
| | Air flow(CFM) | 3656 | 3586 | 3718 | 3549 | 3381 | / | / | / | / |
| 200 | Fan speed(RPM) | 1012 | 995 | 997 | 995 | 993 | / | / | / | / |
| | Power input(W) | 1840 | 1670 | 1660 | 1530 | 1400 | / | / | / | / |
| | Air flow(CFM) | 3481 | 3394 | 3517 | 3337 | 3157 | / | / | / | / |
| 225 | Fan speed(RPM) | 1014 | 996 | 1000 | / | / | / | / | / | / |
| | Power input(W) | 1725 | 1545 | 1550 | / | / | / | / | / | / |
| | Air flow(CFM) | 3292 | 3148 | 3316 | / | / | / | / | / | / |
| 250 | Fan speed(RPM) | 1016 | 998 | 1002 | / | / | / | / | / | / |
| | Power input(W) | 1610 | 1420 | 1425 | / | / | / | / | / | / |
| | Air flow(CFM) | 3104 | 2902 | 3048 | / | / | / | / | / | / |

Notes:

1. Legend: X: Regulation Space of Motor Pulley (mm); N: Number of Turns; ESP: External Static Pressure (Pa);
2. PULLEY PITCH Factory set point: The table, no. of turns (N) =1.5;
3. Bold data is the performance testing set point;
4. Shading data are rated airflow.

10.6 Model: 12.5Ton

| ESP(Pa) | N | 0 | 0.25 | 0.5 | 0.75 | 1 | 1.25 | 1.5 | 1.75 | 2 | 2.25 | 2.5 |
|---------|----------------|------|------|------|------|-------------|------|------|------|------|------|------|
| | X | 0.5 | 1 | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 | 5 | 5.5 |
| 0 | Fan speed(RPM) | 857 | 849 | 840 | 828 | 816 | 806 | 795 | 784 | 774 | 772 | 769 |
| | Power input(W) | 3530 | 3445 | 3360 | 3225 | 3090 | 3000 | 2910 | 2810 | 2710 | 2620 | 2530 |
| | Air flow(CFM) | 6773 | 6718 | 6662 | 6575 | 6487 | 6395 | 6302 | 6230 | 6158 | 6103 | 6049 |
| 25 | Fan speed(RPM) | 858 | 850 | 841 | 829 | 817 | 807 | 796 | 785 | 775 | 772 | 770 |
| | Power input(W) | 3415 | 3323 | 3230 | 3103 | 2975 | 2878 | 2780 | 2690 | 2600 | 2513 | 2425 |
| | Air flow(CFM) | 6571 | 6503 | 6435 | 6354 | 6272 | 6176 | 6079 | 6004 | 5929 | 5872 | 5815 |
| 50 | Fan speed(RPM) | 859 | 851 | 842 | 830 | 818 | 808 | 797 | 787 | 776 | 773 | 770 |
| | Power input(W) | 3300 | 3200 | 3100 | 2980 | 2860 | 2755 | 2650 | 2570 | 2490 | 2405 | 2320 |
| | Air flow(CFM) | 6368 | 6288 | 6208 | 6133 | 6057 | 5956 | 5856 | 5778 | 5699 | 5641 | 5582 |
| 75 | Fan speed(RPM) | 861 | 852 | 843 | 831 | 819 | 809 | 798 | 788 | 777 | 774 | 771 |
| | Power input(W) | 3175 | 3078 | 2980 | 2868 | 2755 | 2643 | 2530 | 2455 | 2380 | 2278 | 2175 |
| | Air flow(CFM) | 6151 | 6069 | 5987 | 5901 | 5814 | 5711 | 5608 | 5534 | 5461 | 5363 | 5265 |
| 100 | Fan speed(RPM) | 862 | 853 | 844 | 832 | 821 | 810 | 799 | 789 | 778 | 775 | 772 |
| | Power input(W) | 3050 | 2955 | 2860 | 2755 | 2650 | 2530 | 2410 | 2340 | 2270 | 2150 | 2030 |
| | Air flow(CFM) | 5933 | 5850 | 5766 | 5669 | 5571 | 5465 | 5359 | 5291 | 5222 | 5085 | 4948 |
| 125 | Fan speed(RPM) | 863 | 854 | 845 | 833 | 822 | 811 | 800 | 790 | 779 | 776 | 773 |
| | Power input(W) | 2900 | 2800 | 2700 | 2583 | 2465 | 2358 | 2250 | 2183 | 2115 | 1983 | 1850 |
| | Air flow(CFM) | 5645 | 5538 | 5432 | 5361 | 5290 | 5179 | 5067 | 4977 | 4887 | 4694 | 4500 |
| 150 | Fan speed(RPM) | 864 | 855 | 846 | 834 | 823 | 812 | 801 | 791 | 780 | 777 | 774 |
| | Power input(W) | 2800 | 2700 | 2600 | 2475 | 2350 | 2245 | 2140 | 2075 | 2010 | 1860 | 1710 |
| | Air flow(CFM) | 5456 | 5347 | 5238 | 5169 | 5101 | 4978 | 4856 | 4754 | 4652 | 4398 | 4144 |
| 175 | Fan speed(RPM) | 865 | 856 | 847 | 835 | 824 | 813 | 802 | 792 | 781 | 778 | 774 |
| | Power input(W) | 2635 | 2535 | 2435 | 2323 | 2210 | 2103 | 1995 | 1925 | 1855 | 1713 | 1570 |
| | Air flow(CFM) | 5187 | 5066 | 4946 | 4870 | 4794 | 4656 | 4519 | 4397 | 4275 | 4031 | 3788 |
| 200 | Fan speed(RPM) | 866 | 857 | 848 | 836 | 825 | 814 | 804 | 793 | 782 | / | / |
| | Power input(W) | 2470 | 2370 | 2270 | 2170 | 2070 | 1960 | 1850 | 1775 | 1700 | / | / |
| | Air flow(CFM) | 4917 | 4786 | 4654 | 4571 | 4488 | 4335 | 4182 | 4040 | 3898 | / | / |
| 225 | Fan speed(RPM) | 868 | 859 | 849 | 837 | 826 | 815 | 805 | 794 | 783 | / | / |
| | Power input(W) | 2295 | 2203 | 2110 | 2000 | 1890 | 1788 | 1685 | 1608 | 1530 | / | / |
| | Air flow(CFM) | 4575 | 4434 | 4293 | 4187 | 4082 | 3922 | 3763 | 3622 | 3481 | / | / |
| 250 | Fan speed(RPM) | 869 | 860 | 850 | 838 | 827 | 816 | 806 | 795 | 784 | / | / |
| | Power input(W) | 2120 | 2035 | 1950 | 1830 | 1710 | 1615 | 1520 | 1440 | 1360 | / | / |
| | Air flow(CFM) | 4232 | 4082 | 3932 | 3804 | 3676 | 3510 | 3344 | 3204 | 3064 | / | / |
| 275 | Fan speed(RPM) | 870 | 861 | 851 | 839 | 828 | / | / | / | / | / | / |
| | Power input(W) | 1950 | 1855 | 1760 | 1675 | 1590 | / | / | / | / | / | / |
| | Air flow(CFM) | 3816 | 3674 | 3533 | 3423 | 3314 | / | / | / | / | / | / |

Notes:

1. Legend: X: Regulation Space of Motor Pulley (mm); N: Number of Turns; ESP: External Static Pressure (Pa);
2. PULLEY PITCH Factory set point: The table, no. of turns (N) =1.5;
3. Bold data is the performance testing set point;
4. Shading data are rated airflow.

10.7 Model: 15Ton

| ESP(Pa) | N | 0 | 0.25 | 0.5 | 0.75 | 1 | 1.25 | 1.5 | 1.75 | 2 |
|---------|----------------|------|------|------|-------------|------|------|------|------|------|
| | X | 0.5 | 1 | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 |
| 0 | Fan speed(RPM) | / | / | 1008 | 999 | 989 | 979 | 969 | 959 | 949 |
| | Power input(W) | / | / | 5146 | 4968 | 4790 | 4575 | 4360 | 4155 | 3950 |
| | Air flow(CFM) | / | / | 7928 | 7867 | 7805 | 7686 | 7566 | 7452 | 7338 |
| 25 | Fan speed(RPM) | / | / | 1014 | 1003 | 991 | 983 | 974 | 964 | 953 |
| | Power input(W) | / | / | 5043 | 4824 | 4605 | 4418 | 4230 | 4025 | 3820 |
| | Air flow(CFM) | / | / | 7791 | 7691 | 7592 | 7473 | 7353 | 7239 | 7124 |
| 50 | Fan speed(RPM) | / | 1022 | 1020 | 1006 | 993 | 986 | 979 | 968 | 957 |
| | Power input(W) | / | 4954 | 4940 | 4680 | 4420 | 4260 | 4100 | 3895 | 3690 |
| | Air flow(CFM) | / | 7700 | 7653 | 7516 | 7379 | 7259 | 7139 | 7025 | 6910 |
| 75 | Fan speed(RPM) | 1031 | 1026 | 1022 | 1009 | 995 | 989 | 982 | 971 | 960 |
| | Power input(W) | 4870 | 4810 | 4750 | 4495 | 4240 | 4088 | 3935 | 3745 | 3555 |
| | Air flow(CFM) | 7622 | 7529 | 7436 | 7313 | 7191 | 7048 | 6904 | 6790 | 6675 |
| 100 | Fan speed(RPM) | 1035 | 1028 | 1021 | 1008 | 995 | 988 | 982 | 971 | 959 |
| | Power input(W) | 4770 | 4665 | 4560 | 4310 | 4060 | 3915 | 3770 | 3595 | 3420 |
| | Air flow(CFM) | 7475 | 7347 | 7219 | 7111 | 7002 | 6836 | 6669 | 6554 | 6439 |
| 125 | Fan speed(RPM) | 1050 | 1044 | 1039 | 1026 | 1013 | 1006 | 998 | 990 | 981 |
| | Power input(W) | 4510 | 4440 | 4370 | 4123 | 3875 | 3760 | 3645 | 3465 | 3285 |
| | Air flow(CFM) | 7113 | 7046 | 6979 | 6844 | 6708 | 6571 | 6434 | 6297 | 6159 |
| 150 | Fan speed(RPM) | 1060 | 1056 | 1052 | 1039 | 1026 | 1021 | 1015 | 1005 | 995 |
| | Power input(W) | 4350 | 4290 | 4230 | 4005 | 3780 | 3695 | 3610 | 3410 | 3210 |
| | Air flow(CFM) | 6899 | 6863 | 6828 | 6679 | 6531 | 6411 | 6291 | 6134 | 5976 |
| 175 | Fan speed(RPM) | 1070 | 1065 | 1060 | 1049 | 1039 | 1032 | 1025 | 1017 | 1008 |
| | Power input(W) | 4170 | 4078 | 3985 | 3808 | 3630 | 3518 | 3405 | 3248 | 3090 |
| | Air flow(CFM) | 6658 | 6609 | 6559 | 6419 | 6279 | 6161 | 6043 | 5859 | 5675 |
| 200 | Fan speed(RPM) | 1082 | 1074 | 1067 | 1059 | 1051 | 1044 | 1036 | 1028 | 1020 |
| | Power input(W) | 3990 | 3865 | 3740 | 3610 | 3480 | 3340 | 3200 | 3085 | 2970 |
| | Air flow(CFM) | 6418 | 6354 | 6291 | 6159 | 6027 | 5911 | 5794 | 5584 | 5375 |
| 225 | Fan speed(RPM) | 1089 | 1082 | 1074 | 1065 | 1056 | 1048 | 1040 | 1033 | 1027 |
| | Power input(W) | 3855 | 3728 | 3600 | 3455 | 3310 | 3180 | 3050 | 2928 | 2805 |
| | Air flow(CFM) | 6194 | 6108 | 6022 | 5879 | 5736 | 5600 | 5464 | 5269 | 5075 |
| 250 | Fan speed(RPM) | 1097 | 1089 | 1082 | 1072 | 1061 | 1053 | 1044 | 1038 | 1033 |
| | Power input(W) | 3720 | 3590 | 3460 | 3300 | 3140 | 3020 | 2900 | 2770 | 2640 |
| | Air flow(CFM) | 5971 | 5862 | 5754 | 5600 | 5446 | 5289 | 5133 | 4954 | 4776 |
| 275 | Fan speed(RPM) | 1104 | 1095 | 1086 | 1076 | 1065 | / | / | / | / |
| | Power input(W) | 3595 | 3438 | 3280 | 3115 | 2950 | / | / | / | / |
| | Air flow(CFM) | 5705 | 5585 | 5464 | 5308 | 5151 | / | / | / | / |
| 300 | Fan speed(RPM) | 1112 | / | / | / | / | / | / | / | / |
| | Power input(W) | 3470 | / | / | / | / | / | / | / | / |
| | Air flow(CFM) | 5439 | / | / | / | / | / | / | / | / |
| 325 | Fan speed(RPM) | 1112 | / | / | / | / | / | / | / | / |
| | Power input(W) | 3470 | / | / | / | / | / | / | / | / |
| | Air flow(CFM) | 5439 | / | / | / | / | / | / | / | / |

Notes:

- Legend: X: Regulation Space of Motor Pulley (mm); N: Number of Turns; ESP: External Static Pressure (Pa);
- PULLEY PITCH Factory set point: The table, no. of turns (N) =1.5;
- Bold data is the performance testing set point;
- Shading data are rated airflow.

10.8 Model: 17.5Ton

| ESP(Pa) | N | 0 | 0.25 | 0.5 | 0.75 | 1 | 1.25 | 1.5 | 1.75 | 2 | 2.25 | 2.5 |
|---------|----------------|------|------|------|------|------|------|-------------|------|------|------|------|
| | X | 0.5 | 1 | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 | 5 | 5.5 |
| 0 | Fan speed(RPM) | / | / | 994 | 987 | 980 | 971 | 961 | 953 | 944 | 936 | 927 |
| | Power input(W) | / | / | 4751 | 4857 | 4962 | 4643 | 4323 | 4216 | 4109 | 3960 | 3811 |
| | Air flow(CFM) | / | / | 9837 | 9896 | 9955 | 9722 | 9489 | 9498 | 9507 | 9346 | 9185 |
| 25 | Fan speed(RPM) | / | / | 994 | 988 | 981 | 972 | 963 | 954 | 946 | 937 | 928 |
| | Power input(W) | / | / | 4580 | 4683 | 4787 | 4494 | 4202 | 4078 | 3955 | 3809 | 3664 |
| | Air flow(CFM) | / | / | 9575 | 9635 | 9695 | 9506 | 9317 | 9264 | 9211 | 9041 | 8871 |
| 50 | Fan speed(RPM) | 1010 | 1003 | 995 | 988 | 982 | 973 | 965 | 956 | 947 | 939 | 930 |
| | Power input(W) | 4581 | 4495 | 4408 | 4510 | 4612 | 4346 | 4080 | 3940 | 3800 | 3659 | 3517 |
| | Air flow(CFM) | 9591 | 9451 | 9312 | 9373 | 9434 | 9290 | 9145 | 9030 | 8915 | 8736 | 8557 |
| 75 | Fan speed(RPM) | 1012 | 1004 | 997 | 990 | 983 | 975 | 966 | 958 | 949 | 940 | 931 |
| | Power input(W) | 4392 | 4313 | 4235 | 4338 | 4442 | 4181 | 3920 | 3777 | 3635 | 3495 | 3356 |
| | Air flow(CFM) | 9307 | 9153 | 8998 | 9067 | 9136 | 8999 | 8861 | 8729 | 8597 | 8421 | 8246 |
| 100 | Fan speed(RPM) | 1013 | 1005 | 998 | 991 | 984 | 976 | 968 | 959 | 951 | 942 | 933 |
| | Power input(W) | 4202 | 4132 | 4061 | 4166 | 4271 | 4015 | 3759 | 3614 | 3469 | 3332 | 3194 |
| | Air flow(CFM) | 9024 | 8854 | 8683 | 8761 | 8839 | 8708 | 8578 | 8429 | 8279 | 8107 | 7934 |
| 125 | Fan speed(RPM) | 1015 | 1007 | 999 | 992 | 985 | 977 | 969 | 961 | 952 | 943 | 934 |
| | Power input(W) | 4005 | 3934 | 3864 | 3967 | 4071 | 3810 | 3550 | 3404 | 3258 | 3127 | 2996 |
| | Air flow(CFM) | 8684 | 8510 | 8336 | 8421 | 8507 | 8350 | 8194 | 8027 | 7860 | 7684 | 7507 |
| 150 | Fan speed(RPM) | 1018 | 1009 | 1000 | 994 | 987 | 979 | 971 | 962 | 954 | 945 | 935 |
| | Power input(W) | 3807 | 3737 | 3667 | 3769 | 3870 | 3605 | 3340 | 3193 | 3046 | 2922 | 2797 |
| | Air flow(CFM) | 8345 | 8167 | 7989 | 8082 | 8175 | 7992 | 7809 | 7625 | 7441 | 7261 | 7081 |
| 175 | Fan speed(RPM) | 1019 | 1011 | 1002 | 995 | 988 | 980 | 972 | 964 | 955 | 946 | 937 |
| | Power input(W) | 3570 | 3509 | 3448 | 3548 | 3649 | 3374 | 3100 | 2950 | 2801 | 2682 | 2564 |
| | Air flow(CFM) | 7899 | 7719 | 7539 | 7648 | 7757 | 7518 | 7279 | 7093 | 6907 | 6715 | 6522 |
| 200 | Fan speed(RPM) | 1021 | 1012 | 1004 | 998 | 992 | 983 | 974 | 965 | 957 | 947 | 938 |
| | Power input(W) | 3332 | 3281 | 3229 | 3328 | 3427 | 3143 | 2859 | 2707 | 2555 | 2443 | 2330 |
| | Air flow(CFM) | 7454 | 7272 | 7090 | 7215 | 7339 | 7044 | 6748 | 6561 | 6374 | 6169 | 5963 |
| 225 | Fan speed(RPM) | 1033 | 1019 | 1006 | 1000 | 994 | / | / | / | / | / | / |
| | Power input(W) | 3042 | 3135 | 3229 | 3128 | 3026 | / | / | / | / | / | / |
| | Air flow(CFM) | 6817 | 6953 | 7090 | 6696 | 6303 | / | / | / | / | / | / |
| 250 | Fan speed(RPM) | 1045 | / | / | / | / | / | / | / | / | / | / |
| | Power input(W) | 2751 | / | / | / | / | / | / | / | / | / | / |
| | Air flow(CFM) | 6180 | / | / | / | / | / | / | / | / | / | / |

Notes:

1. Legend: X: Regulation Space of Motor Pulley (mm); N: Number of Turns; ESP: External Static Pressure (Pa);
2. PULLEY PITCH Factory set point: The table, no. of turns (N) =1.5;
3. Bold data is the performance testing set point;
4. Shading data are rated airflow.

10.9 Model: 20Ton


| ESP (Pa) | N | 0 | 0.25 | 0.5 | 0.75 | 1 | 1.25 | 1.5 | 1.75 | 2 | 2.25 | 2.5 | 2.75 | 3 |
|----------|----------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------------|
| | X | 0.5 | 1 | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 | 5 | 5.5 | 6 | 6.5 |
| 0 | Fan speed(RPM) | / | / | / | / | 1194 | 1181 | 1168 | 1154 | 1140 | 1127 | 1113 | 1098 | 1081 |
| | Power input(W) | / | / | / | / | 6951 | 6710 | 6468 | 6266 | 6063 | 5831 | 5599 | 5422 | 5188 |
| | Air flow(CFM) | / | / | / | / | 11210 | 11104 | 10997 | 10872 | 10746 | 10623 | 10499 | 10306 | 10078 |
| 25 | Fan speed(RPM) | / | / | / | / | 1195 | 1182 | 1169 | 1155 | 1141 | 1128 | 1114 | 1100 | 1083 |
| | Power input(W) | / | / | / | / | 6756 | 6531 | 6306 | 6103 | 5901 | 5671 | 5442 | 5255 | 5057 |
| | Air flow(CFM) | / | / | / | / | 10982 | 10890 | 10798 | 10668 | 10539 | 10398 | 10258 | 10068 | 9892 |
| 50 | Fan speed(RPM) | / | / | / | 1214 | 1196 | 1183 | 1170 | 1156 | 1142 | 1129 | 1115 | 1101 | 1084 |
| | Power input(W) | / | / | / | 6944 | 6561 | 6352 | 6143 | 5941 | 5738 | 5512 | 5285 | 5088 | 4926 |
| | Air flow(CFM) | / | / | / | 10877 | 10754 | 10676 | 10599 | 10465 | 10332 | 10174 | 10016 | 9829 | 9705 |
| 75 | Fan speed(RPM) | / | / | / | 1214 | 1197 | 1184 | 1171 | 1157 | 1143 | 1130 | 1116 | 1102 | 1085 |
| | Power input(W) | / | / | / | 6738 | 6390 | 6180 | 5970 | 5754 | 5539 | 5328 | 5118 | 5069 | 4748 |
| | Air flow(CFM) | / | / | / | 10628 | 10540 | 10453 | 10367 | 10207 | 10047 | 9898 | 9749 | 9807 | 9403 |
| 100 | Fan speed(RPM) | / | 1240 | 1228 | 1215 | 1198 | 1185 | 1172 | 1158 | 1145 | 1131 | 1117 | 1103 | 1087 |
| | Power input(W) | / | 6941 | 6765 | 6532 | 6218 | 6008 | 5797 | 5568 | 5339 | 5145 | 4950 | 5049 | 4570 |
| | Air flow(CFM) | / | 10582 | 10491 | 10378 | 10326 | 10230 | 10135 | 9948 | 9761 | 9622 | 9483 | 9785 | 9102 |
| 125 | Fan speed(RPM) | / | 1241 | 1230 | 1215 | 1199 | 1186 | 1173 | 1159 | 1146 | 1131 | 1117 | 1105 | 1091 |
| | Power input(W) | / | 6753 | 6659 | 6367 | 6068 | 5866 | 5663 | 5441 | 5218 | 5013 | 4808 | 4570 | 4351 |
| | Air flow(CFM) | / | 10357 | 10349 | 10170 | 10113 | 10017 | 9922 | 9753 | 9584 | 9435 | 9285 | 9024 | 8815 |
| 150 | Fan speed(RPM) | 1258 | 1242 | 1230 | 1216 | 1202 | 1189 | 1175 | 1162 | 1149 | 1134 | 1120 | 1105 | 1091 |
| | Power input(W) | 6736 | 6565 | 6360 | 6158 | 5820 | 5611 | 5401 | 5180 | 4958 | 4769 | 4579 | 4327 | 4141 |
| | Air flow(CFM) | 10287 | 10132 | 10049 | 9952 | 9818 | 9692 | 9566 | 9395 | 9224 | 9069 | 8915 | 8599 | 8418 |
| 175 | Fan speed(RPM) | 1261 | 1244 | 1232 | 1218 | 1204 | 1190 | 1177 | 1163 | 1149 | 1135 | 1121 | 1106 | 1093 |
| | Power input(W) | 6511 | 6332 | 6169 | 5929 | 5607 | 5391 | 5175 | 4953 | 4731 | 4545 | 4358 | 4107 | 3925 |
| | Air flow(CFM) | 10042 | 9864 | 9794 | 9650 | 9524 | 9377 | 9231 | 9046 | 8861 | 8699 | 8537 | 8243 | 8045 |
| 200 | Fan speed(RPM) | 1263 | 1245 | 1233 | 1221 | 1205 | 1192 | 1179 | 1164 | 1150 | 1136 | 1123 | 1106 | 1094 |
| | Power input(W) | 6285 | 6099 | 5977 | 5700 | 5394 | 5172 | 4949 | 4727 | 4504 | 4321 | 4137 | 3887 | 3709 |
| | Air flow(CFM) | 9798 | 9597 | 9540 | 9347 | 9230 | 9063 | 8896 | 8697 | 8497 | 8328 | 8158 | 7887 | 7672 |
| 225 | Fan speed(RPM) | 1264 | 1248 | 1235 | 1222 | 1207 | 1194 | 1181 | 1166 | 1152 | 1138 | 1124 | 1110 | 1096 |
| | Power input(W) | 6046 | 5871 | 5696 | 5451 | 5160 | 4923 | 4686 | 4461 | 4237 | 4049 | 3861 | 3624 | 3433 |
| | Air flow(CFM) | 9505 | 9301 | 9183 | 9019 | 8877 | 8693 | 8508 | 8291 | 8074 | 7871 | 7669 | 7387 | 7138 |
| 250 | Fan speed(RPM) | 1265 | 1251 | 1237 | 1224 | 1209 | 1196 | 1183 | 1169 | 1154 | 1140 | 1126 | 1113 | 1099 |
| | Power input(W) | 5807 | 5643 | 5415 | 5201 | 4925 | 4674 | 4422 | 4196 | 3969 | 3777 | 3585 | 3361 | 3157 |
| | Air flow(CFM) | 9212 | 9004 | 8826 | 8691 | 8524 | 8322 | 8120 | 7885 | 7650 | 7415 | 7180 | 6887 | 6605 |
| 275 | Fan speed(RPM) | 1267 | 1253 | 1239 | 1226 | 1211 | 1198 | 1185 | 1171 | 1157 | 1144 | 1130 | 1117 | 1094 |
| | Power input(W) | 5523 | 5350 | 5120 | 4872 | 4585 | 4322 | 4059 | 3812 | 3564 | 3331 | 3098 | 2800 | 2662 |
| | Air flow(CFM) | 8831 | 8594 | 8380 | 8204 | 8010 | 7740 | 7470 | 7173 | 6876 | 6487 | 6099 | 5562 | 5395 |
| 300 | Fan speed(RPM) | 1269 | 1254 | 1242 | 1228 | 1213 | 1201 | 1188 | 1174 | 1160 | 1147 | 1134 | 1120 | 1088 |
| | Power input(W) | 5238 | 5056 | 4825 | 4542 | 4245 | 3971 | 3696 | 3428 | 3159 | 2885 | 2611 | 2239 | 2167 |
| | Air flow(CFM) | 8450 | 8184 | 7933 | 7717 | 7495 | 7157 | 6819 | 6460 | 6102 | 5560 | 5018 | 4237 | 4186 |
| 325 | Fan speed(RPM) | 1272 | 1258 | 1245 | 1233 | 1218 | 1206 | 1193 | / | / | / | / | / | / |
| | Power input(W) | 4892 | 4650 | 4334 | 3987 | 3707 | 3334 | 2961 | / | / | / | / | / | / |
| | Air flow(CFM) | 7955 | 7559 | 7136 | 6775 | 6406 | 5820 | 5234 | / | / | / | / | / | / |
| 350 | Fan speed(RPM) | 1276 | 1262 | 1248 | 1235 | 1223 | / | / | / | / | / | / | / | / |
| | Power input(W) | 4546 | 4243 | 3842 | 3731 | 3169 | / | / | / | / | / | / | / | / |
| | Air flow(CFM) | 7459 | 6935 | 6339 | 6285 | 5318 | / | / | / | / | / | / | / | / |
| 375 | Fan speed(RPM) | 1280 | 1267 | 1254 | / | / | / | / | / | / | / | / | / | / |
| | Power input(W) | 3982 | 3457 | 3371 | / | / | / | / | / | / | / | / | / | / |
| | Air flow(CFM) | 6465 | 5433 | 5387 | / | / | / | / | / | / | / | / | / | / |
| 400 | Fan speed(RPM) | 1284 | / | / | / | / | / | / | / | / | / | / | / | / |
| | Power input(W) | 3417 | / | / | / | / | / | / | / | / | / | / | / | / |
| | Air flow(CFM) | 5471 | / | / | / | / | / | / | / | / | / | / | / | / |

Notes:


- Legend: X: Regulation Space of Motor Pulley (mm); N: Number of Turns; ESP: External Static Pressure (Pa);
- PULLEY PITCH Factory set point: The table, no. of turns (N) =1.5;
- Bold data is the performance testing set point;
- Shading data are rated airflow.

11. Refrigerant Cycle Diagram

11.1 6.2&7.5 ton:
Cooling only type

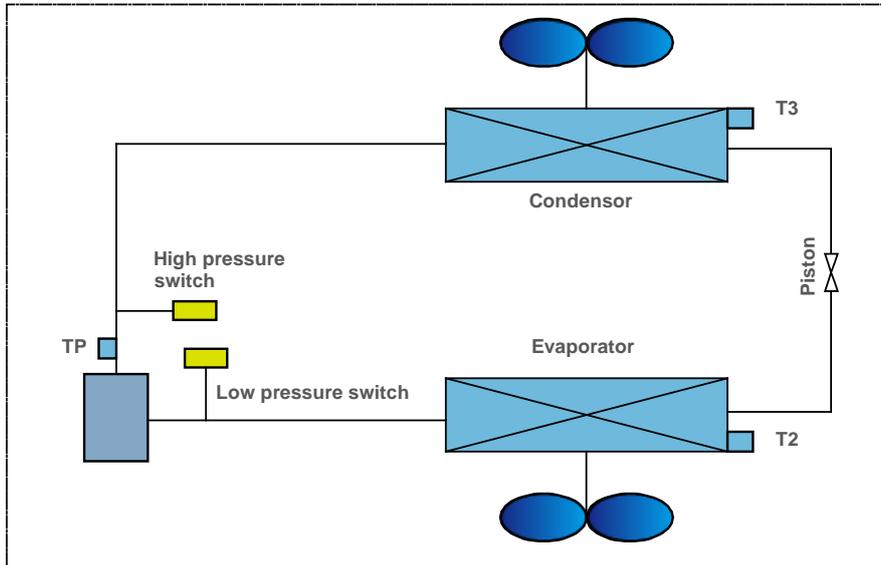

Heat pump type:

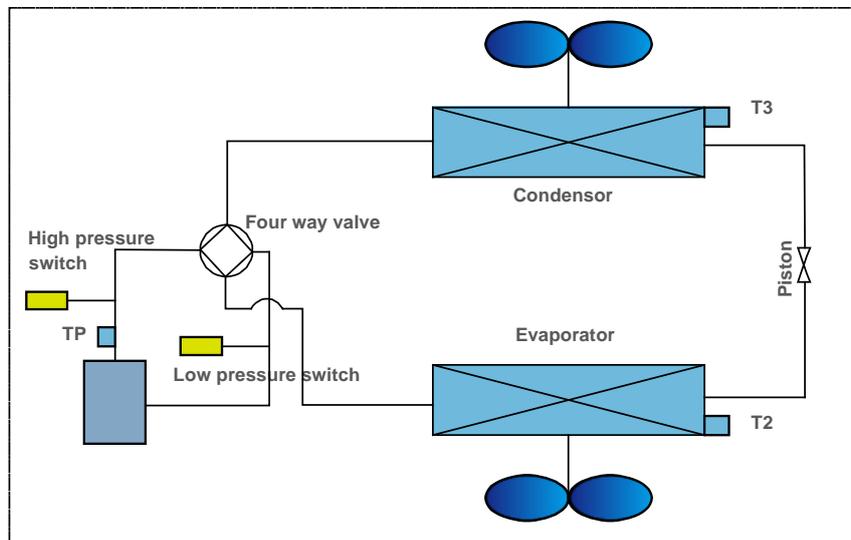


TP: Compressor discharge temperature sensor in system

T2: Indoor coil temperature sensor in system


T3: Outdoor coil temperature sensor in system

11.2 8.5,10,12.5,15,17.5&20 ton:


Cooling only type:

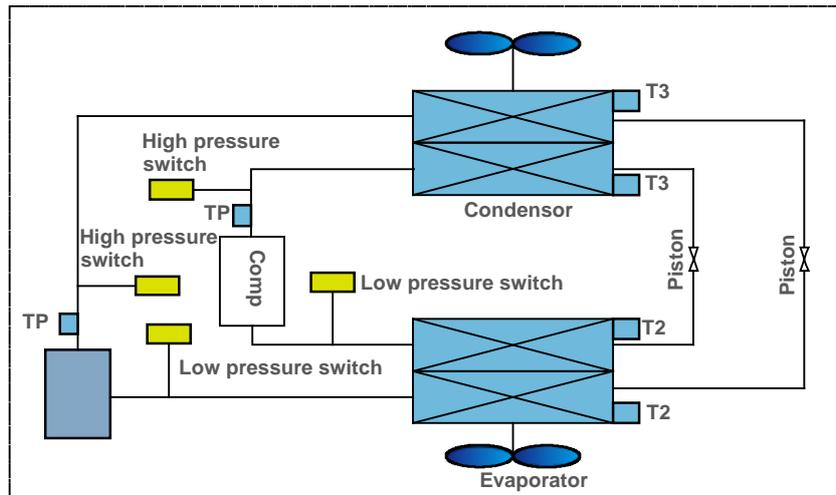


Heat pump type

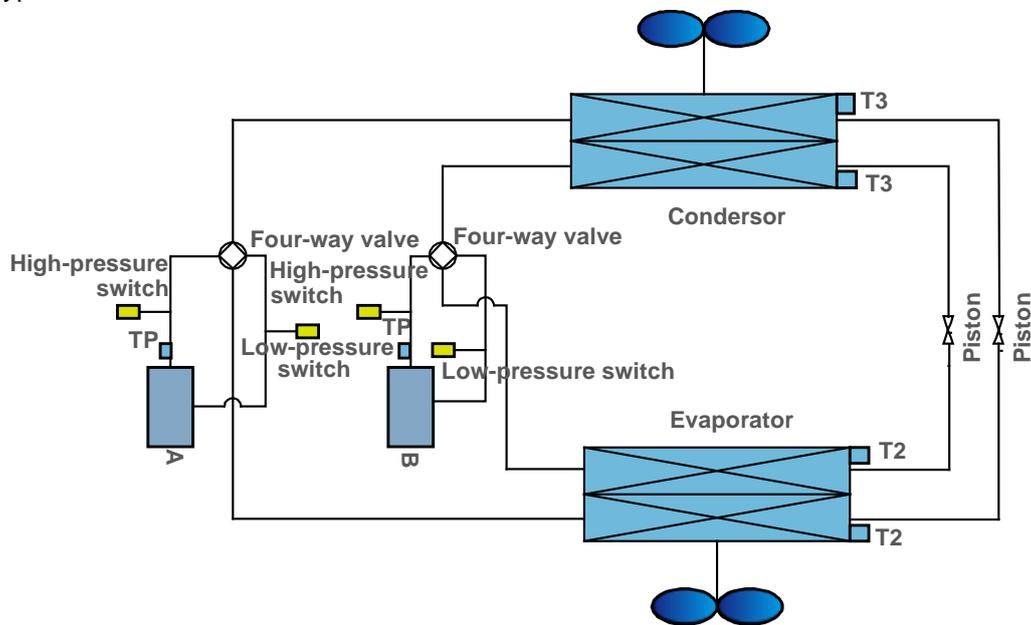

11.3 25&30 ton:
Cooling only type

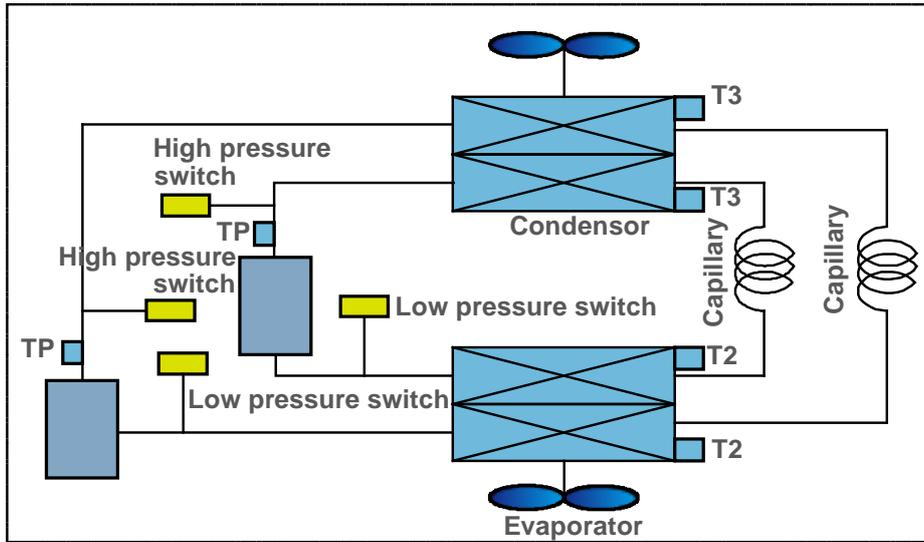

Heat pump type

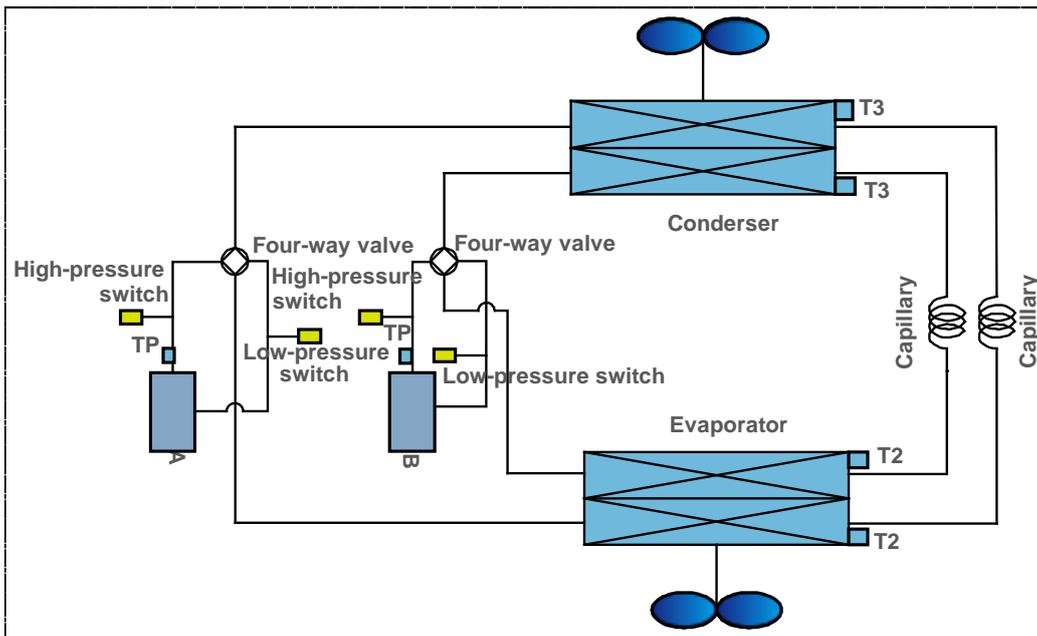


TP: Compressor discharge temperature sensor in system A and B

T2: Indoor coil temperature sensor in system A and B


T3: Outdoor coil temperature sensor in system A and B

12. Operation Limit

12.2 T1 application

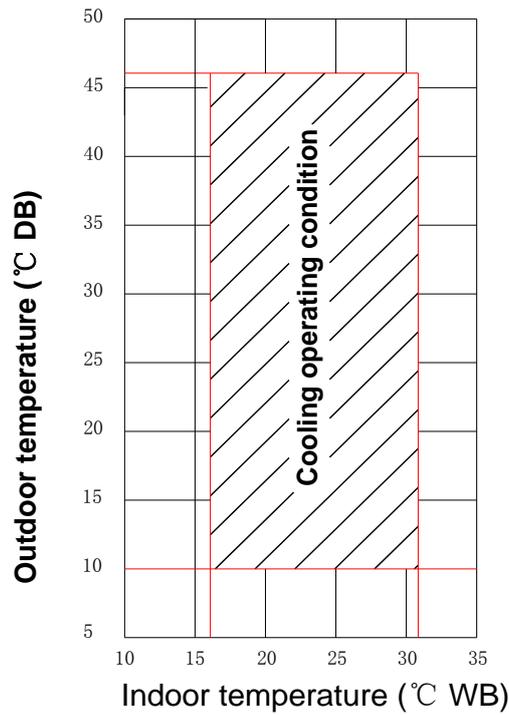

| Mode | Temperature | Outdoor temperature | Indoor temperature |
|--------------|-------------|---------------------|--------------------|
| Cooling mode | | 10°C ~ 46°C | 17°C ~ 31°C |

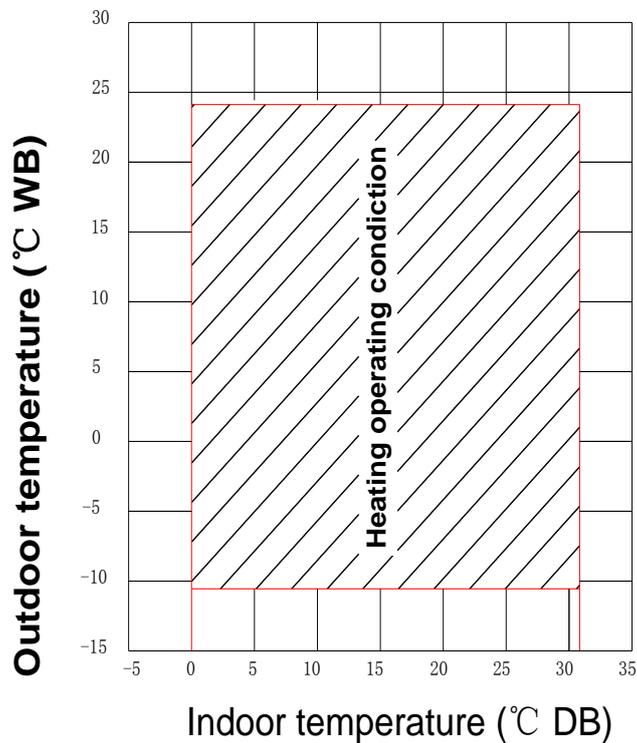

| Mode | Temperature | Outdoor temperature | Indoor temperature |
|--------------|-------------|---------------------|--------------------|
| Heating mode | | -9.4°C ~ 24°C | 0°C ~ 31°C |

Note:


Room relative humidity less than 80% . If the unit operates in excess of this figure, the surface of the unit may attract condensation.

13. Installation

13.1 Lifting

Rigging cables should have adequate capability to resist 3 times weight of unit. Before lift, please check and ensure that hooks are holding tightly to unit and lifting angles are no less than 60°.


Cloth material or hard-paper should be padded in the contact place between unit and rigging cable. Rigging cable should be entwined a round at the hook for prevent danger by cable slip because of weight unbalance. During lifting, anyone forbidden lingering under the lifting unit.

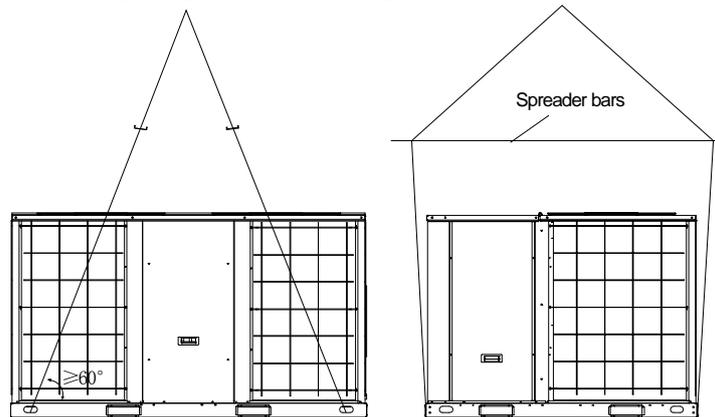

13.2 Service Space

1. The recommended clearances for single-unit installations are illustrated in following *Fig.*

These minimum requirements are not only an important consideration when determining unit placement, but they are also essential to ensure adequate serviceability, maximum capacity, and peak operating efficiency. 2. Any reduction of the unit clearances indicated in these illustrations may result in condenser coil starvation or the recirculation of warm condenser air. Actual clearances which appear to be inadequate should be reviewed with a local engineer.

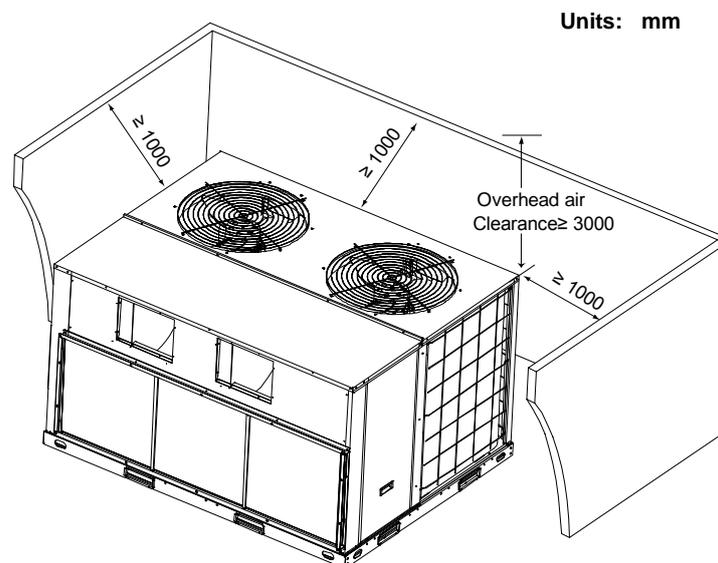


13.3 Rooftop -- units

For roof top applications using a field fabricated frame and ducts, according to the following procedure:

- 1) The frame must be located and secured by bolting or welding to the roof. Flashing is required.
- 2) The hole in the roof must be prepared in advance of installing the unit.
- 3) Secure the ducts to the roof.

- 4) Place the unit on the frame or roof curb.
- 5) Secure the unit to the frame or roof curb.
- 6) Insulate any ductwork outside of the structure with at least two (2) inches of insulation and then weatherproof. There must be a weatherproof seal where the duct enters the structure.
- 7) Complete the installation according to the instructions.

Typical rooftop application with frame:

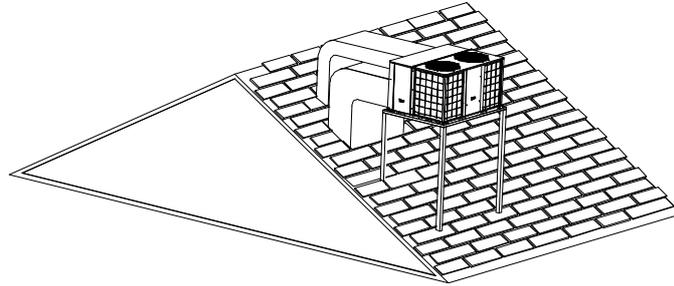


13.4 Ground Level -- Horizontal Units

For ground level installations, the unit should be positioned on a pad the size of the unit or larger. The unit must be level on the pad. The pad must not come in contact with the structure. Be sure the outdoor portion of the supply and return air ducts are as short as possible.


Installation according to the following procedure:

- 1) Place the unit on the pad.
- 2) Attach the supply and return air ducts to the unit.
- 3) Insulate any ductwork outside of the structure with at least 2 inches of insulation and weatherproof. There must be a weatherproof seal where the duct enters the structure.
- 4) Complete the installation according to the instructions.

Typical ground level application:

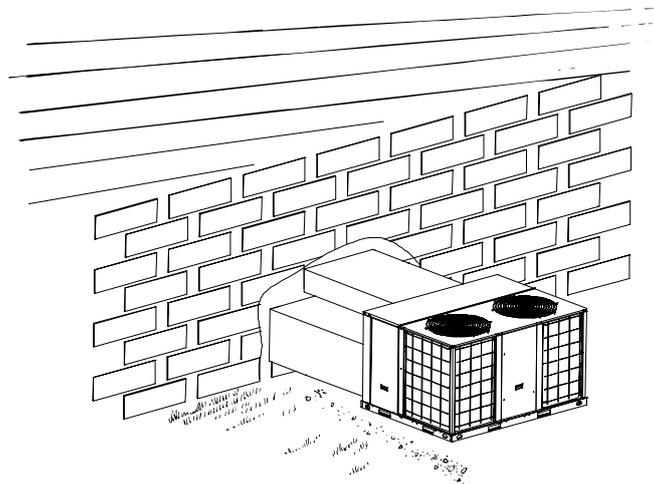

13.5 Installation of condensate drain piping

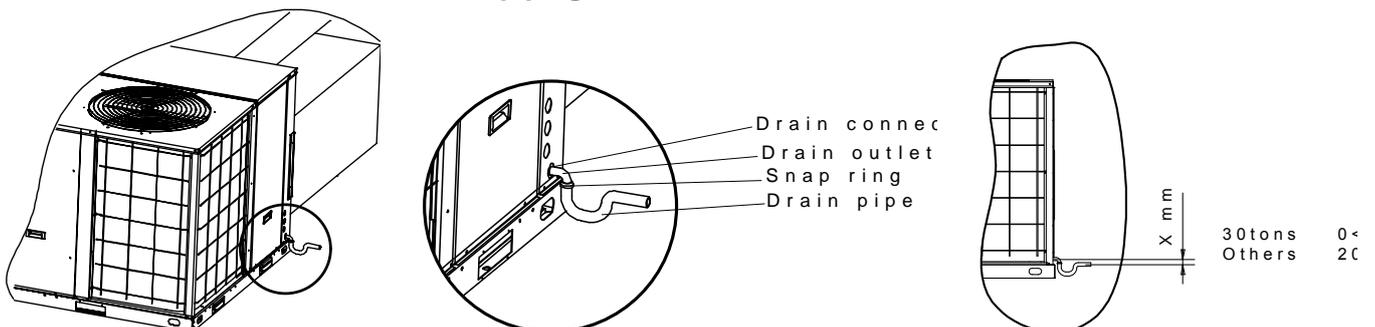

13.6 Ductwork


1. Attaching horizontal ductwork to unit

1) All conditioned air ductwork should be insulated to minimize heating and cooling duct losses. Use a minimum of two inches of insulation with a vapor barrier. The outside ductwork must be weatherproofed between the unit and the building.

2) When attaching ductwork to a horizontal unit, provide a flexible watertight connection to prevent noise transmission from the unit to the ducts. The flexible connection must be indoors and made out of heavy canvas.

Note:

Do not draw the canvas taut between the solid ducts.

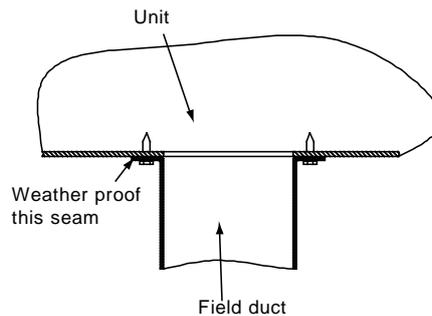

13.7 Wiring provision

Field wiring

The units are internally wired at the factory according to generally accepted electrical technology.

Required field wiring

Main power wiring to the unit control wiring between the control center and the unit, and earth wiring are required in the field.

Required components

The following components are required: main power fuse, conduit coupling, and field supplied room thermostat.

Wire and fuse size selection for main power source.

Wire and fuse size should be selected in accordance with national standard, taking the designed maximum current shall be the total of the compressor maximum current, condenser fan motor current and evaporator fan motor current (refer to "electrical data").

Wire size between room thermostat and unit.

The wire size between the room thermostat and the unit should be determined according to the following table, because the 24V power source is applied to the control circuit.

| | Wiring length between room thermostat and unit(one way) | | | | |
|-------------------------------------|---|-----|------|------|-----|
| | 10m | 15m | 20m | 30m | 40m |
| Minimum wire size(mm ²) | 0.5 | 0.5 | 0.75 | 0.75 | 1.0 |

14. Wired Controller

14.1 Standard wired controller: KJR-12B/DP (T)-E



KJR-12B/DP (T)-E

1. SAFETY PRECAUTIONS

The following contents are stated on the product and the operation manual, including usage, precautions against personal harm and property loss, and the methods of using the product correctly and safely. After fully understanding the following contents (identifiers and icons), read the text body and observe the following rules.

Identifier description

| Identifier | Meaning |
|--|---|
| Warning | Means improper handling may lead to personal death or severe injury. |
| Caution | Means improper handling may lead to personal injury or property loss. |
| [Note]: 1. "Harm" means injury, burn and electric shock which need long-term treatment but need no hospitalization 2. "Property loss" means loss of properties and materials. | |

■ Icon description

| Icon | Meaning |
|------|--|
| | It indicates forbidding. The forbidden subject-matter is indicated in the icon or by images or characters aside. |
| | It indicates compulsory implementation. The compulsory subject-matter is indicated in the icon or by images or characters aside. |

Warning

| | | |
|--|-----------------------|---|
| | Delegate installation | Please entrust the distributor or professionals to install the unit. The installers must have the relevant know-how. Improper installation performed by the user without permission may cause fire, electric shock, personal injury or water leakage. |
|--|-----------------------|---|

| | | |
|--|--------|--|
| | Forbid | Do not spray flammable aerosol to the wire controller directly. Otherwise, fire may occur. |
| | Forbid | Do not operate with wet hands or let water enter the wire controller. Otherwise, electric shock may occur. |

2. SUMMARIZE

Usage condition:


- ①. Power supply: 5V DC.
- ②. Operation temperature: -15°C-+43°C.
- ③. Operation humidity: 40%-90%, RH.

3. FUNCTION SUMMARY

Main function:

- ①. Connecting to indoor unit by A, B, C, D, E terminal;
- ②. Button setting action mode.
- ③. LCD display.
- ④. Timer for rest time.

4. NAME AND FUNCTION OF INDICATORS ON THE CONTROLLER

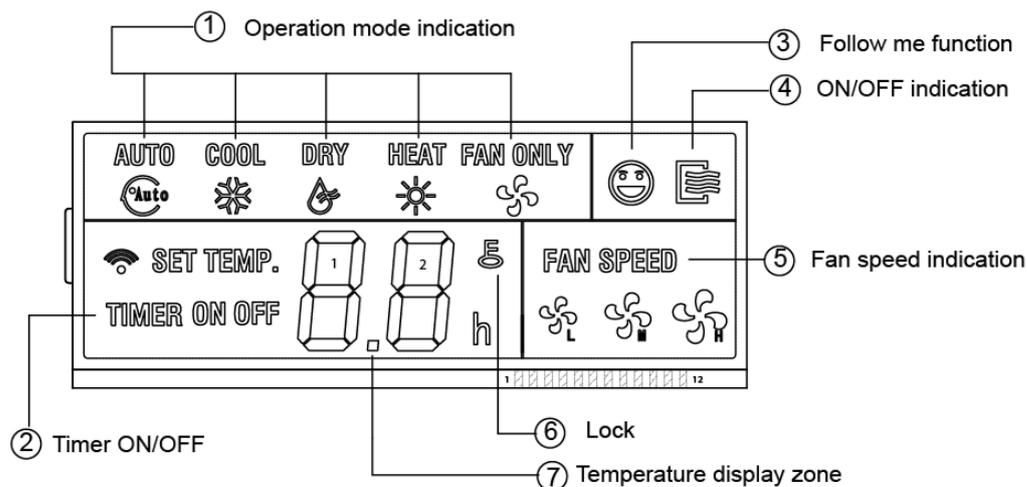

① Operation mode indication:

When press " MODE " button, the following mode can be selected in circle. Auto→Cool →Dry→Heat→Fan only→Auto. For cooling only model,heat mode is skipped.

② Timer :

When adjust setting on time or only on time is set, the "ON" is lighted.

When adjust setting off time or only off time is set, the "OFF" is lighted. If both 'on' and 'off' timer are set, both the "ON" and "OFF" are lighted.

③ Follow me function:

There is a temperature sensor inside the wire controller, after setting temperature, it will compare the two temperatures, and the space of wire controller will be the same as setting temperature. It is available under cooling, heating, auto mode.

④ ON/OFF indication :

When it is on, the icon display, otherwise it is extinguished.

⑤ Fan speed indication :

There are four fan modes : low, middle, high, auto. For some models, no middle fan then the middle fan is seen as high speed. The function is not suitable for the rooftop package units.


⑥ Lock:

When the " LOCK " button is pressed, the icon appear and other buttons is unable, press again, the icon disappear.

⑦ Temperature display zone:


Generally it displays setting temperature, it can be adjusted by press temperature button ▲ and ▼. But in fan mode, no display here.

5. INSTALLATION METHOD

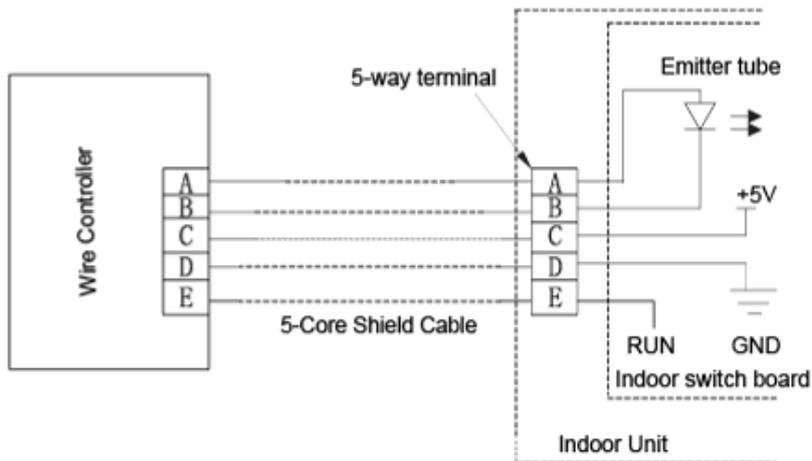


When a wired controller is needed, a small 5-way terminal should be added, fix an infrared emitter with gumwater near the receiver on the switch board. Connect its anode and cathode to A and B, and +5V, GND, RUN to C, D, E on the switch board.

6. NAME AND OPERATION OF THE BUTTON ON THE WIRE CONTROLLER

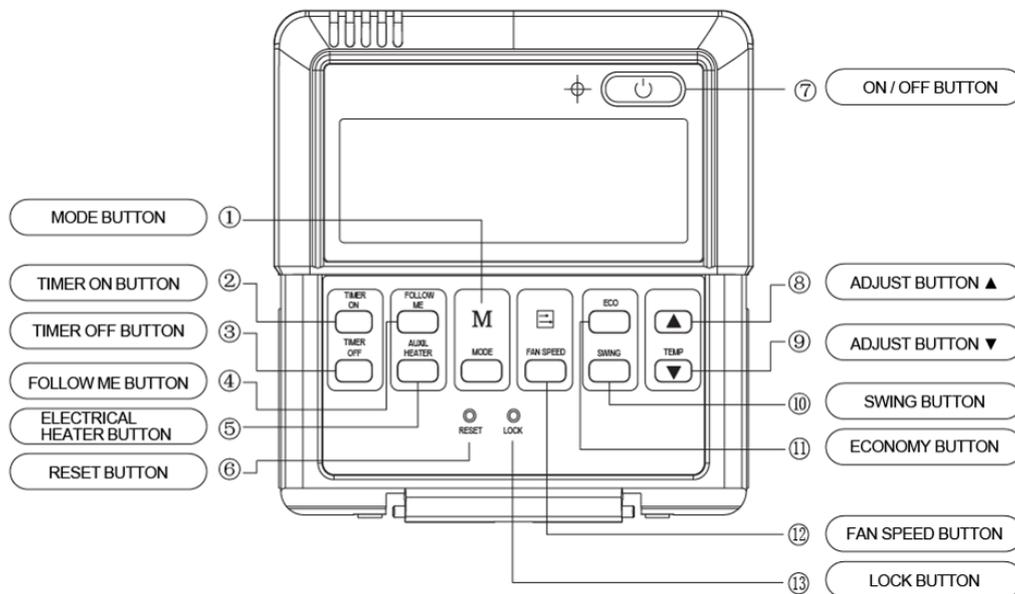

① Mode button:

When press this button, the operation mode change as the following sequence:



Remark: For the cooling only model, the heating mode is skipped.

② Timer on button :

Press this button, timer on function is active. Then every press, the time increase 0.5h, after 10h, 1h increase after each press. If cancel this Function, just set it to "0.0".

③ Timer off button:

Press this button, timer off function is active. Then every press, the time increase 0.5h, after 10h, per 1h increase after each press. If cancel this function, just set it to "0.0".

④ Follow me button:

When under cool, heat and auto mode, press this button, follow me function is active. Press again, this function is ineffective.

⑤ Electrical heater button :

If press this button in heat mode, electrical heater function become ineffective.

⑥ Reset button(hidden):

Use a 1mm stick to press in the little hole , then the current setting is canceled . The wired controller will enter into original state.

⑦ ON/OFF button:

When in off state, press this button, the indicator is on, the wire controller enter into on state, and send setting information to in door PCB. When in on state, press this button, the indicator is off, and send instruction. If timer on or timer off has been set, it cancel this setting then send instruction to stop the machine.

⑧ Adjust button ▲:

Set indoor temperature up. If press and hold on, it will increase at 1 degree per 0.5 second.

⑨ Adjust button ▼ :

Set indoor temperature down. If press and hold on, it will decrease at 1degree per 0.5 second.

⑩ Swing button:

First pressing: start swing function; second pressing: stop swing. (Match to some model with swing function).

⑪ Economy operation button:

Press this button, the indoor unit operates in economy mode, press it again, exit this mode (it may be ineffective for some models)

⑫ Fan speed button:

Press this button consecutively, the fan speed will circle as follow:



⑬ Lock button (hidden):

When you push the LOCK button, all current settings are locked in and the wire controller does not accept any operation except that of the LOCK button. Use the lock mode when you want to prevent setting from being changed accidentally or play fully. Push the LOCK button again when you want to cancel the LOCK mode.

7. USING METHOD

AUTOMATIC OPERATION

Connect to power, indoor operation lamp flash.

- ①. Press "MODE" button, select " AUTO " ;
- ②. Press the button "▲" and "▼", set temperature you want, generally it is among 17°C~30°C;
- ③. Press " ON/OFF" button, operation lamp is on, the air-conditioner work in auto mode, indoor fan is auto, and can not be changed. Auto is displayed on LCD. Press " ON/OFF" button again to stop.
- ④. Economy operation is valid in auto mode.

COOL/HEAT/FAN MODE OPERATION

- ①. Press "MODE" button, select "COOL", "HEAT" or "FAN ONLY" mode.
- ②. Press temperature adjust button to select setting temp..
- ③. Press "FAN SPEED" button to select high/mid/low/auto.
- ④. Press "ON/OFF" button, indoor unit operation lamp on, it works in selected mode. Press "ON/OFF" button again, it stops to work.

Remark: When in fan mode, no temperature can be set.

DRY OPERATION

-
- ①. Press " MODE " button, select " DRY " mode.
 - ②. Press temperature adjust button to select setting temp.
 - ③. Press " ON/OFF " button, indoor unit operation lamp on, it works in dry mode. Press ON/OFF button again, it stops to work.
 - ④. In dry mode, economy operation and fan speed are ineffective.

TIMER SETTING

Timer on only:

- ①. Press " TIME ON " button, it display "SET" on LCD, and display " H " and "ON" , it is waiting for timer on setting.
- ②. Press " timer " on button repeatedly to adjust time setting.
- ③. If press this button and hold on, the time will increase at 0.5h, after 10h, it increases at 1h.
- ④. After setting 0.5 second, the wire controller send timer on information, it is finished.

Timer off only:

- ①. Press "TIME OFF " button, it display "SET" on LCD, and display " H " and ON, it is waiting for timer on setting.
- ②. Press "TIME OFF" button repeatedly to adjust time setting.
- ③. If press this button and hold on, the time will increase at 0.5h, after 10h, it increases at 1h.
- ④. After setting 0.5 second, the wire controller send timer off information, it is finished.

TIMER ON AND TIMER OFF BOTH

- ①. Set timer on time as the corresponding step1 and 2.
- ②. Set timer off time as the corresponding step1 and 2.
- ③. Timer off time must be longer than timer on time.
- ④. 0.5 second after setting, the wire controller send information, the setting is finished.

CHANGE TIMER

If there is a timer of changing time to be need, press corresponding button to revise it. If cancel timer, change time to 0.0.

NOTE: The timer time is relative time, that is delay after setting time (i, e: setting time is 8:05 A,M). So when timer is set, the standard time can not be adjusted.

8. TECHNICAL INDICATION AND REQUIREMENT

EMC and EMI comply with the CE certification requirements.

14.2 Optional wired controller:

KJR-23B: For cooling only and cooling with auxiliary heater

KJR-25B: For Cooling and heating



KJR-23B




KJR-25B


14.3 Control wiring

To connect wired controller


For C/O Units

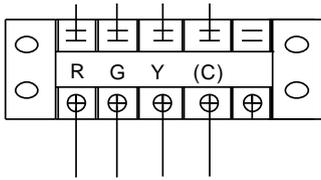


For E/Heater+C Units

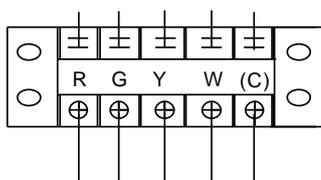


Power supply

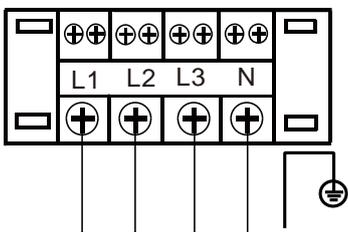

Next wire joint also available

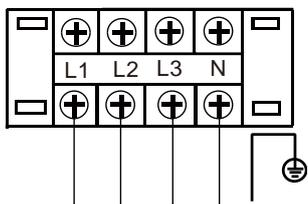

For C/O Units
6.25-7.5 TONS

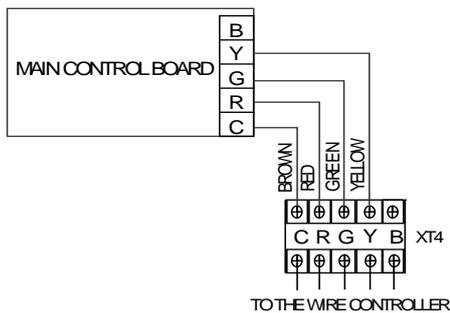

Suggestion: Thermostat choose KJR-23B or Non-programmed electrical thermostat series of Honeywell, such as TH5220D. Wiring please refer to the Owner's Manual of the thermostat.


Dial code setting

Set the dial code SW3 of PCB in unit's wire control box, after settings, please shut off the power supply and then repower, otherwise, the new settings function couldn't work.


When select the KJR-12B wired controller, please set the SW3 in "ON".

When select the wired controller be recommended, please set the SW3 in "1".

For C/O Units
8.5-30 TONS

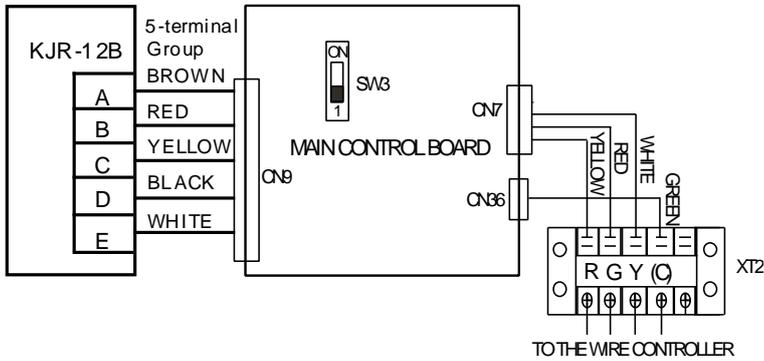

For E/Heater+C Units

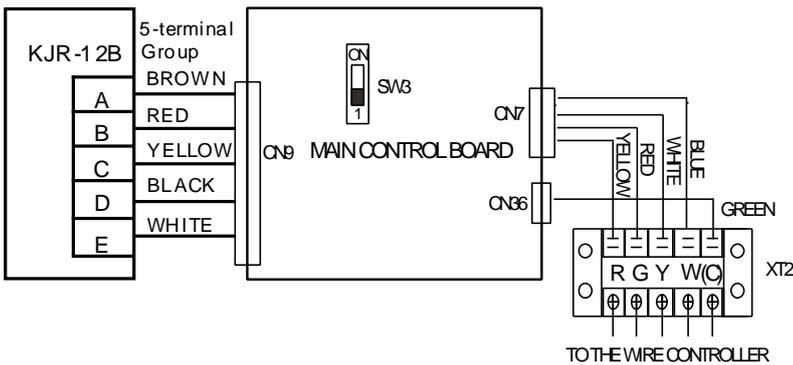

15. Error Code

15.1 Error Code for 6.2&7.5ton


| NUM | CODE | LED1(RE D) | LED2(YELLOW) | LED3(GREEN) |
|-----|---|------------|--------------|-------------|
| 1 | STANDBY | OFF | OFF | ON |
| 2 | FUNCTION | ON | ON | ON |
| 3 | PHASE-MISSING | FLASH | FLASH | FLASH |
| | PHASE-ERROR | | | |
| 4 | T1 SENSOR FAILURE | FLASH | FLASH | FLASH |
| | HIGH PRESSURE PROTECTION | | | |
| | VENT PROTECTION | | | |
| 5 | T2 SENSOR FAILURE | FLASH | OFF | FLASH |
| 6 | T3 SENSOR FAILURE | OFF | FLASH | FLASH |
| 7 | T4 SENSOR FAILURE | ON | FLASH | FLASH |
| 8 | T2 EVAPORATOR LOW TEMP. PROTECTION | OFF | FLASH | OFF |
| 9 | T2 EVAPORATOR HIGH TEMP. PROTECTION | FLASH | ON | ON |
| 10 | T3 CONDENSOR HIGH TEMP. PROTECTION | FLASH | OFF | OFF |
| 11 | LINE CONTROLLER INPUT FAILURE | FLASH | FLASH | ON |
| 12 | COMPRESSOR OVERCURRENT PROTECTION | OFF | OFF | FLASH |
| 13 | COMPRESSOR-INHALING LOW PRESSURE PROTECTION | FLASH | ON | FLASH |
| 14 | DEFROST | ON | FLASH | FLASH |

Error code for 8.5ton and above


| Type | Content | Code | Remarks |
|------------|---|------|-------------------------------------|
| Normal | Standby | — | |
| Normal | Constraint cool | on | |
| Normal | Run | 10. | |
| Error | Compressor phase sequence error or phase default | E0 | |
| Error | Outdoor coil sensor in sys. A error | E1 | |
| Error | Outdoor coil sensor in sys. B error | E2 | |
| Error | Overcurrent protection of system A are active 3 times within one hour | E3 | Unit shall be power off to recovery |
| Error | Overcurrent protection of system B are active 3 times within one hour | E4 | Unit shall be power off to recovery |
| Error | Indoor coil sensor in sys. A error | E5 | |
| Error | Indoor coil sensor in sys. B error | E6 | |
| Error | High, low pressure protection or discharge temperature protection of system A reached 3 times | E7 | Unit shall be power off to recovery |
| Error | High, low pressure protection or discharge temperature protection of system B reached 3 times | E8 | Unit shall be power off to recovery |
| Error | Indoor sensor error | E9 | |
| Error | Outdoor ambient sensor error | EA | |
| Error | Wire controller output error | Eb | |
| Protection | Overcurrent protection in sys.A | P0 | |
| Protection | Overcurrent protection in sys.B | P1 | |
| Protection | Overcurrent protection for indoor fan | P2 | |
| Protection | Comprehensive protection for outdoor fan | P3 | |
| Protection | Protection for Hi./Lo. pressure or exhaust temp. in sys.A | P4 | Comprehensive protection in sys.A |
| Protection | Protection for Hi./Lo. pressure or exhaust temp. in sys.B | P5 | Comprehensive protection in sys.B |
| Protection | Hi-pressure protection initiated in T2 evaporator stops the outdoor unit fan | P6 | |
| Protection | Hi-pressure protection initiated in T2 evaporator stops the outdoor unit fan and compressor | P7 | |
| Protection | Protection for condenser Hi-temp. in sys.A | P8 | |
| Protection | Protection for condenser Hi-temp. in sys.B | P9 | |
| Protection | Anti-freezing protection for evaporator in sys. A | Pc | |
| Protection | Anti-freezing protection for evaporator in sys. B | Pd | |
| Protection | Defrosting | dF | |
| Protection | Protection for outdoor temp | PA | |

15.2 Troubleshooting

① E0: Compressor phase sequence error or phase default

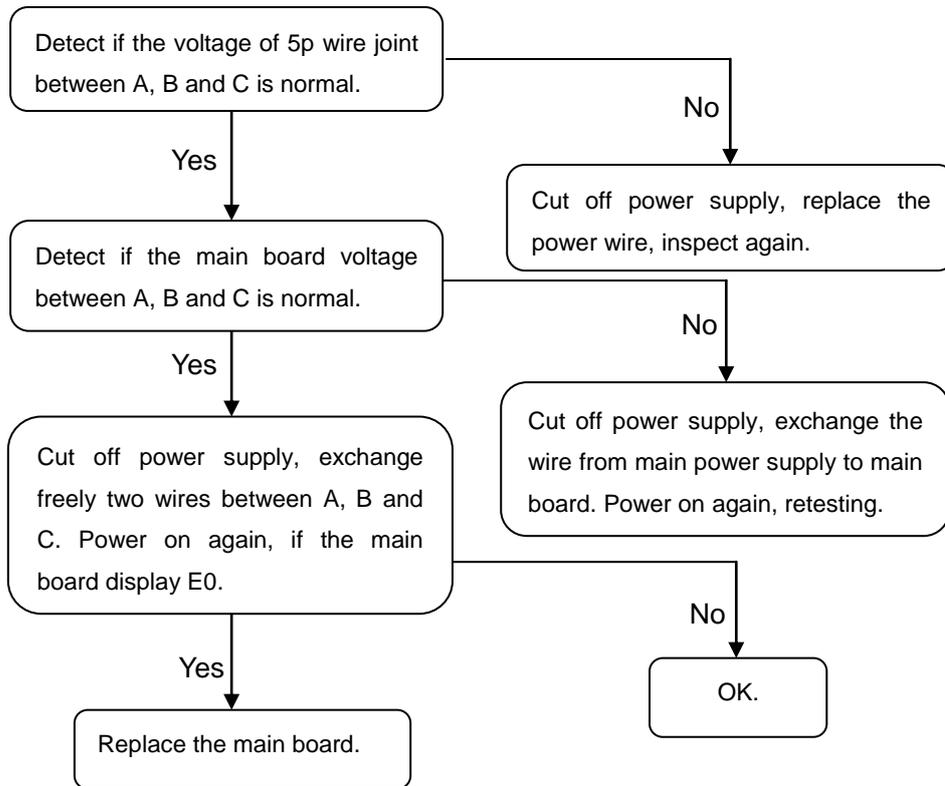


② E1: Outdoor coil temp. sensor T3 default.

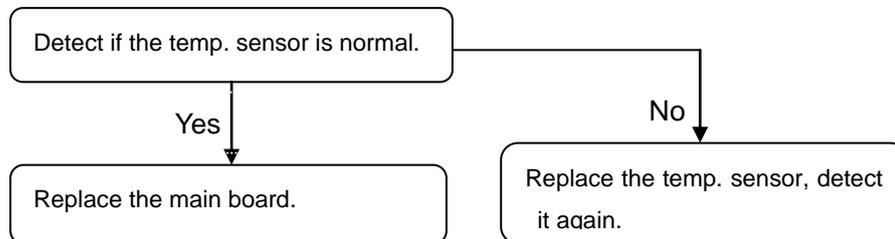

③ E9: Indoor coil temp. sensor T2 default.

(Indoor temp. and Pipe Temp. Sensor Resistance Value Table, see **Appendix 2**)

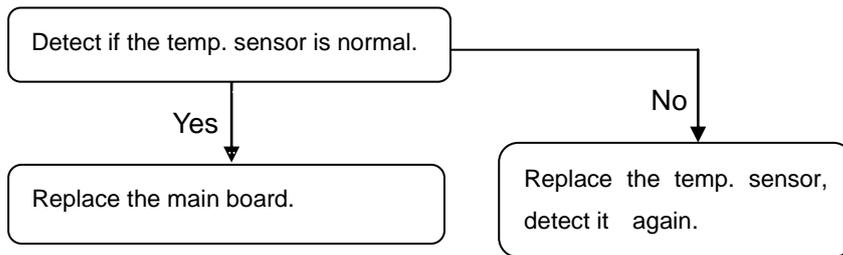


④ When E2,E5,E6 or EA displays, please check the wired nameplate, if the terminals of T2_1、 T2_2、 T3_2、 T4 are connected as short circuit. If no, please connect all as short circuit, unless replace main board.

⑤ Eb: Wired controller output error.(Only for KJR-23B or KJR-25B).


Avoid three conditions as following:

- 1) The wired controller output signal has Y, no G.
- 2) The wired controller output signal has W, no G.
- 3) The wired controller output signal has Y and W, no G.


⑥ P0: Compressor over current protection.(The over current protection value is 16A)

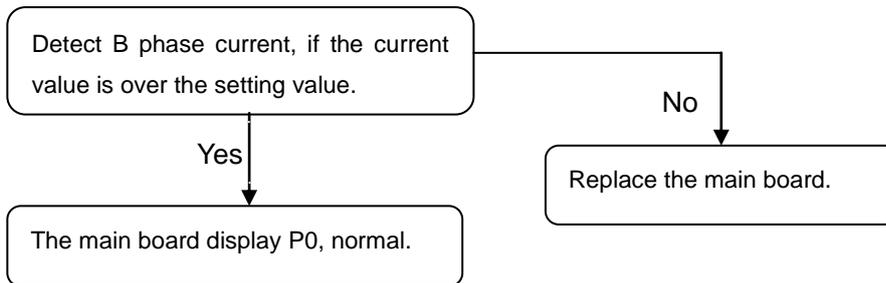


⑦ P3: Comprehensive protection for outdoor fan

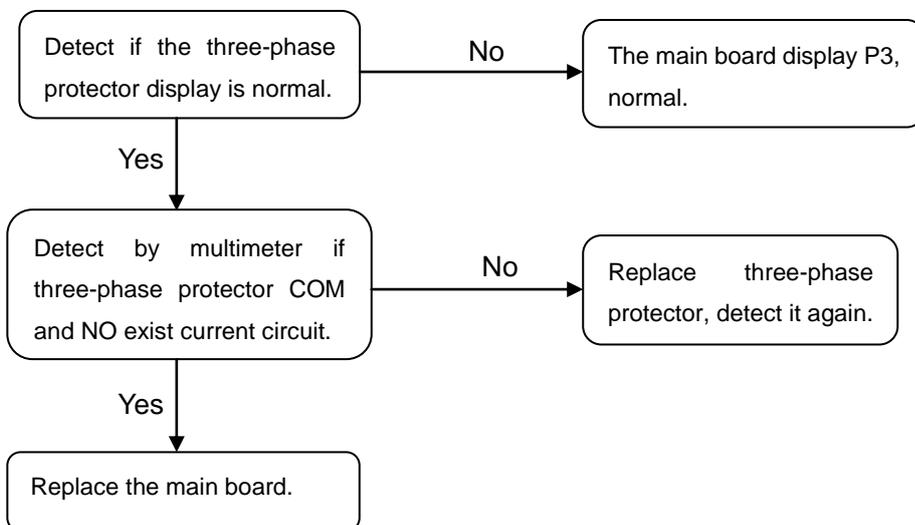


⑧ P4: Protection for Hi./Lo. Pressure or exhaust temp. (High pressure protection value: 4.4MPa, High pressure protection value: 0.14MPa; air discharge temp. protection value: 130°C above)

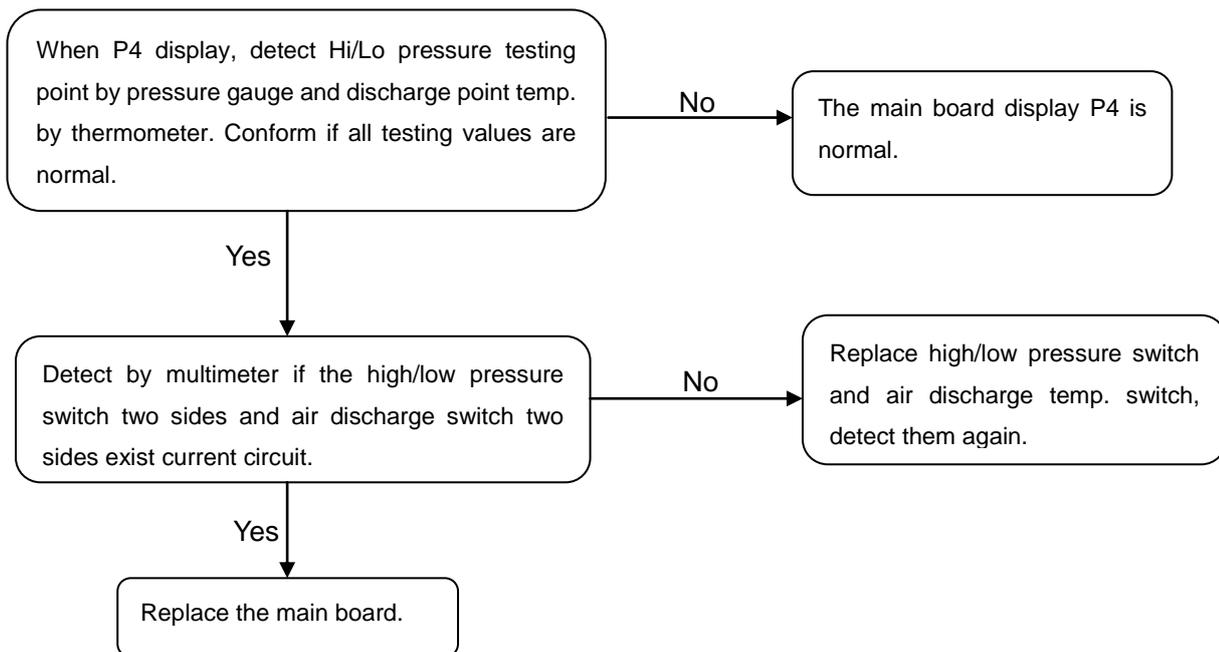

⑨ Indoor fan motor don't work.

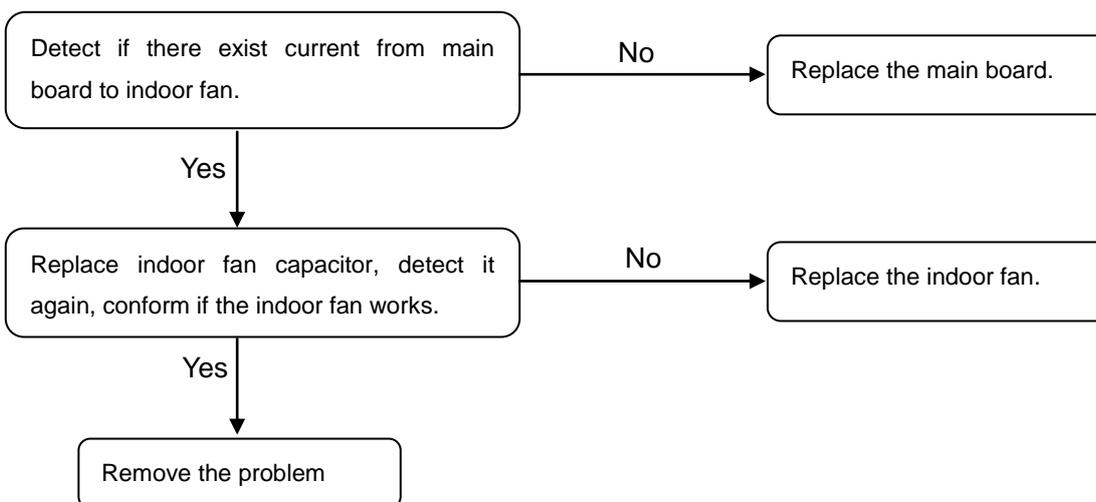


⑩ Outdoor fan motor don't work.

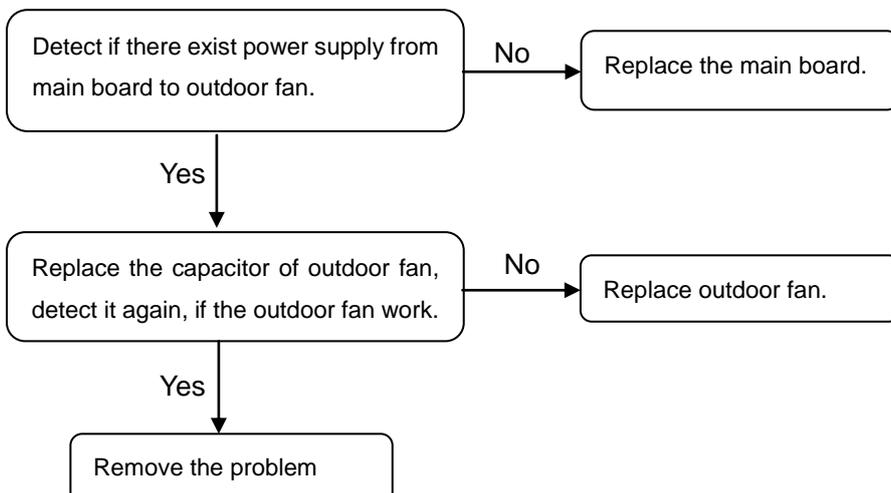


① Indoor fan motor don't run.


The first check if the power supplier is normal, if all wire connection terminal is loose, if the wired controller set and wire connection are correct, operating as flow process after confirm.

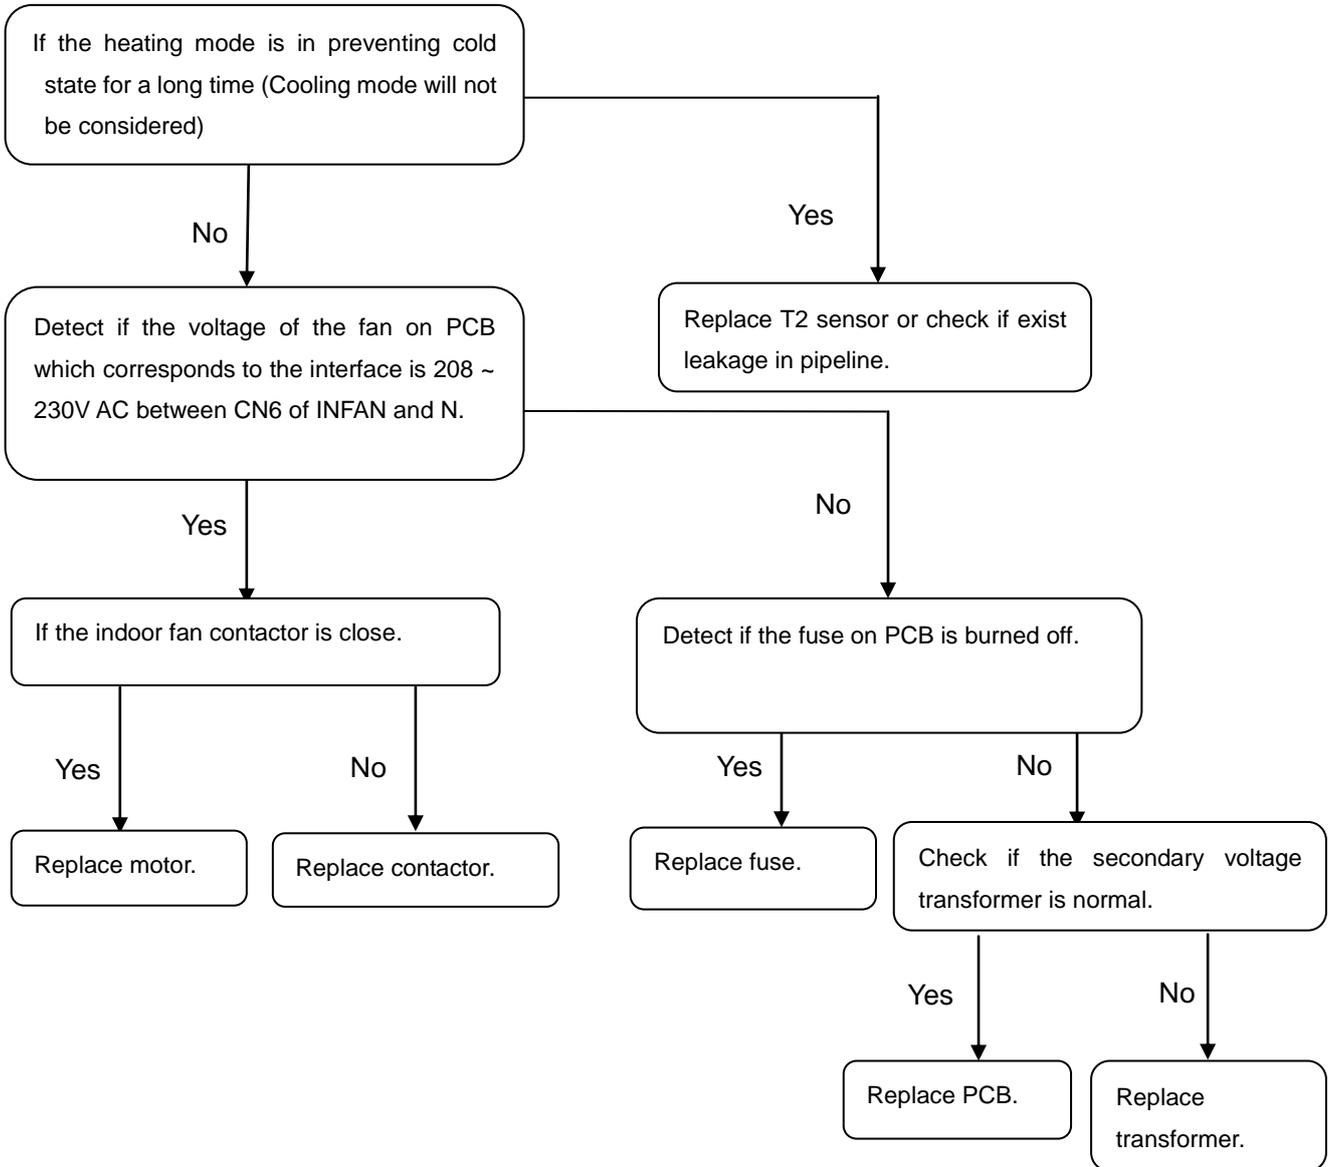


② Compressor don't run (All wires connection are correct and reliable, if power supplier is required range. If compressor don't run, you can analysis as flowing)

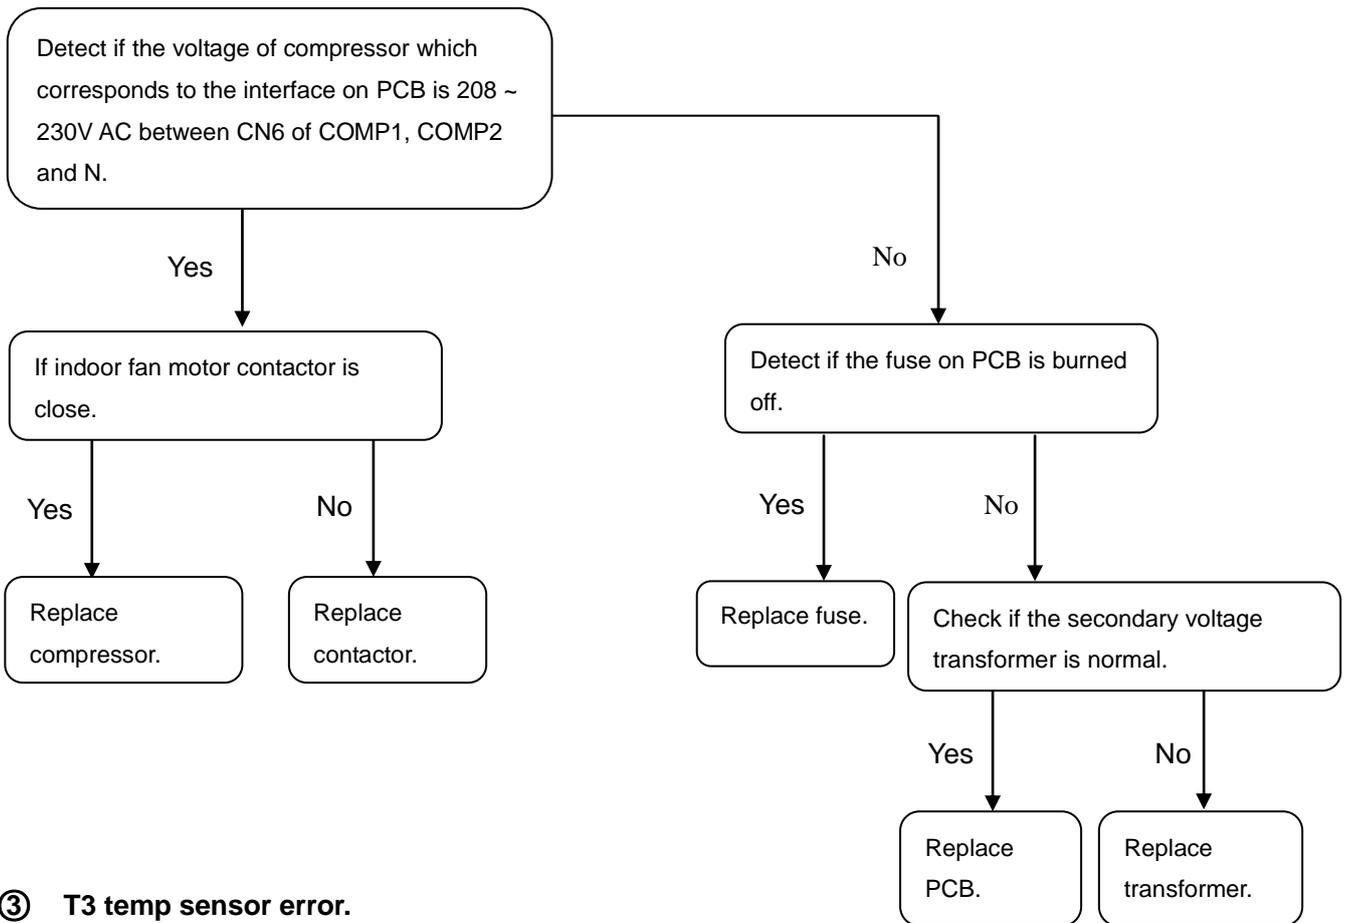


③ T3 temp sensor error.

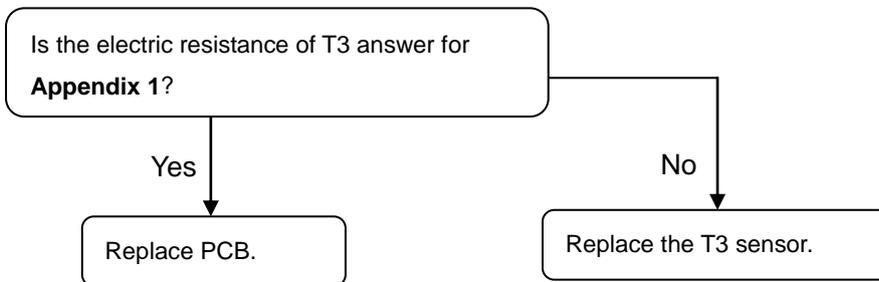


④ Check if the low pressure protection is normal.

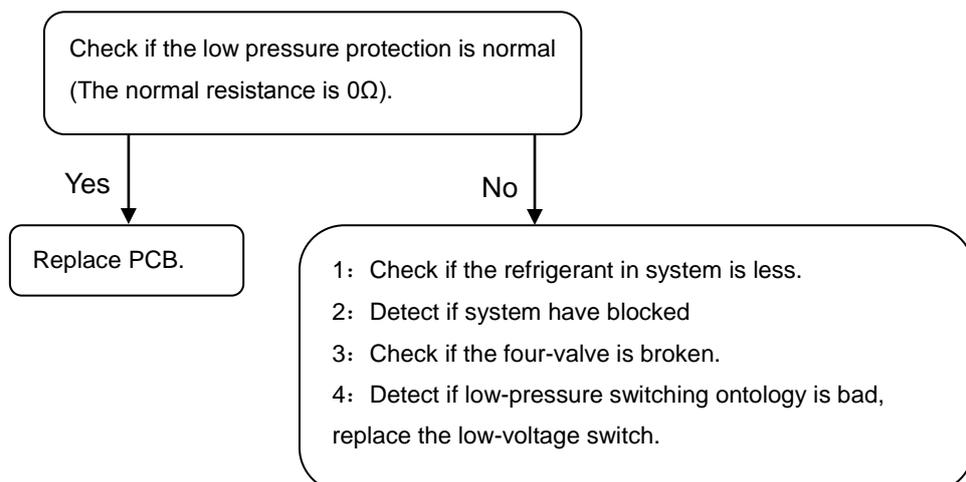


⑤ Outdoor fan motor don't run.

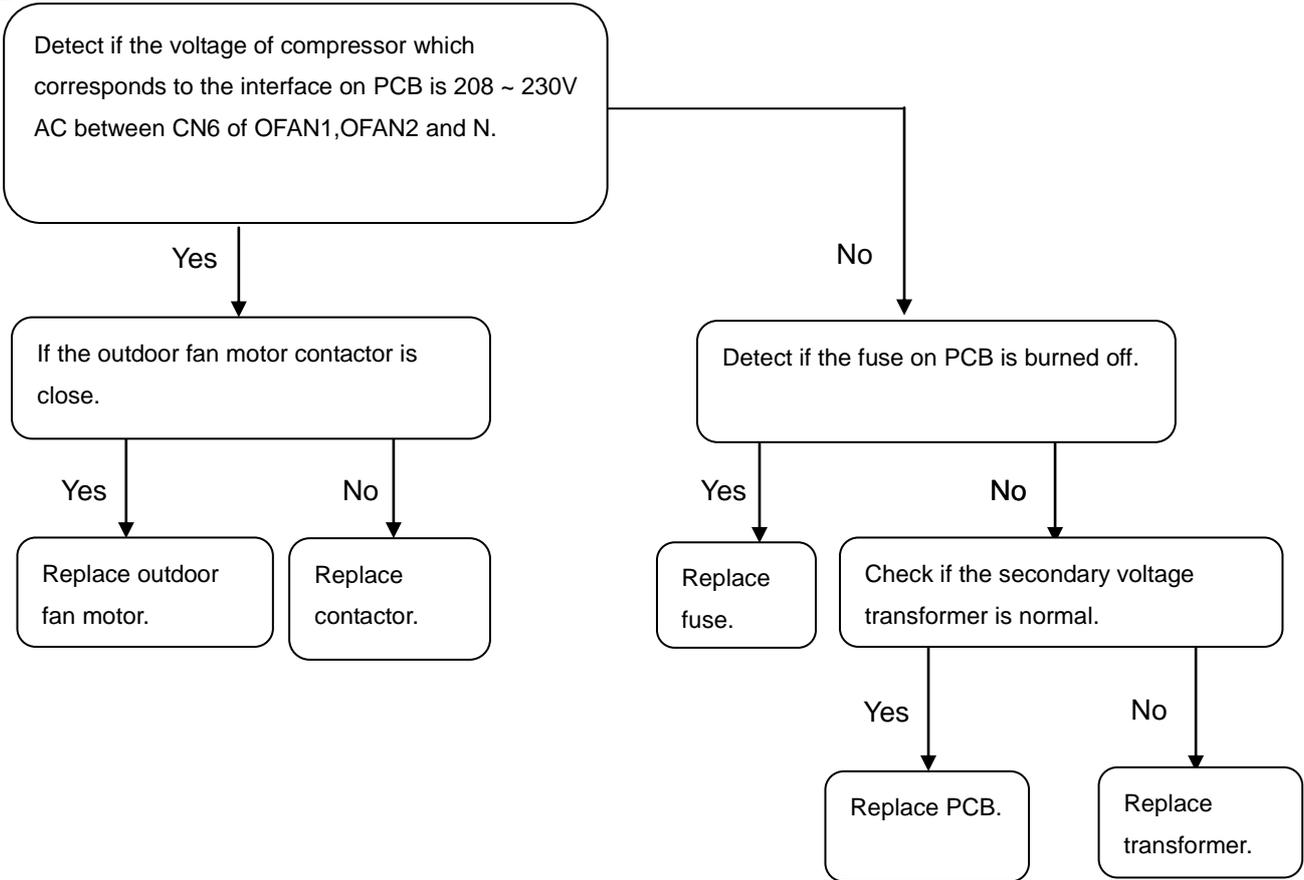

⑥ Four ways valve don't work.

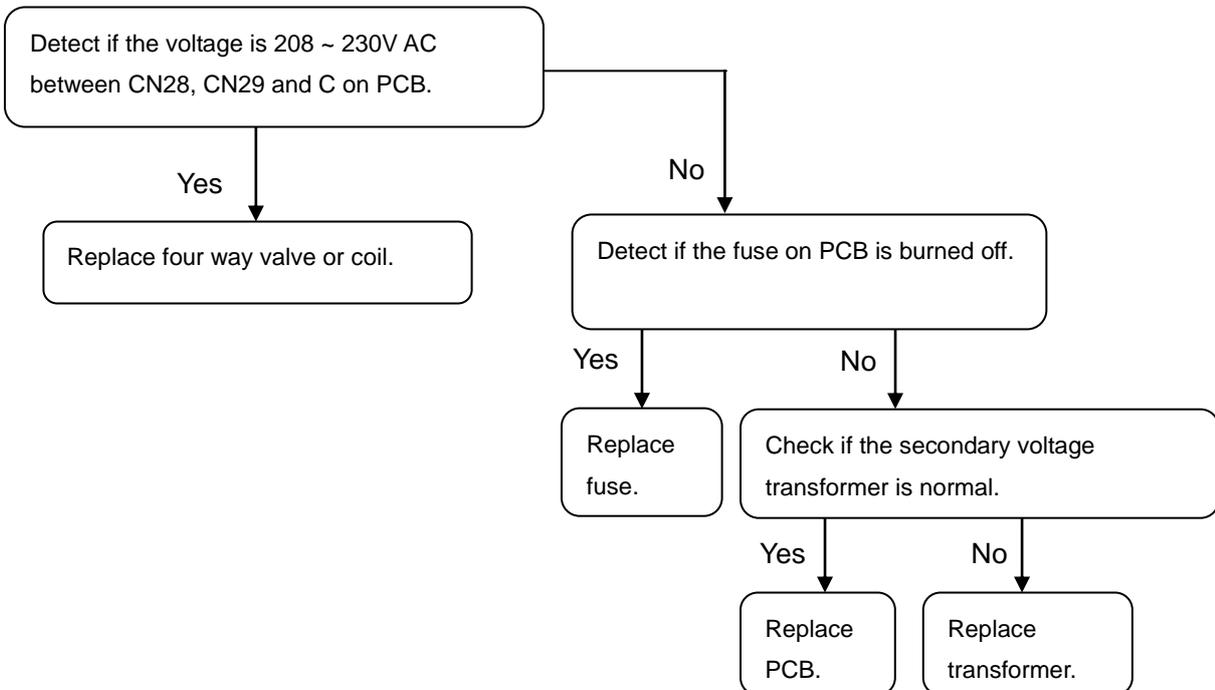

⑦ Condenser high temperature protection

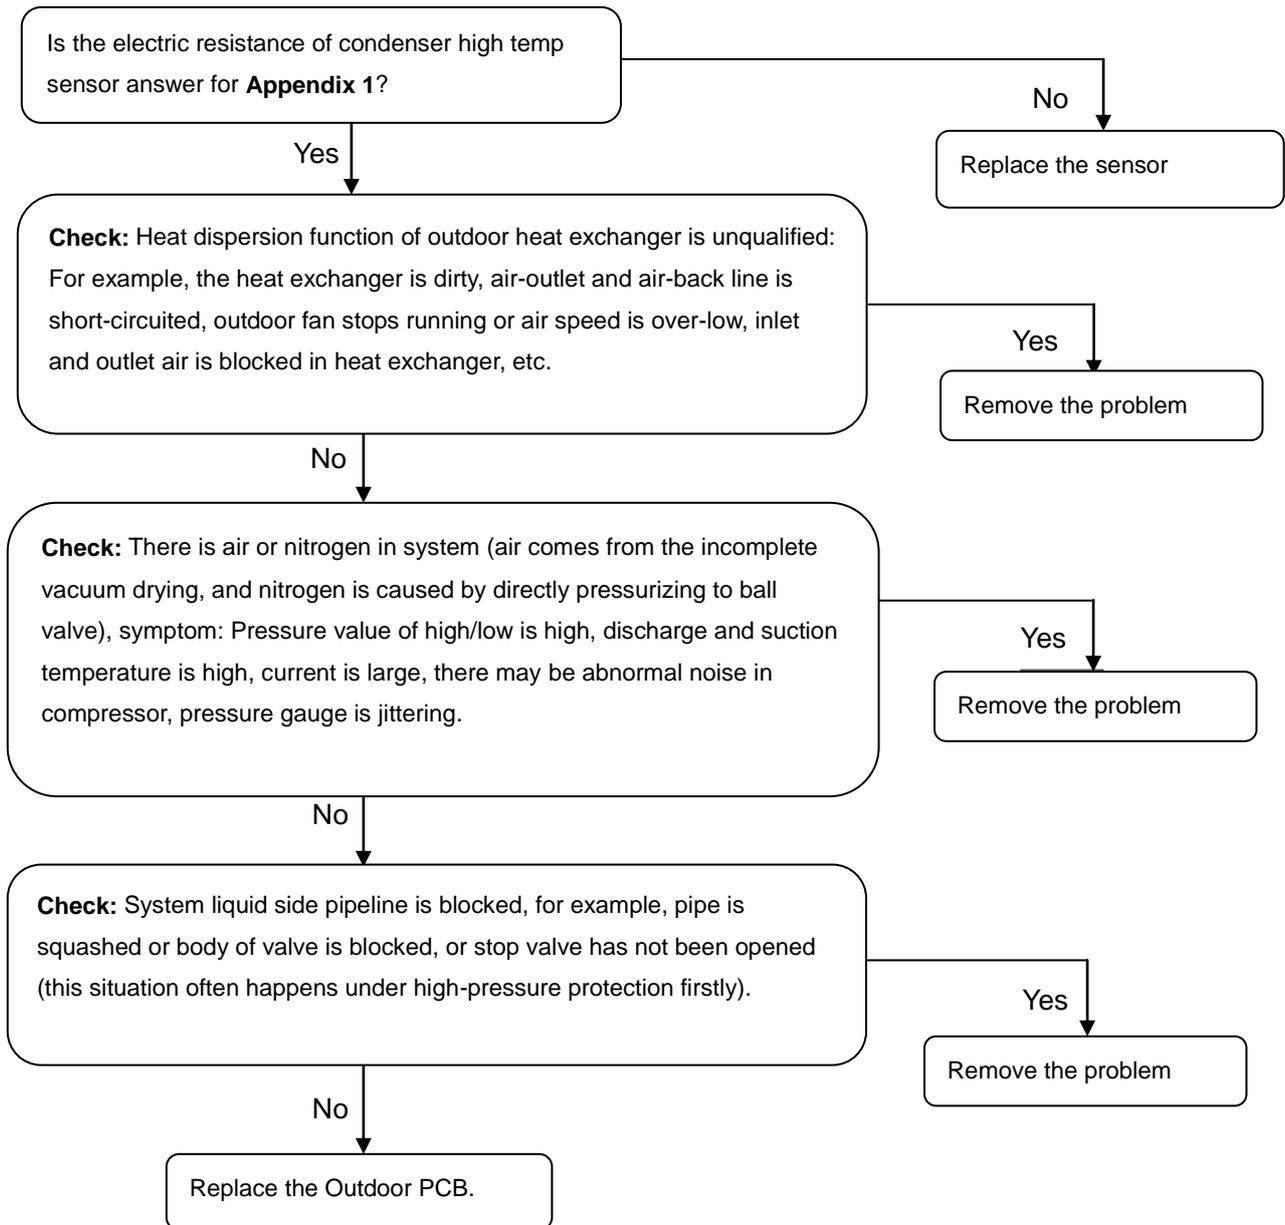


16. Accessories

| Name of accessories | Qty | Shape |
|--------------------------|-----|---|
| Manual | 1 | ———— |
| Drain outlet | 1 |  |
| Snap ring | 1 |  |
| Drain pipe | 1 |  |
| KJR-12B Wired controller | 1 |  |

17. Maintenance and Upkeep

Regular maintenance and upkeep

Some regular maintenance and upkeep have been carry on by user, includes: change the one-time dust filter, clean casing, wash condenser and replace a new belt, as well as do some test for the equipment.

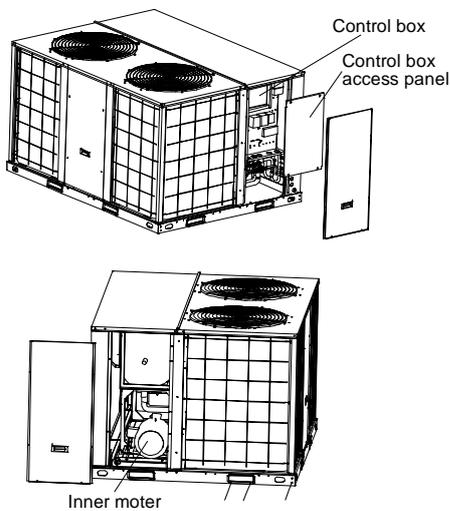


Tab.18-1

| Model | A |
|----------|-------|
| 6.2 Ton | 328mm |
| 7.5 Ton | 328mm |
| 8.5Ton | 380mm |
| 10 Ton | 380mm |
| 12.5Ton | 560mm |
| 15 Ton | 560mm |
| 17.5 Ton | 580mm |
| 20 Ton | 580mm |
| 25Ton | 480mm |
| 30Ton | 480mm |

Note: At least 1m flame resistant layer must be laid at the end of the air duct internal surface.


Regulating belt of tension, Refer to the following Fig. loose 2 bolts, and move the electric motor to adjust belt tension.

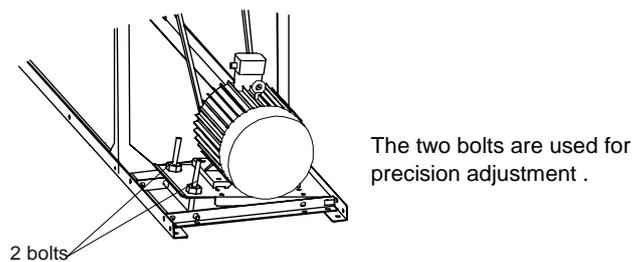

Belt tension is measured by belt tension indicator.

Calculate the deflection, $\text{deflection} = A/64$.

Measure the belt deflection force, the force should be between the values shown in Tab.18-2.

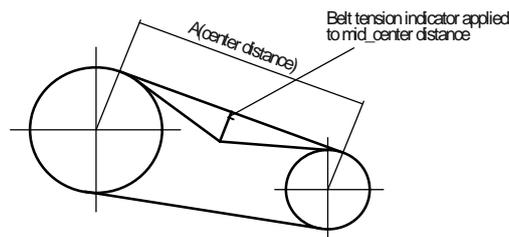

Tab.18-2

| Belt section | For required to deflection | | |
|--------------|----------------------------|-----------|---------------------|
| | Small pulley diameter (mm) | Newton(N) | Kilogram-force(kgf) |
| SPA | 80 to132 | 25 to 35 | 2.5 to 3.6 |

NOTE: The belt which is too tight or too loose may generate noise and be harmful to the unit.

Appendix :

1. Indoor Temp. and Pipe Temp. Sensor Resistance Value Table (8.5ton and above)

| °C | K Ohm | °C | K Ohm | °C | K Ohm | °C | K Ohm |
|-----|---------|----|---------|----|---------|-----|---------|
| -20 | 115.266 | 20 | 12.6431 | 60 | 2.35774 | 100 | 0.62973 |
| -19 | 108.146 | 21 | 12.0561 | 61 | 2.27249 | 101 | 0.61148 |
| -18 | 101.517 | 22 | 11.5000 | 62 | 2.19073 | 102 | 0.59386 |
| -17 | 96.3423 | 23 | 10.9731 | 63 | 2.11241 | 103 | 0.57683 |
| -16 | 89.5865 | 24 | 10.4736 | 64 | 2.03732 | 104 | 0.56038 |
| -15 | 84.2190 | 25 | 10.000 | 65 | 1.96532 | 105 | 0.54448 |
| -14 | 79.3110 | 26 | 9.55074 | 66 | 1.89627 | 106 | 0.52912 |
| -13 | 74.5360 | 27 | 9.12445 | 67 | 1.83003 | 107 | 0.51426 |
| -12 | 70.1698 | 28 | 8.71983 | 68 | 1.76647 | 108 | 0.49989 |
| -11 | 66.0898 | 29 | 8.33566 | 69 | 1.70547 | 109 | 0.48600 |
| -10 | 62.2756 | 30 | 7.97078 | 70 | 1.64691 | 110 | 0.47256 |
| -9 | 58.7079 | 31 | 7.62411 | 71 | 1.59068 | 111 | 0.45957 |
| -8 | 56.3694 | 32 | 7.29464 | 72 | 1.53668 | 112 | 0.44699 |
| -7 | 52.2438 | 33 | 6.98142 | 73 | 1.48481 | 113 | 0.43482 |
| -6 | 49.3161 | 34 | 6.68355 | 74 | 1.43498 | 114 | 0.42304 |
| -5 | 46.5725 | 35 | 6.40021 | 75 | 1.38703 | 115 | 0.41164 |
| -4 | 44.0000 | 36 | 6.13059 | 76 | 1.34105 | 116 | 0.40060 |
| -3 | 41.5878 | 37 | 5.87359 | 77 | 1.29078 | 117 | 0.38991 |
| -2 | 39.8239 | 38 | 5.62961 | 78 | 1.25423 | 118 | 0.37956 |
| -1 | 37.1988 | 39 | 5.39689 | 79 | 1.21330 | 119 | 0.36954 |
| 0 | 35.2024 | 40 | 5.17519 | 80 | 1.17393 | 120 | 0.35982 |
| 1 | 33.3269 | 41 | 4.96392 | 81 | 1.13604 | 121 | 0.35042 |
| 2 | 31.5635 | 42 | 4.76253 | 82 | 1.09958 | 122 | 0.3413 |
| 3 | 29.9058 | 43 | 4.57050 | 83 | 1.06448 | 123 | 0.33246 |
| 4 | 28.3459 | 44 | 4.38736 | 84 | 1.03069 | 124 | 0.32390 |
| 5 | 26.8778 | 45 | 4.21263 | 85 | 0.99815 | 125 | 0.31559 |
| 6 | 25.4954 | 46 | 4.04589 | 86 | 0.96681 | 126 | 0.30754 |
| 7 | 24.1932 | 47 | 3.88673 | 87 | 0.93662 | 127 | 0.29974 |
| 8 | 22.5662 | 48 | 3.73476 | 88 | 0.90753 | 128 | 0.29216 |
| 9 | 21.8094 | 49 | 3.58962 | 89 | 0.87950 | 129 | 0.28482 |
| 10 | 20.7184 | 50 | 3.45097 | 90 | 0.85248 | 130 | 0.27770 |
| 11 | 19.6891 | 51 | 3.31847 | 91 | 0.82643 | 131 | 0.27078 |
| 12 | 18.7177 | 52 | 3.19183 | 92 | 0.80132 | 132 | 0.26408 |
| 13 | 17.8005 | 53 | 3.07075 | 93 | 0.77709 | 133 | 0.25757 |
| 14 | 16.9341 | 54 | 2.95896 | 94 | 0.75373 | 134 | 0.25125 |
| 15 | 16.1156 | 55 | 2.84421 | 95 | 0.73119 | 135 | 0.24512 |
| 16 | 15.3418 | 56 | 2.73823 | 96 | 0.70944 | 136 | 0.23916 |
| 17 | 14.6181 | 57 | 2.63682 | 97 | 0.68844 | 137 | 0.23338 |
| 18 | 13.9180 | 58 | 2.53973 | 98 | 0.66818 | 138 | 0.22776 |
| 19 | 13.2631 | 59 | 2.44677 | 99 | 0.64862 | 139 | 0.22231 |

2. Indoor Temp. and Pipe Temp. Sensor Resistance Value Table (6. 2&7. 5ton)

| Temp (°C) | Resistance (KΩ) | | | Resist.tol (%) | | Temp.tol(°C) | |
|--------------|-----------------|--------------|--------|----------------|--------|--------------|--------|
| | Rmax | R (t) Normal | Rmin | MAX(+) | MIN(-) | MAX(+) | MIN(-) |
| -20 | 116.539 | 106.732 | 96.920 | 9.19 | 9.19 | 1.59 | 1.59 |
| -19 | 110.231 | 100.552 | 91.451 | 9.63 | 9.05 | 1.57 | 1.57 |
| -18 | 103.743 | 94.769 | 86.328 | 9.47 | 8.91 | 1.56 | 1.55 |
| -17 | 97.673 | 89.353 | 81.525 | 9.31 | 8.76 | 1.54 | 1.54 |
| -16 | 91.990 | 84.278 | 77.017 | 9.15 | 8.62 | 1.53 | 1.52 |
| -15 | 86.669 | 79.521 | 72.788 | 8.99 | 8.47 | 1.51 | 1.50 |
| -14 | 81.684 | 75.059 | 68.815 | 8.83 | 8.32 | 1.49 | 1.48 |
| -13 | 77.013 | 70.873 | 65.083 | 8.66 | 8.17 | 1.47 | 1.47 |
| -12 | 72.632 | 66.943 | 61.574 | 8.50 | 8.02 | 1.45 | 1.45 |
| -11 | 68.523 | 63.252 | 58.274 | 8.33 | 7.87 | 1.44 | 1.43 |
| -10 | 64.668 | 59.784 | 55.169 | 8.17 | 7.72 | 1.42 | 1.41 |
| -9 | 61.048 | 56.524 | 52.246 | 8.00 | 7.57 | 1.40 | 1.39 |
| -8 | 57.649 | 53.458 | 49.492 | 7.84 | 7.42 | 1.38 | 1.37 |
| -7 | 54.456 | 50.575 | 46.899 | 7.67 | 7.27 | 1.35 | 1.35 |
| -6 | 51.456 | 47.862 | 44.455 | 7.51 | 7.12 | 1.33 | 1.32 |
| -5 | 48.636 | 45.308 | 42.150 | 7.35 | 6.97 | 1.31 | 1.30 |
| -4 | 45.984 | 42.903 | 39.977 | 7.18 | 6.82 | 1.29 | 1.28 |
| -3 | 43.490 | 40.638 | 37.927 | 7.02 | 6.67 | 1.27 | 1.26 |
| -2 | 41.144 | 38.504 | 35.992 | 6.86 | 6.52 | 1.25 | 1.24 |
| -1 | 38.935 | 36.492 | 34.165 | 6.70 | 6.38 | 1.23 | 1.21 |
| 0 | 36.857 | 34.596 | 32.440 | 6.53 | 6.23 | 1.21 | 1.19 |
| 1 | 34.898 | 32.807 | 30.810 | 6.38 | 6.09 | 1.18 | 1.17 |
| 2 | 33.055 | 31.120 | 29.271 | 6.22 | 5.94 | 1.16 | 1.15 |
| 3 | 31.317 | 29.528 | 27.815 | 6.06 | 5.80 | 1.14 | 1.12 |
| 4 | 29.681 | 28.026 | 26.440 | 5.90 | 5.66 | 1.12 | 1.10 |
| 5 | 28.138 | 26.608 | 25.140 | 5.75 | 5.52 | 1.10 | 1.08 |
| 6 | 26.682 | 25.268 | 23.909 | 5.60 | 5.38 | 1.07 | 1.06 |
| 7 | 25.310 | 24.003 | 22.745 | 5.45 | 5.24 | 1.05 | 1.03 |
| 8 | 24.016 | 22.808 | 21.644 | 5.30 | 5.10 | 1.03 | 1.01 |
| 9 | 22.794 | 21.678 | 20.601 | 5.15 | 4.97 | 1.01 | 0.99 |
| 10 | 21.641 | 20.610 | 19.614 | 5.00 | 4.83 | 0.99 | 0.97 |
| 11 | 20.553 | 19.601 | 18.680 | 4.86 | 4.70 | 0.96 | 0.94 |
| 12 | 19.525 | 18.646 | 17.794 | 4.71 | 4.57 | 0.94 | 0.92 |
| 13 | 18.554 | 17.743 | 16.955 | 4.57 | 4.44 | 0.92 | 0.90 |
| 14 | 17.636 | 16.888 | 16.160 | 4.43 | 4.31 | 0.90 | 0.88 |
| 15 | 16.769 | 16.079 | 15.406 | 4.29 | 4.19 | 0.88 | 0.85 |
| 16 | 15.949 | 15.313 | 14.691 | 4.15 | 4.06 | 0.86 | 0.83 |
| 17 | 15.174 | 14.588 | 14.014 | 4.02 | 3.94 | 0.84 | 0.81 |
| 18 | 14.442 | 13.902 | 13.372 | 3.89 | 3.81 | 0.81 | 0.79 |
| 19 | 13.748 | 13.251 | 12.762 | 3.75 | 3.69 | 0.79 | 0.76 |
| 20 | 13.093 | 12.635 | 12.183 | 3.62 | 3.57 | 0.77 | 0.74 |
| 21 | 12.471 | 12.050 | 11.634 | 3.50 | 3.46 | 0.75 | 0.72 |
| 22 | 11.883 | 11.496 | 11.112 | 3.37 | 3.34 | 0.73 | 0.70 |
| 23 | 11.327 | 10.971 | 10.617 | 3.25 | 3.23 | 0.71 | 0.68 |
| 24 | 10.800 | 10.473 | 10.147 | 3.12 | 3.11 | 0.69 | 0.66 |
| 25 | 10.300 | 10.000 | 9.700 | 3.00 | 3.00 | 0.67 | 0.63 |
| 26 | 9.848 | 9.551 | 9.255 | 3.11 | 3.10 | 0.69 | 0.66 |
| 27 | 9.418 | 9.125 | 8.834 | 3.21 | 3.19 | 0.72 | 0.69 |
| 28 | 9.010 | 8.721 | 8.434 | 3.31 | 3.29 | 0.75 | 0.71 |

| | | | | | | | |
|----|-------|-------|-------|------|------|------|------|
| 29 | 8.621 | 8.337 | 8.055 | 3.41 | 3.38 | 0.77 | 0.74 |
| 30 | 8.252 | 7.972 | 7.695 | 3.51 | 3.47 | 0.80 | 0.77 |
| 31 | 7.900 | 7.625 | 7.353 | 3.61 | 3.57 | 0.83 | 0.79 |
| 32 | 7.566 | 7.296 | 7.029 | 3.70 | 3.66 | 0.85 | 0.82 |
| 33 | 7.247 | 6.982 | 6.721 | 3.80 | 3.74 | 0.88 | 0.84 |
| 34 | 6.944 | 6.684 | 6.428 | 3.89 | 3.83 | 0.91 | 0.87 |
| 35 | 6.656 | 6.401 | 6.150 | 3.98 | 3.92 | 0.93 | 0.90 |
| 36 | 6.381 | 6.131 | 5.886 | 4.08 | 4.00 | 0.96 | 0.93 |
| 37 | 6.119 | 5.874 | 5.634 | 4.17 | 4.09 | 0.98 | 0.95 |
| 38 | 5.870 | 5.630 | 5.395 | 4.26 | 4.17 | 1.01 | 0.98 |
| 39 | 5.631 | 5.397 | 5.167 | 4.34 | 4.26 | 1.03 | 1.01 |
| 40 | 5.404 | 5.175 | 4.951 | 4.43 | 4.34 | 1.06 | 1.03 |
| 41 | 5.188 | 4.964 | 4.745 | 4.52 | 4.42 | 1.09 | 1.06 |
| 42 | 4.982 | 4.763 | 4.549 | 4.60 | 4.50 | 1.12 | 1.09 |
| 43 | 4.785 | 4.571 | 4.362 | 4.69 | 4.58 | 1.14 | 1.12 |
| 44 | 4.596 | 4.387 | 4.183 | 4.77 | 4.66 | 1.17 | 1.14 |
| 45 | 4.417 | 4.213 | 4.014 | 4.85 | 4.74 | 1.19 | 1.17 |
| 46 | 4.246 | 4.046 | 3.851 | 4.93 | 4.81 | 1.22 | 1.20 |
| 47 | 4.082 | 3.887 | 3.697 | 5.02 | 4.89 | 1.25 | 1.23 |
| 48 | 3.925 | 3.735 | 3.550 | 5.10 | 4.97 | 1.28 | 1.25 |
| 49 | 3.776 | 3.590 | 3.409 | 5.18 | 5.04 | 1.30 | 1.28 |
| 50 | 3.632 | 3.451 | 3.274 | 5.25 | 5.12 | 1.33 | 1.30 |
| 51 | 3.495 | 3.318 | 3.146 | 5.33 | 5.19 | 1.35 | 1.33 |
| 52 | 3.363 | 3.191 | 3.023 | 5.41 | 5.26 | 1.41 | 1.36 |
| 53 | 3.237 | 3.069 | 2.905 | 5.49 | 5.34 | 1.43 | 1.38 |
| 54 | 3.116 | 2.952 | 2.793 | 5.56 | 5.41 | 1.46 | 1.41 |
| 55 | 3.001 | 2.841 | 2.685 | 5.64 | 5.48 | 1.48 | 1.44 |
| 56 | 2.890 | 2.734 | 2.582 | 5.71 | 5.55 | 1.51 | 1.46 |
| 57 | 2.784 | 2.632 | 2.484 | 5.79 | 5.62 | 1.54 | 1.49 |
| 58 | 2.682 | 2.534 | 2.390 | 5.86 | 5.69 | 1.56 | 1.52 |
| 59 | 2.585 | 2.440 | 2.299 | 5.93 | 5.76 | 1.59 | 1.54 |
| 60 | 2.491 | 2.350 | 2.213 | 6.01 | 5.83 | 1.62 | 1.57 |
| 61 | 2.401 | 2.264 | 2.130 | 6.08 | 5.90 | 1.64 | 1.60 |
| 62 | 2.315 | 2.181 | 2.051 | 6.15 | 5.96 | 1.67 | 1.62 |
| 63 | 2.233 | 2.102 | 1.975 | 6.22 | 6.03 | 1.70 | 1.65 |
| 64 | 2.154 | 2.026 | 1.903 | 6.29 | 6.10 | 1.72 | 1.68 |
| 65 | 2.077 | 1.953 | 1.833 | 6.36 | 6.16 | 1.75 | 1.70 |
| 66 | 2.004 | 1.883 | 1.766 | 6.42 | 6.23 | 1.77 | 1.73 |
| 67 | 1.934 | 1.816 | 1.702 | 6.49 | 6.29 | 1.80 | 1.76 |
| 68 | 1.867 | 1.752 | 1.641 | 6.56 | 6.35 | 1.83 | 1.78 |
| 69 | 1.802 | 1.690 | 1.582 | 6.62 | 6.41 | 1.85 | 1.81 |
| 70 | 1.740 | 1.631 | 1.525 | 6.69 | 6.48 | 1.88 | 1.84 |
| 71 | 1.680 | 1.574 | 1.471 | 6.75 | 6.54 | 1.91 | 1.86 |
| 72 | 1.622 | 1.519 | 1.419 | 6.82 | 6.60 | 1.93 | 1.89 |
| 73 | 1.567 | 1.466 | 1.369 | 6.88 | 6.66 | 1.96 | 1.92 |
| 74 | 1.514 | 1.416 | 1.321 | 6.94 | 6.71 | 1.98 | 1.94 |
| 75 | 1.463 | 1.367 | 1.275 | 7.00 | 6.77 | 2.01 | 1.97 |